




50HZ/60HZ

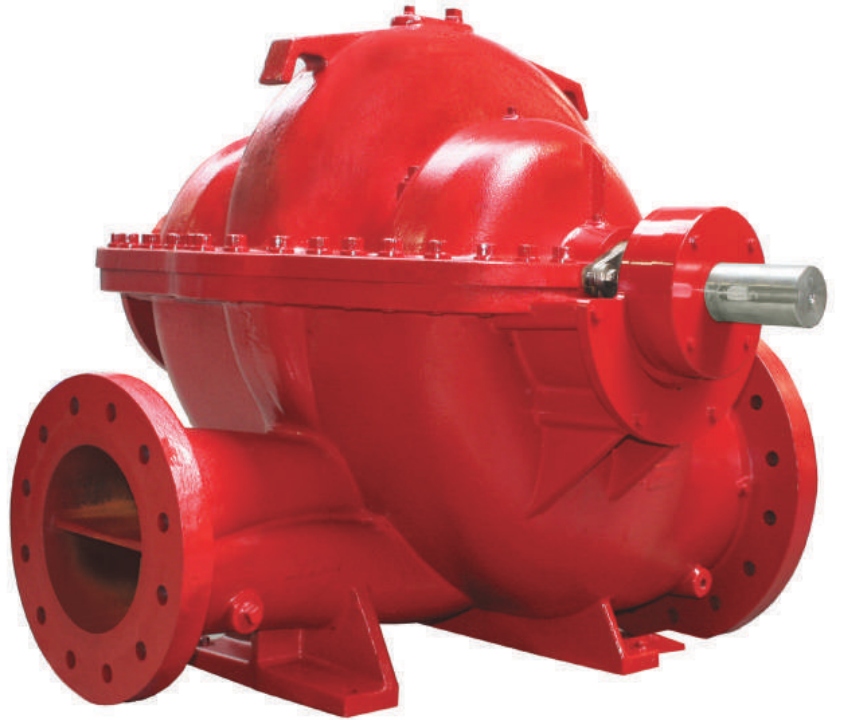

**MENA**  
MECHANICAL INDUSTRIES CO.

# FIRE PUMP

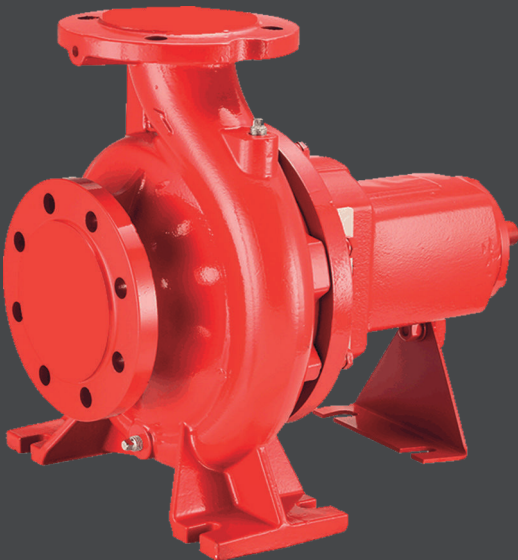

	
	Doc. Ref. <b>TS-75013-ES2545</b>
Customer Name <b>WATERWAVE</b>	
Project Name:	


## Fire Pump Set Technical Submittal

### END SUCTION

**(E+D+J)**

**Capacity  
750GPM @ 13 BAR**


<b>0</b>	<b>SUBMITTED FOR APPROVAL</b>	<b>KY</b>	<b>KY</b>		<b>18/12/2025</b>
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

### DOCUMENT INDEX

Part	Seq. No.	Doc. Ref.	Description	Remarks
GENERAL DOCUMENTS	01	GD-SVL	Sub-Vendor List	
	02	GD-STS	System Technical Specifications	
	03	GD-CE	UL/FM Certificates	
	04	GD-CP	Catalogue and Trade License	
			GD-PR	PREVIOUS APPROVALS
DIESEL DRIVEN PUMP	05	DDP-PSC-750	Diesel Engine Driven Pump Specifications	
	06	DDP-DES	Diesel Engine Specifications	
	07	DDP-PCS-24V	Diesel Engine driven fire pump controller specifications	
ELECTRIC DRIVEN PUMP	08	EDP-PSC-750	Electric motor driven pump specifications	
	09	EDP-EMS-200/2	Electric motor specifications	
	10	EDP-PCS	Electric motor driven fire pump controller specifications	
JOCKEY PUMP	11	JP-RV	Jockey Pump Specifications	
	12	JP-PCS-JP3	Jockey Pump Controller	
ACCESSORIES	13	A-CRV-R	Casing Relief Valve	
		A-PG-W	Pressure Guages	
		A-FM-GRND	Flowmeter	
		A-CS-180	Diesel Fuel Tank Drawing	
		A-CS-PRV	PRV	
		A-DW	DRAFT WARRANTY	




0	SUBMITTED FOR APPROVAL				
Rev	Description	Prepared	Checked	Approved	Date


		

**SUB VENDOR LIST**

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

## SUB VENDOR LIST

EQUIPMENT	BRAND	MAKE	DESCRIPTION
END SUCTION FIRE PUMP		MENA MECHANICAL INDUSTRIES, UAE	RANGE: 50 - 1000 US GPM upto 230 PSI
DIESEL DRIVER	<b>TAIDONG</b>	TAIDONG UL LISTED	RANGE: 24 - 262 HP from 2920 - 3000 RPM
FIRE PUMP MOTOR	<b>TECHTOP MOTOR</b>	TECHTOP UL LISTED	RANGE: 15HP- 350HP Type: ODP & TEFC, NEMA2
FIRE PUMP CONTROLLERS		TORNATECH, INC UL LISTED & FM APPROVED	RANGE: 11kW to 350KW Type: Diesel, Electric, Jockey
FLOWMETER		GERAND, USA FM APPROVED	RANGE: 2-1/2 Inch to 8 Inch UP TO 300 PSI
Casing Relief Valve	<b>FLUID</b>	<b>FLUID</b> UL LISTED , INDIA	RANGE: 3/4-1" UP TO 300 PSI

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name	Contractor Job No.	


## SYSTEM TECHNICAL SUBMITTAL

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>


**PUMP PERFORMANCE CURVE**

Pump	
Model	VES 100-315
Type	END SUCTION-50 HZ
Specific Speed	2900
Dimension	5x4
Power Rating	
Engine HP	

Search Criteria			
Flow In GPM	750	Head In (Bar)	13
Fluid			
Fluid	Water		
Atm Pressure	101 Mpa		

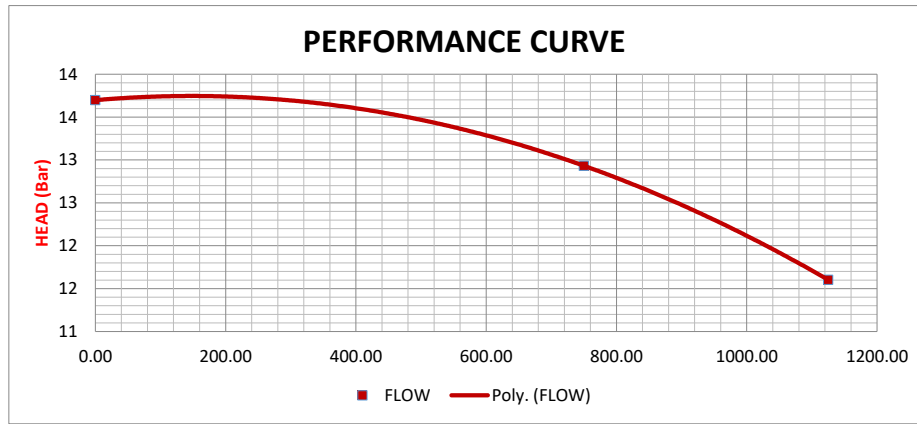

Data Point	
Flow (GPM)	750
Head (Bar)	13
Eff	64.14
BHP@150%	149.52
Design Curve	
Shutoff head	13.70
Flow @150%	1125
H(Bar)@150%	11.60
Power-150%	149.520
RPM	2,900
Driver Rating	
Motor (HP)	NA
Engine(HP)	185

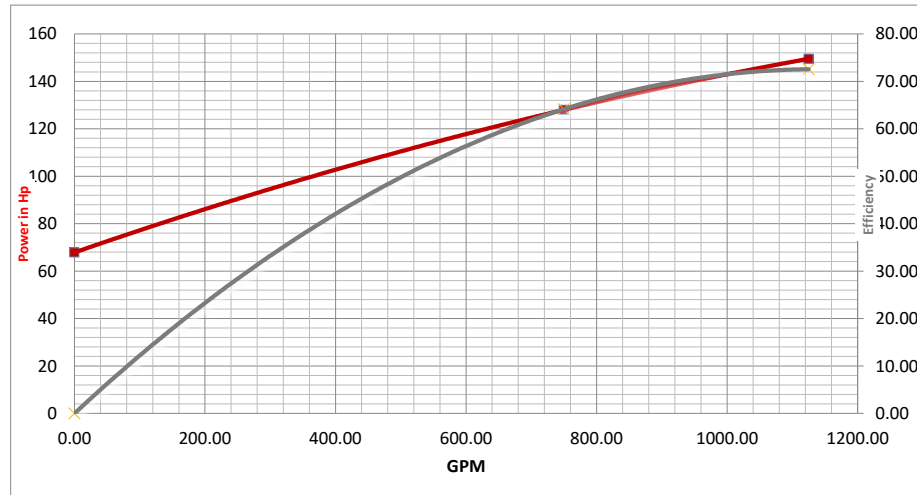

**Performance Evaluation**

Flow In GPM	Pressure in M(Bar)	Power In KW	Efficiency
0.00	13.70	67.859	0.00
750.00	12.93	127.978	64.14
1125.00	11.60	149.520	72.55







\*Manufacturer Reserves Right to Revise the specs and contains without prior notice

Performance Curve	original	<b>Engineering</b>	copy	N/A	DOC PCD-VES 100-315-750-13-2900
-------------------	----------	--------------------	------	-----	---------------------------------

## Diesel Fire Pump

**Item Description**

**Proposed**




<b><u>Diesel Pump:</u></b>	
Make	: MENA (MENA Mechanical Industries) UL Listed
Model	: VES100-315
Type	: End Suction Fire Pump
Rated Flow	: 750 USGPM
Rated Head	: 13 BAR
Rated Speed	: 2900 RPM
Casing	: Ductile Iron
Impeller	: Bronze
Material Shaft	: ASTM 420
Brand	: 
Pump Approval	: UL Listed 
<b><u>Diesel Engine:</u></b>	
Make	: TAIDONG
Model / Hp	: 6110THE / 185 HP
Cooling Method	: Heat Exchanger
Speed	: 2920 RPM
Engine Approval	: UL Listed 
<b><u>Diesel Pump Controller</u></b>	
Make	: "Tornatech" 
Model	: GPD-24-220
Operation	: Combined Automatic , Manual Start
Enclosure	: NEMA 2
Mounting	: FLOOR / WALL
Method of Start	: Standard
Operation Interface	: Standard
Power Supply	: 220V AC, 24V DC
Controller Approval	: UL Listed & FM Approved, Built to NFPA 20 Standards  



DRAWING NO.

IF IN DOUBT, PLEASE ASK

REVISIONS						
ZONE	LTR	DESCRIPTION	DATE	BY	CHECKED	APPROVED

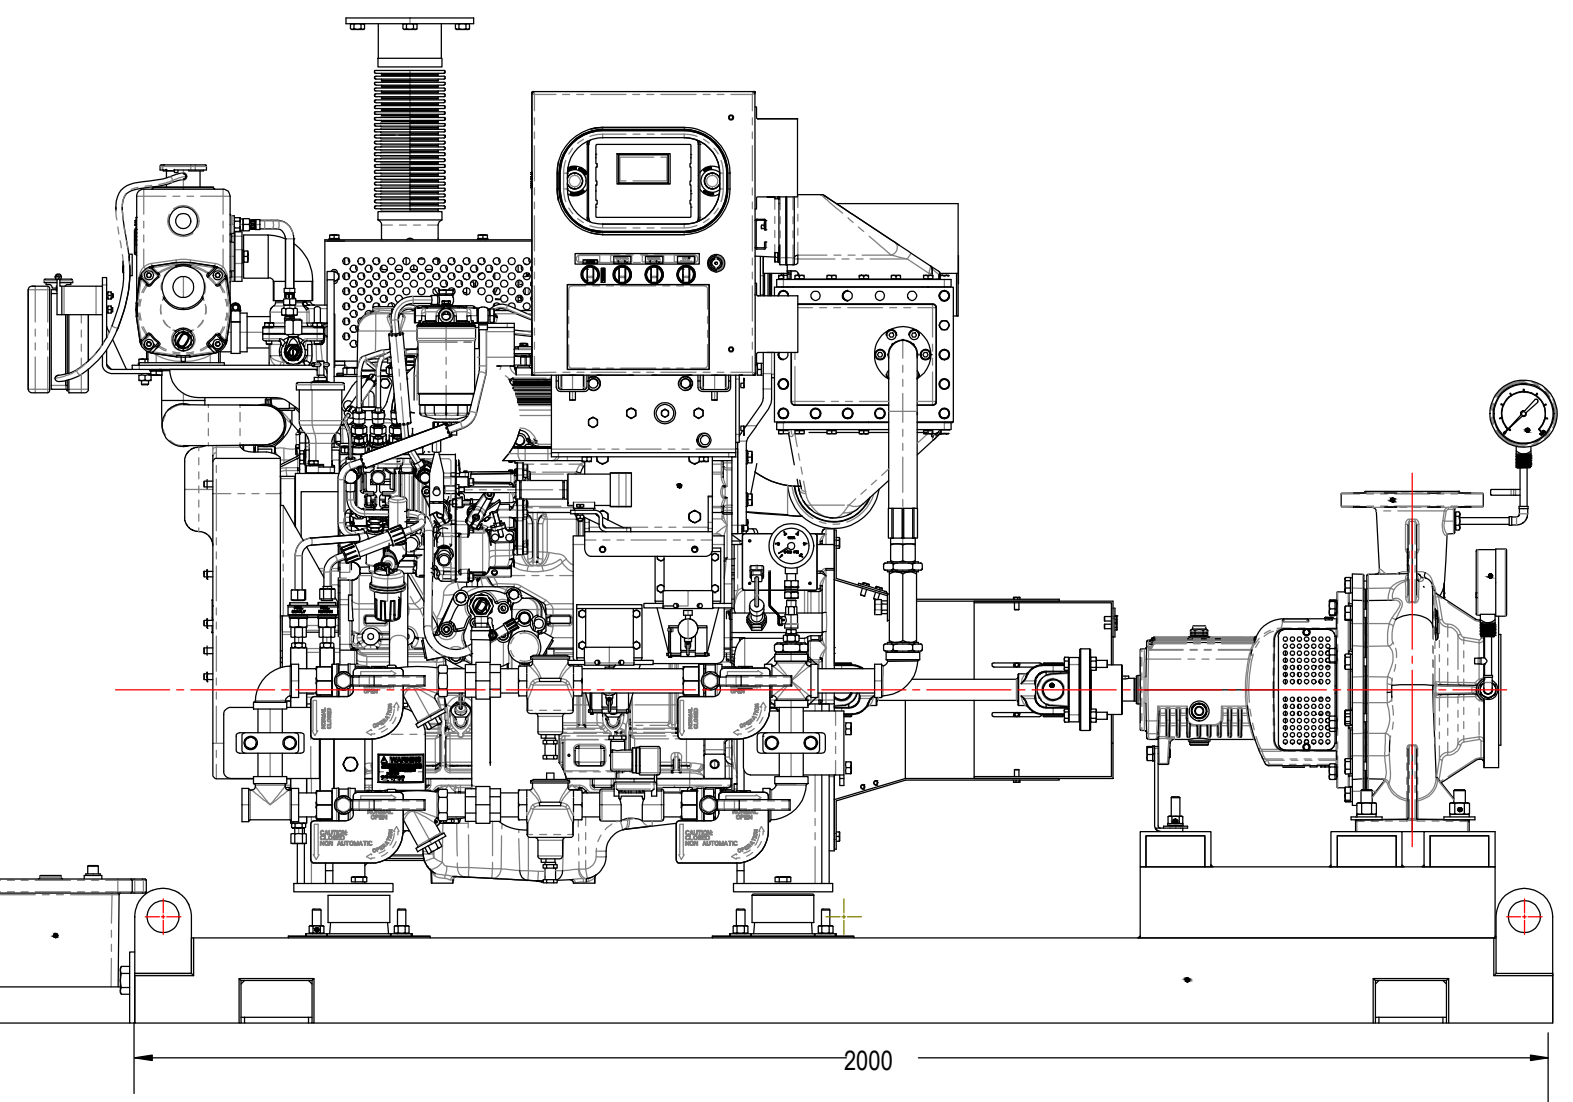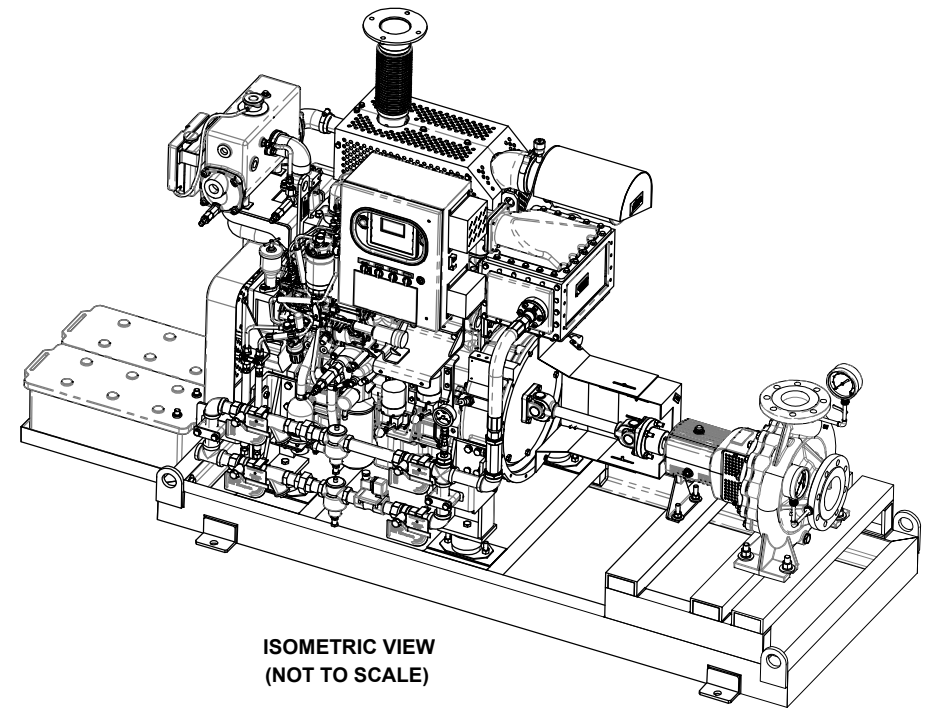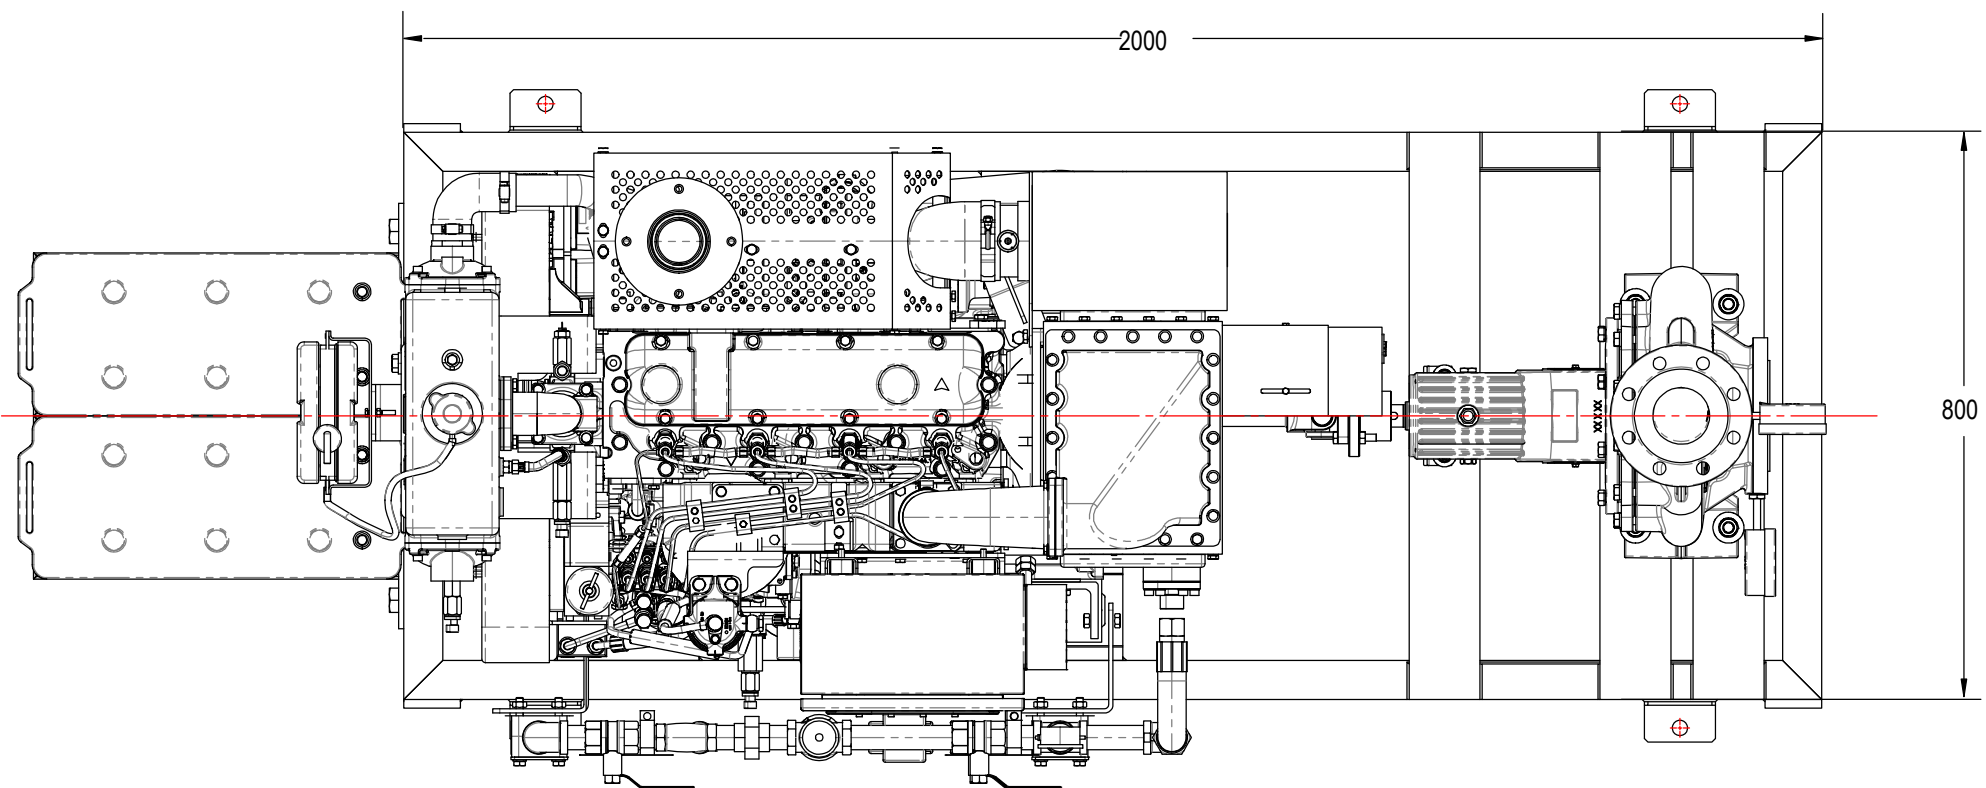


UNLESS OTHERWISE SPECIFIED: 1. REMOVE ALL BURRS AND SHARP EDGES 2. FILLETS $\frac{1}{8}$ R MAX. 3. CUT OR MACHINED SURFACES TO HAVE 1:50 4. DIMENSIONS ARE IN MM. 5. TOLERANCES ARE: DECIMAL ANGLES .X .50 ±30' .XX ±20	<b>MENA MECHANICAL</b>		DRAWING NO.
	APPROVALS	DATE	DESCRIPTION:
	DRAWN OA	02/1/24	UL VES 100-315
	CHECKED		DIESEL ENGINE TAIDONG @ 2920 RPM, W/ BASE PLATE
MATERIAL:	APPROVED	ASSEMBLY (750GPM @ 13 BAR)	SHEET: 1 of 1
WEIGHT:	CROSS REFERENCE	SCALE:	THE DESIGN AND OTHER INFORMATION CONTAINED IN THIS DRAWING ARE PROPERTY OF MENA MECH IND. EXCEPT FOR RIGHTS EXPRESSLY GRANTED BY CONTRACT. THIS DRAWING MAY NOT IN WHOLE OR IN PART BE DUPLICATED OR USED FOR MANUFACTURE WITHOUT WRITTEN PERMISSION OF MENA MECH IND.
		DIMENSION:	MM


### PUMP PERFORMANCE CURVE

Pump	
Model	VES 100-250
Type	END SUCTION-60 HZ
Specific Speed	3500
Dimension	5x4
Motor Rating	
Motor HP	

Search Criteria			
Flow In GPM	750	Head In (Bar)	13.03
Fluid			
Fluid	Water		
Atm Pressure	101 Mpa		

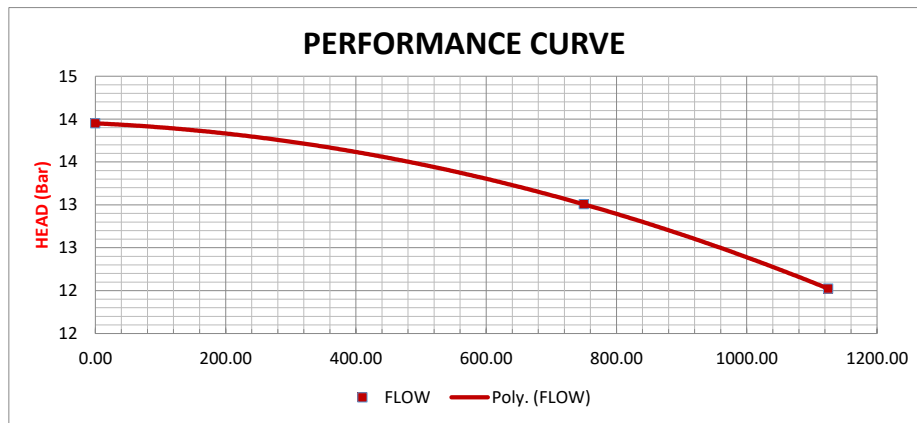

Data Point	
Flow (GPM)	750
Head (Bar)	13.03
Eff	61.00
BHP@150%	161.96
RPM	3500
Design Curve	
Shutoff head	13.95
Flow @150%	1125
H(Bar)@150%	12.02
Power-150%	161.390
Driver Rating	
Motor (HP)	200
Engine(HP)	NA

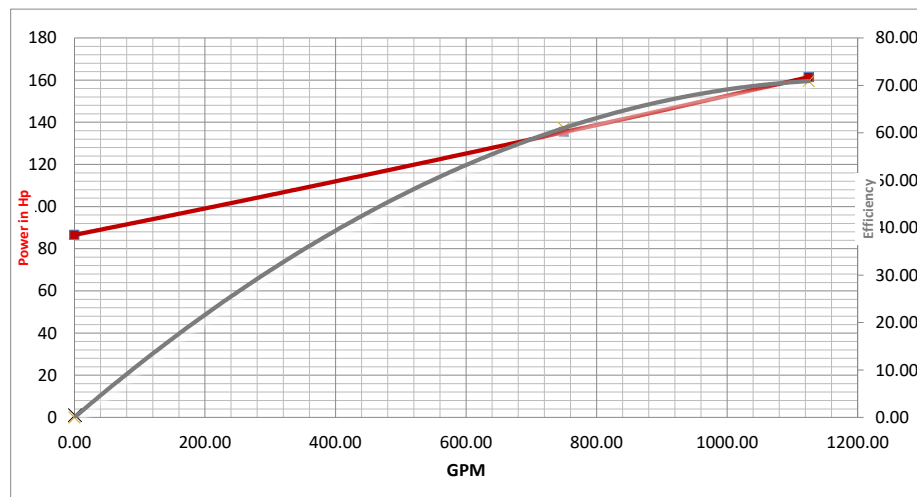

#### Performance Evaluation

Flow In GPM	Pressure in M(Bar)	Power In HP	Efficiency
0.00	13.95	86.563	0.00
750.00	13.01	135.294	61.00
1125.00	12.02	161.390	70.90







\*Manufacturer Reserves Right to Revise the specs and contains without prior notice

Performance Curve	original	<b>Engineering</b>	copy	N/A	DOC PCE-VES 100-250-750-13.03-3500
-------------------	----------	--------------------	------	-----	------------------------------------

## Electric Fire Pump

### Item Description



### Proposed

<b><u>Electric Pump:</u></b>	
Make	: MENA (MENA Mechanical Industries) UL Listed
Model	: VES100-250
Type	: End Suction Fire Pump
Rated Flow	: 750 USGPM
Rated Head	: 13 BAR
Rated Speed	: 3500 RPM
Casing	: Ductile Iron
Impeller Material	: Bronze
Shaft	: ASTM 420
Brand	: 
Pump Approval	: UL Listed 
<b><u>Electric Motor:</u></b>	
Make	: TECHTOP
Protection	: Class F
Type	: ODP
Performance Rating	: 200 HP, 3Ph, 60Hz , 380V, 2 POLES
Speed	: 3500 RPM
Motor Approval	: UL Listed 
<b><u>Electric Pump Controller</u></b>	
Make	: "Tornatech" 
Model	: GPY-380\200\3\60
Operation	: Combined Automatic , Manual Start & Remote Start
Enclosure	: NEMA 2
Mounting	: FLOOR / WALL
Method of Start	: STAR DELTA
Operation Interface	: Standard
Power Supply	: 3Ph, 380V, 60Hz
Controller Approval	: UL Listed & FM Approved, Built to NFPA 20 Standards  


DRAWING NO.

IF IN DOUBT, PLEASE ASK

REVISIONS						
ZONE	LTR	DESCRIPTION	DATE	BY	CHECKED	APPROVED

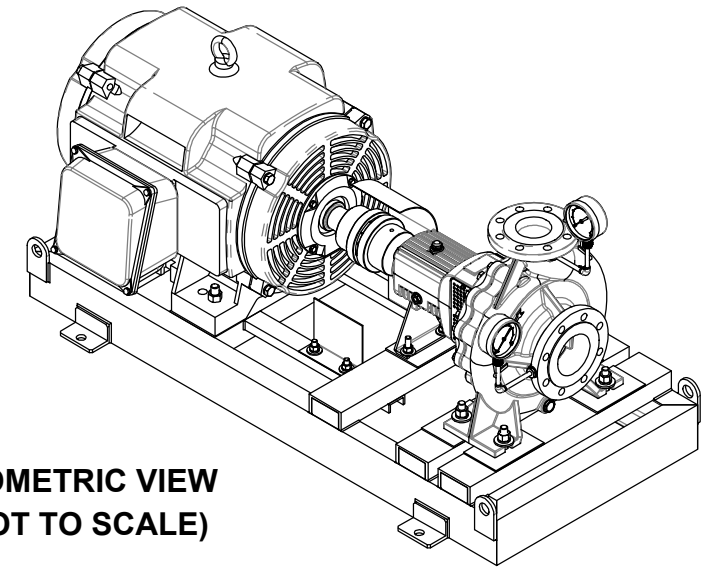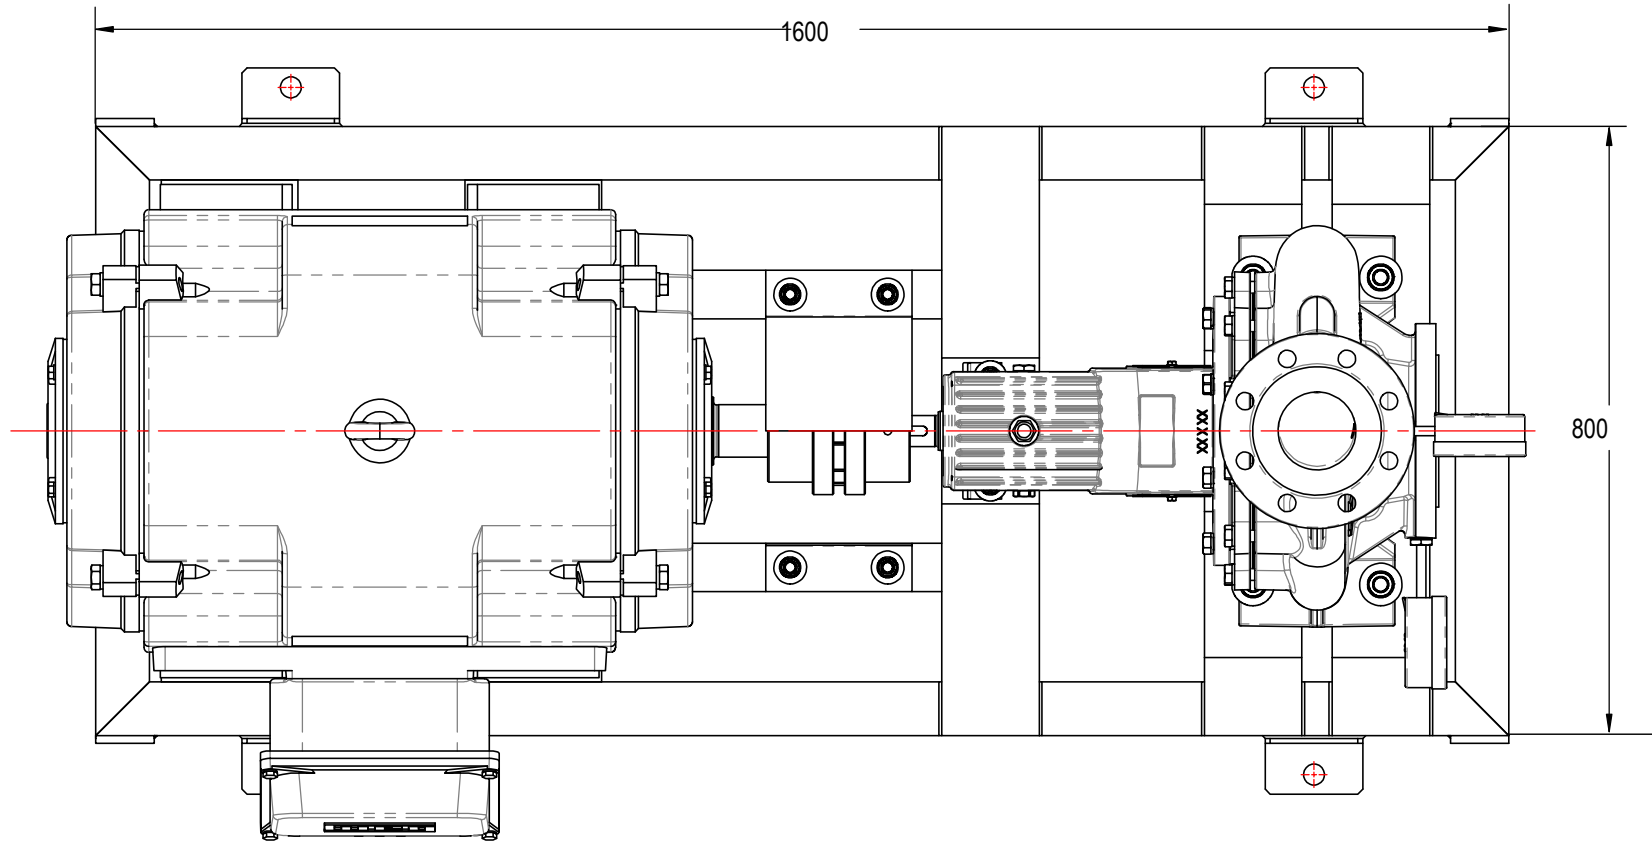

ISOMETRIC VIEW  
(NOT TO SCALE)

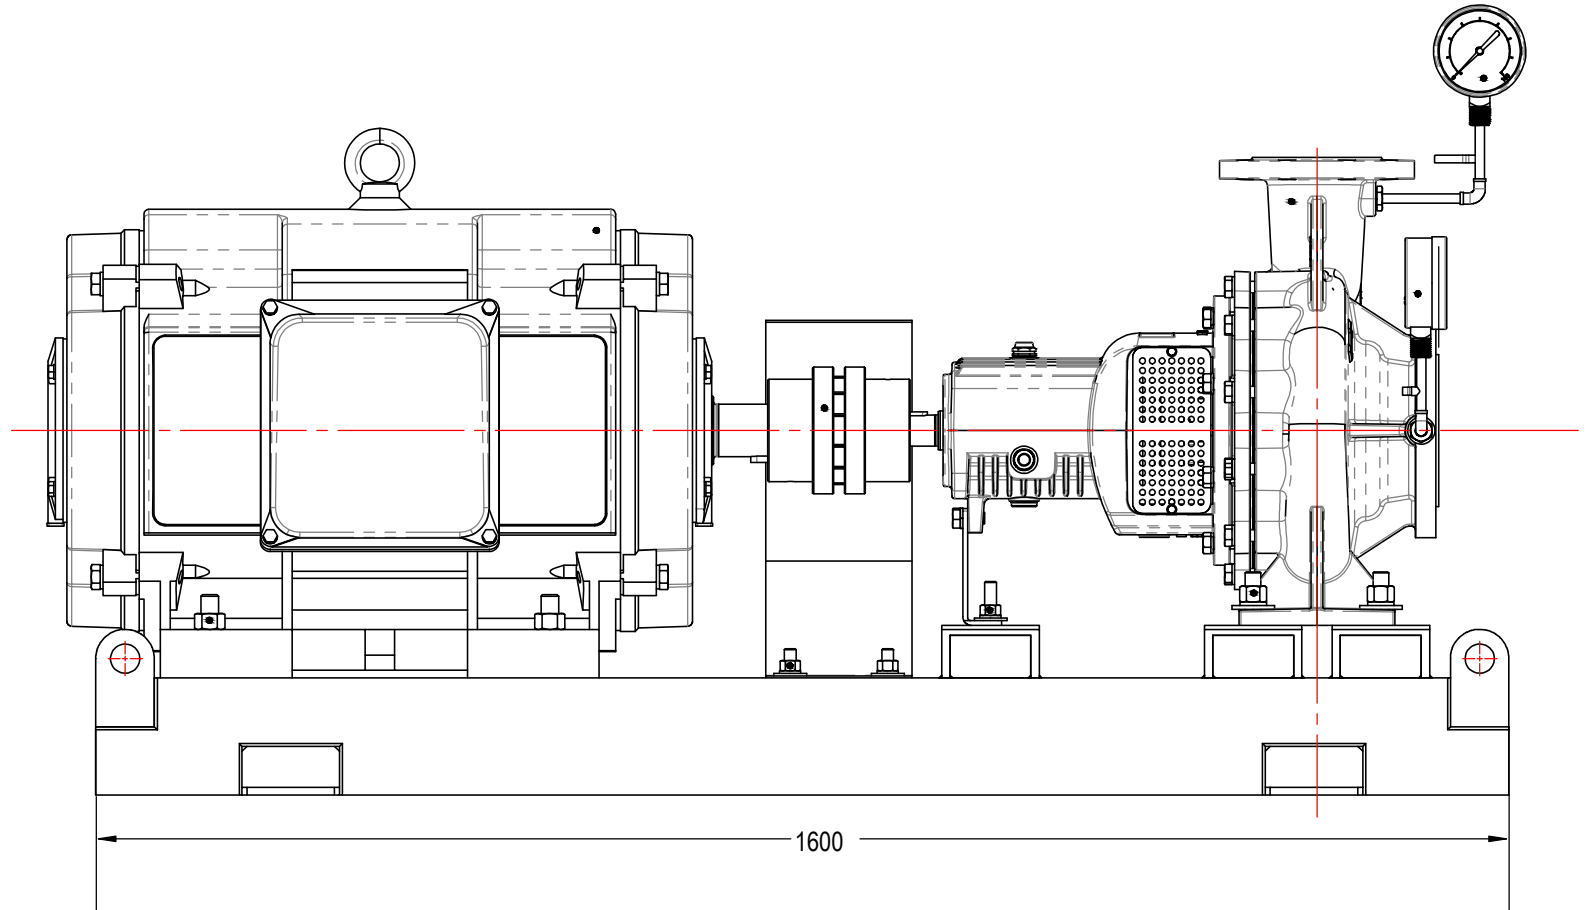




<small>UNLESS OTHERWISE SPECIFIED:  1. REMOVE ALL BURRS AND SHARP EDGES TO R MAX.  2. FILLETS TO R MAX.  3. CUT OR MACHINED SURFACES TO HAVE 1.6µm.  4. DIMENSIONS ARE IN MM.  5. TOLERANCES ARE:  DECIMAL ANGLES  .X .50 ±30'  .XX ±20 </small>	<b>MENA MECHANICAL</b>			DRAWING NO.	
	APPROVALS	DATE	DESCRIPTION:	VES 100-250	
	DRAWN	OA	02/1/24		
	CHECKED			ELECTRIC MOTOR- 200 HP -3550 RPM, W/ B ASSEMBLY	SHEET: 1 of 1
	APPROVED			ASSEMBLY ( 750GPM @ 13 BAR )	
<b>SEE PARTS LIST</b>	CROSS REFERENCE	SCALE:	THE DESIGN AND OTHER INFORMATION CONTAINED IN THIS DRAWING ARE PROPERTY OF MENA MECH IND. EXCEPT FOR RIGHTS EXPRESSLY GRANTED BY CONTRACT. THIS DRAWING MAY NOT IN WHOLE OR IN PART BE DUPLICATED OR USED FOR MANUFACTURE WITHOUT WRITTEN PERMISSION OF MENA MECH IND.		
WEIGHT:		DIMENSION:	MM		

## Jokey Fire Pump

**Item Description**

**Proposed**

<b><u>Electric Pump:</u></b>	
Make	: PACIFIC OR MENA Pumps
Model	: RV OR MNT
Type	: Vertical Multistage
Rated Flow	: 20 USGPM
Rated Head	: 13.5 BAR
Rated Speed	: 3500 RPM, 60 Hz
<b><u>Motor:</u></b>	
Type	: TEFC Motor
Power Supply	: 3 Ph, 380V, 60 hz
Rated power	: 5.5 Hp
Speed	: 3500RPM
<b><u>Jockey Pump Controller</u></b>	
Make	: "Tornatech" 
Model	: JP3-380\5.5\3\60
Operation	: Combined Automatic , Manual Start
Enclosure	: NEMA 2
Mounting	: WALL
Method of Start	: DOL
Operation Interface	: Touch Screen
Power Supply	: 3 Phase, 380 V, 60 Hz
Controller Approval	: UL Listed / Built to NFPA 20 Standards 

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name	Contractor Job No.	

### PREVIOUS APPROVALS

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

التاريخ: 2023/10/19  
الرقم: ME/LE/2023/C0106

## خطاب

بموجب هذا نحن شركة ميناء للصناعات الميكانيكية (شركة اماراتية بموجب رخصة تجارية رقم 763789) ، نؤكد ان مؤسسة موج الماء المضخات للتجارة (شركة سعودية بموجب رخصة تجارية رقم 43069093569) هي وكيل تجاري / موزع في المملكة العربية السعودية ولديها الصلاحيات بالتقديم للحصول على الاعتمادات من الاستشاريين ، كما انها مسؤولة عن خدمات الفحص وما بعد البيع لمضخات اطفاء الحريق ذات العلامة التجارية – MENA.

المدير العام

شركة ميناء للصناعات الميكانيكية



# Material Submittal Form

TRS-CN-FRM-0018



General Information			
Contractor	Coastal Contracting Company	Submittal No.	012
Contract No.	CC3000-CCC	Date	27-Jan-24
To the Engineer	Electrical Engineer	Approved Subcontractor <i>(as applicable)</i>	

Material Information			
Material Description <i>(One item only per Form)</i>	Fire Fighting Pump Set		
As per Specification	Proposed	Alternative	YES
Drawing Reference		BOQ Ref. No.	NA
Specification Reference	NA	Standards, BS, DIN	-

Manufacturer/Supplier			
Company Name	Mena Mechanical Industries Co.	Locally Manufactured	NA
Address	601-Shaheel 1 - Nahda 1- United Arab Emirates		
Local Agent	Water Wave Pump Trading EST.	Other Details	NA
Program Date <i>(Material Required on Site)</i>		Expected Arrival Date <i>(on Site)</i>	

Contractor's

\_\_\_\_\_  
Mahmoud Alshebli  
Name

\_\_\_\_\_  
  
Signature

\_\_\_\_\_  
31-Jan-24  
Date

Design Consultant - Comments

Comments: **Submit:  
Test Certificate**

\_\_\_\_\_  
Ahmed Senan  
Name

\_\_\_\_\_  
  
Signature

\_\_\_\_\_  
Date

Engineer's - Comments

Comments:

\_\_\_\_\_  
Name

\_\_\_\_\_  
Signature

\_\_\_\_\_  
Date

Status Code

Accepted       Accepted with Comments       Revise and Resubmit

Rejected       Review not Required

# SUBMITTAL REQUEST طلب اعتماد

PRE. DATE: التاريخ التقديم:	التقديم السابق: DATE: 17/05/2023	NO. رقم الاعتماد:	المالك: CLIENT
CONTRACTOR: المقاول:	CONSALTANT: الاستشاري:		
 MASADER PLUS LTD. MEP – LC Tabuk, KSA	 MOHAMMED FAHD ALSAUD ARCHITECTURE CONSULTANTS 3690, Jeddah 21481 KSA	 Saudi Air Navigation Services, Jeddah, KSA	

<b>PROJECT: KKIA FIRE PROTECTION (ATCT, ACC &amp; TSC)</b> اسم المشروع:			
ARCH	<input type="checkbox"/>	معماري	Design Drwgs.
STR	<input type="checkbox"/>	إنشائي	Shop Drwgs.
ELEC	<input type="checkbox"/>	كهرباء	Materials
MECH	<input checked="" type="checkbox"/>	ميكانيكا	Specs/Data
Other	<input type="checkbox"/>	أخرى	Other

بند رقم	وصف البند للإعتماد	رقم المبني	كتالوج الصانع أو مخططات المقاول	رقم المواصفات الفنية	عدد النسخ
ITEM NO.	DESCRIPTION OF ITEM	BLDG. NO.	MFG.CAT. OR CONTR. DRAWING NO.	SPEC. REF.	NO. OF COPIES
1	FIRE FIGHTING PUMP 1000 gpm & 16 bar	ATCT	MENA Fire Pumps		1
2	FIRE FIGHTING PUMP 500 gpm & 8 bar	ACC	MENA Fire Pumps		1

SIGNATURE: التوقيع:	CONSULTANT RECEIVED ON NAME: الاسم:
---------------------	-------------------------------------

REMARKS: الملاحظات:


Control panel for both fire pumps should operate to work on 55 degree temprature

500 GPM pump should operate delta star not DOL , Jocky pump for ATCT should starting methos ( Delta star ) not DOL


BATTERIES sholud not less than 2022 production

Contractor should arrange with supplier a bout diesel pump heater and all required wires connection to pump

For ACC building , IP control panels should not less than IP55 beause it is outdoor installation

	 المهندس المختص:	مدير المشروع: التاريخ:
--	--	---------------------------

COMMENTS: الملاحظات:

Project Engr. (SANS) مهندس المشروع المالك:	 التاريخ: 23.12.2023	<input type="checkbox"/> <input type="checkbox"/> Approved معتمدة <input type="checkbox"/> <input checked="" type="checkbox"/> Approved except as noted معتمدة مع ملاحظات <input type="checkbox"/> <input type="checkbox"/> Resubmit as noted يعاد التقديم بعد التعديل <input type="checkbox"/> <input type="checkbox"/> Disapproved مرفوضة <input type="checkbox"/> <input type="checkbox"/> For Information للعلم
Project Manager (SANS) مدير المشروع المالك:		

SIGNATURE: التوقيع:	CONTRACTOR RECEIVED ON NAME: اسم المقاول بتاريخ:
---------------------	--

- Diesel tank volume & dimension to be specified in the submittal.
- Selection is based on actual hydraulic calculation , any lack of coordination is the contractor responsibility.
- Refer to Electrical Comments.
- Installation drawing for main and diesel pumps including any missed accessories should have been presented from the supplier
- Capable of furnishing not less than 150 percent of rated capacity at not less than 65 percent of total rated head. Shutoff head is limited to 140 percent of total rated head.
- Flow measurement systems components to be match with project pressure ratings.



محمد فهد السعود

للإستشارات الهندسية  
 MOHAMMED F. ALSAUD CONSULTANT  
 4030250538 السجل التجاري:  
 رقم الترخيص: 110003976

**DUKAN WAREHOUSE  
AL KHUMRAH - JEDDAH**

S. No.	Materials	Listings	Approved / Acceptable Brands	Remarks
1	Black Steel Sch#40 Pipes	SASO	SSP / Sumitomo / Jazira	require sample for GMC Sch#40, ERW pipes
2	Grooved Fittings	UL / FM	Victaulic / Gruvlok / Shurjoint	require sample for LEDE groove fittings
3	Threaded Fittings	SASO	Gourd Hitachi	
4	Alarm Check Valves, OS&Y Gate Valves, Gear Operated Butterfly Valves, Swing Check Valves, Strainer, Zone Drain & Test Valves	UL / FM	Victaulic / Gruvlok / Tyco	
5	Automatic Air Vents	UL / FM	Claval	
6	Sprinklers	UL / FM	Victaulic / Viking / Gem / Tyco	
7	Fire Extinguishers	SASO	Sffeco	
8	Fire Hose Cabinets	SASO	Sffeco	
9	Fire Department Siamese Connection	UL / FM	Potter / Giocomini	
10	Flow Switches	UL / FM	Potter	
11	Aerosol System	UL / FM	STAT-X	
12	Detection / alarm and Agent Release panel for Aerosol System	UL / FM	Potter	
13	Fire & Jockey Pumps	UL / FM	Mena	
14	Fire & Jockey Pump's Panels	UL / FM	TornaTech	
15	Flow Meter	UL / FM	Gerand	
16	Pilot Operated Relief Valve for Diesel Pump	UL / FM	Claval	
17	Emergency Lights (minimum 3 hours backup)	SASO	Vielux	
18	Fire Alarm System	UL / FM	Simples / Context	
19	Fire Doors	SASO	Sffeco	
20	Pressure Gauges	UL / FM	WIKAI	
21	Hangers / Supports / Threaded Rods	UL / FM		require sample for submitted brand



Consultant	Project Management	Contractor
------------	--------------------	------------

**MATERIAL SUBMITTAL FORM**

Project Name. : **BUTAT RISE TOWER , ALSHUBALY -DAMMAM**  
 Project No. : \_\_\_\_\_ Date : **06/07/2024**  
 Submittal No. : **SH2-MAR-M-005** Specs Ref. No. \_\_\_\_\_  
 Contract Drawing Ref. No. : \_\_\_\_\_ B.O.Q Ref. No. \_\_\_\_\_

**DISCIPLINE**

Arch.  Civil  Elec.  Mech.  HVAC  L.S.  H.S.  Other

**Attachments**

Technical Brochure ( ) Manufacturer Specs ( ) Sample ( ) O & Manual ( ) Others

**Material Description**  
**Fire Pump**

Item in BOQ	Item	Brand	Model
<b>UL Listed Diesel Pump:</b>			
	UL Listed Split Case Fire Pump - 1000 gpm@17bar	<u>MENA</u>	<u>MSC5-80-350</u>
	UL/FM Diesel Engine	<u>KIRLOSKAR</u>	<u>KFP6R-UF26R1/ 247 HP</u>
	UL/FM Diesel Pump Controller	<u>"Tornatech", Canada</u>	<u>GPD-12-220</u>
<b>UL Listed Electrical Pump:</b>			
	UL Listed Split Case Fire Pump - 1000 gpm@17bar	<u>MENA</u>	<u>MSC6-125-310</u>
	UL Listed Electric Motor:	<u>MARATHON</u>	<u>ODP</u>
	UL/FM Electric Pump Controller	<u>"Tornatech", Canada</u>	<u>GPY-380\250\3\60</u>
<b>Jokey Pump:</b>			
	Vertical Multistage - 100 gpm@17bar	<u>PACIFIC</u>	<u>RV32</u>
	Electric Motor:	<u>TEFC Motor</u>	<u>Power : 30 HP</u>
	UL Listed Jockey Pump Controller	<u>"Tornatech", Canada</u>	<u>JP3-380\30\3\60</u>

**Name of Manufacturer :**  
**MINA Mechanical Industries Company**  
 Postal Address **Dammam - Saudi Arabia**  
 Tel # \_\_\_\_\_ Fax # \_\_\_\_\_  
 Web site address : \_\_\_\_\_ E-mail: \_\_\_\_\_

**Local Supplier / Agent :** **Professional Structure Services Co. (PSS)**  
 Postal Address **Dammam - Saudi Arabia**  
 Tel # \_\_\_\_\_ Fax # \_\_\_\_\_  
 Web site address : \_\_\_\_\_ E-mail: \_\_\_\_\_

Contractors Comments \_\_\_\_\_

Name: **Eng. Riyadh Saif** Date: **06/07/2024** Signature: \_\_\_\_\_

**Management Comments**

Name: \_\_\_\_\_ Date: \_\_\_\_\_ Signature: \_\_\_\_\_

(A) Approved   
  (B) Approved as Noted   
  (C) Revise and re submit   
  (D) Rejected

**COMMENTS**

Comments \_\_\_\_\_  
 Date : \_\_\_\_\_  
 Signature \_\_\_\_\_

**FINAL APPROVAL**

<p style="text-align: center;"><b>Consultant</b></p> <p>Name : _____ Date : _____</p> <p>Signature : _____</p>	<p style="text-align: center;"><b>Project Management</b></p> <p>Name : <b>Eng. Ahmed Elghareeb</b> Date <b>25-08-2024</b></p> <p>Signature : _____</p>
--	--



## Material Submittal

<b>OWNER</b>	: AL MOUSA HEALTH GROUP		
<b>CONSULTANT</b>	: --	<b>Document No.</b>	: AZ-PHC-MAT-ME-009
<b>CONTRACTOR</b>	: AL BADEEL CONTRACTING	<b>Date</b>	: 13-3-2025
<b>PROJECT</b>	: AZIZIYA PRIMARY HEALTH CARE	<b>Project No.</b>	: PHC
<b>LOCATION</b>	: Al Khobar		

Project	AZIZIYA PRIMARY HEALTH CARE	Submittal No.	REV00	Ref. Spec's	3.3
Ref. Dwg.	----	Date			

**Description:** (Manufacturer, Model No, Type, Size, Color Etc.)

### Fire Pump (MENA)

Catalogue
  Drawing
  Sample
  Certificate
  Others

Having Checked this submittal, we certify it conforms to the requirements  
Of the contract Documents in all respects, except as otherwise indicated herein

**Contractor:** Eng. Karim Mahmoud

**Signature:** K.M

**Date:** 13-3-2025


#### ACTION

- Approved (A)  
 Approved As Noted (B)  
 Resubmittal Required (C)  
 Not Approved (D)

#### Remarks/Comments

approved subject to : attached calculation for final selection approval  
final approval after ceville defence approval

Profession	Name	Signature	Review Date
Site Manager			
Civil/Structural Engineer			
Architect			
Electrical Engineer			
Mechanical Engineer			

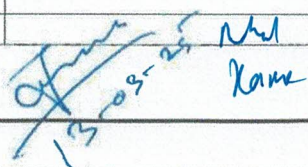
  
13-03-25




Submittal Ref.	FPC-101-MS-ME-006	Revision	Rev - 00	Date	13/07/2025
Project Title:	Business Park 101				

### Material Submittal Form

Client:	ASEEL				
Consultant:	ZENIT	Contractor	FPC		

Discipline	<input type="checkbox"/> Civil	<input type="checkbox"/> Architecture	<input checked="" type="checkbox"/> Mechanical	<input type="checkbox"/> Electrical	<input type="checkbox"/> Others .....
------------	--------------------------------	---------------------------------------	--	-------------------------------------	---------------------------------------

Material Details (to be filled by Contractor)		List of Enclosure
Specs. / BOQ / Drawings Reference	<b>FIREFIGHTING - FIRE PUMP SET - BRAND : MENA - UL LISTED - (1000 GPM &amp; 10 BAR )</b>	Copy of related spec's
Specified Material		Compliance Statement
Proposed Material		Samples
Manufacturer / Local Supplier		Others (Specify)
Reason for Alternative (if any)		
Remarks		

Submittal Status:	<input type="checkbox"/> A- Approved	<input checked="" type="checkbox"/> B- Approved with Comments	<input type="checkbox"/> C- Revise and Resubmit	<input type="checkbox"/> D- Rejected
-------------------	--------------------------------------	---	---	--------------------------------------

Engineer's Comments:

*please see the attached sheet for details.*

Note: This review does not relieve the contractor of his responsibilities under the terms of the contract nor authorize additional compensation.

	Name	Signature	Date
Submitted By (Contractor)	Adhe Jagadesh		13/07/2025
Received By (Consultant)			
Reviewed By (Consultant)	Taha A. Pascal		19-7-2025
Approved By (Consultant)			
Approved By (Client) *			

Note\*: Client Approving the Finishing Materials Only

## Mohamed Sayed

**From:** sherif.azab@madar-eng.com  
**Sent:** Monday, August 21, 2023 11:54 AM  
**To:** 'nbajudah@mina.com.sa'  
**Cc:** ahaddad@mina.com.sa; dr.ahmed@madar-eng.com; mohamed.sayed@madar-eng.com  
**Subject:** اعتماد ظلمبة الحريق الرئيسية - أبراج منى

المحترمين  
المحترم

السادة / شركة منى العقارية  
عناية / المهندس نبيل باجودة  
تحية طيبة وبعد .....

بمراجعة الكتالوج المرسل من طرفكم الخاص بظلمبة الحريق الرئيسية ماركة MENA نفيدكم بالاتي:

- تم اعتماد المضخات موديل VT150-265 قدرة 750 جالون / دقيقة ومعدل ضغط 17 بار.
- الاعتماد شامل المضخات والمحركات ولوحات التحكم والمحابس.
- الاعتماد طبقا للشهادات المقدمة من ال UL وال FM.
- يلزم على المصنع تقديم شهادة الإنشاء للمضخة وكذلك شهادة الاستيراد كون بلد المنشأ غير المملكة العربية السعودية.
- يرجى التنبيه على المصنع ان يكون طول الغاطس ( ال SUMP DEPTH ) مطابق لعمق الخزان.
- تركيب الغرفة يكون طبقا للمخططات المعتمدة و NFPA.

Technical Submittal

<https://drive.google.com/file/d/100nDm2AvDh-R3Ov8AfbCJIRMFaLkklCx/view?usp=sharing>

*Kind regards,*



شركة مدار الجزيرة  
للاستشارات الهندسية

**Sherif Azab,CFPS**

**Team Leader**

+966563692585 | [www.madar-eng.com](http://www.madar-eng.com) | [sherif.azab@madar-eng.com](mailto:sherif.azab@madar-eng.com)

7<sup>th</sup> floor-Msharek tower-3<sup>rd</sup> ring road-Makkah

**Checklist for Testing Fire Set-Pump Name / Electric – Diesel - Jockey**

Project:	Bandar Hamadeh for Contracting
Installation site:	Makkah Aziziya
Date of Start-Up	17/12/2023

**KSB/Duplex Submersible Pump Set**

<b>Performance data:</b>	
Pump Brand and Manufacture:	Pump Name/Origin
Pump Set Type:	Fire Fighting Pumps Set
Number of Pumps:	Electric – Diesel - Jockey
Set Location:	Fire Set Room

<b>Condition inspection:</b>	
Visual inspection of condition, impermeability and pressure gauge levels	Checked
Inspection of any leak in the fire set	Checked
inspection of control efficiency and smooth operation of pumps	Checked
Inspection / access to the installation room	Checked
Inspection of condition of installation area	Checked

<b>Operating mode:</b>	
Pump One (Electric)	AUTO
Pump Two (Diesel)	AUTO
Pump Three (Jockey)	AUTO

<b>Fire set activation / Pressure Set point</b>	
Electric Pump	Cut in: 160 Psi/ Cut out: 232 Psi
Diesel Pump	Cut in: 150 Psi/ Cut out: 232 Psi
Jockey Pump	Cut in: 190 Psi/ Cut out: 290 Psi
Voltage(V)	385 – 390 VOLT



#### Pumps testing

Operating pump 1	Done
Operating pump 2	Done
Operating pump 3	Done
Dry running protection	-
Peak load pump 1	Checked
Peak load pump 2	Checked
Peak load pump 3	Checked
Back up pump 1	Checked
Back up pump 2	Checked
Back up pump 3	Checked
Direction of rotation	Checked

#### Visual check

Check the function of the ball valve	Checked
Check pressure gauges operation	Checked
Check electrical connections	Checked
Check for any leakage in the pumps	Checked

#### Remarks:

Firefighting Pump Set have been tested and is functioning at full capacity with all accessories. It was handed over to the project manager and is in outstanding performance.



**Imad Al Halabi**  
**Waterwave Est**  
**0553004066**  
[imad@waterwave.site](mailto:imad@waterwave.site)  
[www.waterwave.site](http://www.waterwave.site)



Successful Handling Over Certificate

شهادة إنجاز و تسليم نهائي

شركة بندر حميدة للمقاولات مكة المكرمة

تشهد بان.....  
مجموعه الحريق يو إل ماركة مينا الإماراتية قد تم استلامها من قبل إستشاري الأمن و السلامة في الموقع و هي تعمل بصورة جيدة و بكفاؤة 150% و حسب التقرير المرفق

Bandar Hmeida Contracting Co

We the undersigned , ..... we confirm that above MENA UL Listed Fire Fighting Pump Set we handled over successfully to safety consultant and as per above parameters and 150% efficiency .





Vendor Ref. No.

Contractor Ref. No.

Contractor Job No.

Project Name:

**UL/FM CERTIFICATES**

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX28929  
**Report Reference** EX28929  
**Issue Date** 2023-JANUARY-04

**Issued to:** **MENA MECH IND CO.**  
Sharjah Al Sajaa Industrial Shed 6  
Victory Warehouse, Sajja New Industrial Area  
Sharjah, United Arab Emirates

**This certificate confirms that representative samples of** Centrifugal Fire Pumps, End Suction  
See Addendum for Models

Have been evaluated by UL in accordance with the Standard(s) indicated on this Certificate.

**Standard(s) for Safety:** ANSI/CAN/UL 448 – Centrifugal Stationary Pumps for Fire-Protection Service

**Additional Information:** See UL Product iQ® at <https://iq.ulprospector.com> for additional information.

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

*Deborah Jennings-Conner*

Deborah Jennings-Conner, VP Regulatory Services  
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/about/locations/>




# CERTIFICATE OF COMPLIANCE

**Certificate Number**    EX28929  
**Report Reference**      EX28929  
**Issue Date**              2023-JANUARY-04

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements.

Document Name	Rated Capacity, GPM (L/Min)	Inlet Size, in.	Outlet Size, in.	Minimum Net Pressure Range, psig (kPa)	Maximum Net Pressure Range, psig (kPa)	Approx Speed, RPM	Max Working Pressure, psig (kPa)
VES 100-200	450 (1,703)	5	4	88 (606)	143 (985)	3500	225 (1,551)
	500 (1,892)	5	4	88 (606)	141 (972)	3500	225 (1,551)
	750 (2,839)	5	4	82 (565)	138 (951)	3500	225 (1,551)
VES 100-250	450 (1,703)	5	4	83 (572)	135 (930)	2900	290 (1,999)
	450 (1,703)	5	4	123 (848)	198 (1,365)	3500	290 (1,999)
	500 (1,892)	5	4	83 (572)	134 (923)	2900	290 (1,999)
	500 (1,892)	5	4	122 (841)	198 (1,365)	3500	290 (1,999)
	750 (2,839)	5	4	74 (510)	128 (882)	2900	290 (1,999)
	750 (2,839)	5	4	115 (792)	191 (1,316)	3500	290 (1,999)
VES 100-315	450 (1,703)	5	4	133 (917)	210 (1,447)	2900	290 (1,999)
	450 (1,703)	5	4	140 (965)	222 (1,530)	2980	290 (1,999)
	500 (1,892)	5	4	132 (910)	209 (1,441)	2900	290 (1,999)
	500 (1,892)	5	4	139 (958)	221 (1,523)	2980	290 (1,999)
	750 (2,839)	5	4	125 (861)	202 (1,392)	2900	290 (1,999)
	750 (2,839)	5	4	133 (917)	214 (1,475)	2980	290 (1,999)
VES 40-250	50 (189)	2-1/2	1-1/2	101 (696)	142 (979)	2900	200 (1,378)
	50 (189)	2-1/2	1-1/2	144 (992)	207 (1,427)	3500	290 (1,999)
	100 (379)	2-1/2	1-1/2	97 (668)	140 (965)	2900	200 (1,378)
	100 (379)	2-1/2	1-1/2	140 (965)	203 (1,399)	3500	290 (1,999)
	150 (568)	2-1/2	1-1/2	87 (599)	131 (903)	2900	200 (1,378)
	150 (568)	2-1/2	1-1/2	133 (917)	196 (1,351)	3500	290 (1,999)
VES 50-250	150 (568)	3	2	104 (717)	147 (1,013)	2980	225 (1,551)
	150 (568)	3	2	144 (992)	202 (1,392)	3500	290 (1,999)
	200 (757)	3	2	101 (696)	145 (999)	2980	225 (1,551)
	200 (757)	3	2	140 (965)	200 (1,378)	3500	290 (1,999)
	250 (946)	3	2	97 (668)	140 (965)	2980	225 (1,551)
	250 (946)	3	2	136 (937)	196 (1,351)	3500	290 (1,999)
VES 65-250	250 (946)	4	2-1/2	91 (627)	143 (985)	2900	225 (1,551)
	250 (946)	4	2-1/2	131 (903)	207 (1,427)	3500	290 (1,999)
	300 (1,136)	4	2-1/2	89 (613)	142 (979)	2900	225 (1,551)
	300 (1,136)	4	2-1/2	130 (896)	206 (1,420)	3500	290 (1,999)
	400 (1,514)	4	2-1/2	82 (565)	137 (944)	2900	225 (1,551)
	400 (1,514)	4	2-1/2	125 (861)	203 (1,399)	3500	290 (1,999)
VES 80-200	400 (1,514)	5	3	89 (613)	141 (972)	3500	225 (1,551)
	450 (1,703)	5	3	86 (592)	139 (958)	3500	225 (1,551)
	500 (1,892)	5	3	83 (572)	136 (937)	3500	225 (1,551)

  
 Deborah Jennings-Conner, VP Regulatory Services  
 UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/aboutul/locations/>



# CERTIFICATE OF COMPLIANCE

**Certificate Number**    EX28929  
**Report Reference**      EX28929  
**Issue Date**              2023-JANUARY-04

Document Name	Rated Capacity, GPM (L/Min)	Inlet Size, in.	Outlet Size, in.	Minimum Net Pressure Range, psig (kPa)	Maximum Net Pressure Range, psig (kPa)	Approx Speed, RPM	Max Working Pressure, psig (kPa)
VES 80-250	400 (1,514)	5	3	88 (606)	140 (965)	2900	225 (1,551)
	400 (1,514)	5	3	128 (882)	207 (1,427)	3500	290 (1,999)
	450 (1,703)	5	3	86 (592)	140 (965)	2900	225 (1,551)
	450 (1,703)	5	3	127 (875)	206 (1,420)	3500	290 (1,999)
	500 (1,892)	5	3	84 (579)	139 (958)	2900	225 (1,551)
	500 (1,892)	5	3	125 (861)	205 (1,413)	3500	290 (1,999)
VES 80-315	450 (1,703)	5	3	131 (903)	207 (1,427)	2900	290 (1,999)
	500 (1,892)	5	3	127 (875)	204 (1,406)	2900	290 (1,999)
VESD 150-100-200	500 (1,892)	6	4	116 (799)	142 (979)	3500	225 (1,551)
	750 (2,839)	6	4	112 (772)	137 (944)	3500	225 (1,551)
	1,000 (3,785)	6	4	99 (682)	128 (882)	3500	225 (1,551)
VESD 150-100-315	500 (1,892)	6	4	119 (820)	192 (1,323)	2900	250 (1,723)
	750 (2,839)	6	4	113 (779)	186 (1,282)	2900	250 (1,723)
	1,000 (3,785)	6	4	101 (696)	173 (1,192)	2900	250 (1,723)

*Deborah Jennings-Conner*

Deborah Jennings-Conner, VP Regulatory Services  
UL LLC



Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/aboutul/locations/>

# CERTIFICATE OF COMPLIANCE

**Certificate Number** UL-US-2245391-0  
**Report Reference** EX26402-20221129  
**Date** 1-Dec-2022

**Issued to:** **TAIZHOU TAIDONG FIRE & MARINE POWER LTD**  
NO 51 XINGJIANG ROAD, PRIVATE ECONOMIC  
INDUSTRIAL CENTER  
JIANGYAN DISTRICT TAIZHOU, JIANGSU 225500  
China

**This is to certify that representative samples of** QYLU - **Internal-combustion Engines for Driving Stationary Fire Pumps**  
See Addendum Page for Product Designation(s).

Have been evaluated by UL in accordance with the Standard(s) indicated on this Certificate.


**Standard(s) for Safety:** UL 1247 , Edition: 5, Issue Date: 2007-5-31 , Revision Date: 2020-8-12

**Additional Information:** See the UL Online Certifications Directory at <https://iq.ulprospector.com> for additional information

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

  
Deborah Jennings-Conner, VP Regulatory Services

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



# CERTIFICATE OF COMPLIANCE

Certificate Number    UL-US-2245391-0  
Report Reference        EX26402-20221129  
Date                      1-Dec-2022

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Model	Category Description
4108HE	DIESEL ENGINES RATED AT SPECIFIC SPEEDS
6110THE	DIESEL ENGINES RATED AT SPECIFIC SPEEDS
6D250HE	DIESEL ENGINES RATED AT SPECIFIC SPEEDS
6D300HE	DIESEL ENGINES RATED AT SPECIFIC SPEEDS

*Deborah Jennings-Conner*

Deborah Jennings-Conner, VP Regulatory Services

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX26635  
**Report Reference** EX26635-20200127  
**Issue Date** 2020-FEBRUARY-14

**Issued to:** SHANGHAI TOP MOTOR CO LTD  
303 KANGLIU RD  
KANGQIAO TOWN  
NANHUI  
SHANGHAI  
201315 CHINA

**This certificate confirms that  
representative samples of**

FIRE PUMP MOTORS  
See Addendum page

Have been investigated by UL in accordance with the  
Standard(s) indicated on this Certificate.


**Standard(s) for Safety:** UL 1004-1, Rotating Electrical Machines – General  
Requirements  
UL 1004-5, Fire Pump Motors  
CSA C22.2 No. 100-14, Motors and Generators

**Additional Information:** See the UL Online Certifications Directory at  
<https://iq.ulprospector.com> for additional information.

This *Certificate of Compliance* does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>






# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX26635  
**Report Reference** EX26635-20200127  
**Issue Date** 2020-FEBRUARY-14

TXC449T250U4B,F-TXC449TS300U4B,F-TXC449TS300U4B,F-TXC449TS300U4B,F-TXC449TS300U4B,F-TXC586/7T350U4B,F-TXC586/7T350U4B,F-TXC586/7T350U4B,F-TXC586/7T350U4B,F-TXC586/7T400U4B,F-TXC586/7T400U4B,F-TXC586/7T400U4B,F-TXC586/7T400U4B,F-TXC586/7T450U4B,F-TXC586/7T450U4B,F-TXC586/7T450U4B,F-TXC586/7T450U4B,F-TXC145T1U6B,F-TXC145T1U6B,F-TXC145T1U6B,F-TXC145T1U6B,F-TXC182T1.5U6B,F-TXC182T1.5U6B,F-TXC182T1.5U6B,F-TXC182T1.5U6B,F-TXC184T2U6B,F-TXC184T2U6B,F-TXC184T2U6B,F-TXC184T2U6B,F-TXC213T3U6B,F-TXC213T3U6B,F-TXC213T3U6B,F-TXC213T3U6B,F-TXC215T5U6B,F-TXC215T5U6B,F-TXC215T5U6B,F-TXC215T5U6B,F-TXC254T7.5U6B,F-TXC254T7.5U6B,F-TXC254T7.5U6B,F-TXC254T7.5U6B,F-TXC256T10U6B,F-TXC256T10U6B,F-TXC256T10U6B,F-TXC256T10U6B,F-TXC284T15U6B,F-TXC284T15U6B,F-TXC284T15U6B,F-TXC284T15U6B,F-TXC286T20U6B,F-TXC286T20U6B,F-TXC286T20U6B,F-TXC324T25U6B,F-TXC324T25U6B,F-TXC324T25U6B,F-TXC324T25U6B,F-TXC326T30U6B,F-TXC326T30U6B,F-TXC326T30U6B,F-TXC326T30U6B,F-TXC364T40U6B,F-TXC364T40U6B,F-TXC364T40U6B,F-TXC364T40U6B,F-TXC365T50U6B,F-TXC365T50U6B,F-TXC365T50U6B,F-TXC365T50U6B,F-TXC404T60U6B,F-TXC404T60U6B,F-TXC404T60U6B,F-TXC404T60U6B,F-TXC405T75U6B,F-TXC405T75U6B,F-TXC405T75U6B,F-TXC405T75U6B,F-TXC444T100U6B,F-TXC444T100U6B,F-TXC444T100U6B,F-TXC444T100U6B,F-TXC445T125U6B,F-TXC445T125U6B,F-TXC445T125U6B,F-TXC445T125U6B,F-TXC447T150U6B,F-TXC447T150U6B,F-TXC447T150U6B,F-TXC447T150U6B,F-TXC449T200U6B,F-TXC449T200U6B,F-TXC449T200U6B,F-TXC449T200U6B,F-TXC586/7T250U6B,F-TXC586/7T250U6B,F-TXC586/7T250U6B,F-TXC586/7T300U6B,F-TXC586/7T300U6B,F-TXC586/7T300U6B,F-TXC586/7T350U6B,F-TXC586/7T350U6B,F-TXC586/7T350U6B,F-TXC586/7T350U6B,F-TXC586/7T400U6B,F-TXC586/7T400U6B,F-TXC586/7T400U6B,F-TXC586/7T400U6B,



Bruce Mahrenholz, Director North American Certification Program

UL LLC


Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX26635  
**Report Reference** EX26635-20200127  
**Issue Date** 2020-FEBRUARY-14

F-TDC254T15U2B,F-TDC254T15U2B,F-TDC254T15U2B,F-TDC254T15U2B,F-TDC256T20U2B,F-TDC256T20U2B,F-TDC256T20U2B,F-TDC256T20U2B,F-TDC284TS25U2B,F-TDC284TS25U2B,F-TDC284TS25U2B,F-TDC284TS25U2B,F-TDC286TS30U2B,F-TDC286TS30U2B,F-TDC286TS30U2B,F-TDC286TS30U2B,F-TDC286TS40U2B,F-TDC286TS40U2B,F-TDC286TS40U2B,F-TDC286TS40U2B,F-TDC324TS40U2B,F-TDC324TS40U2B,F-TDC324TS40U2B,F-TDC324TS40U2B,F-TDC324TS50U2B,F-TDC324TS50U2B,F-TDC324TS50U2B,F-TDC324TS50U2B,F-TDC326TS50U2B,F-TDC326TS50U2B,F-TDC326TS50U2B,F-TDC326TS50U2B,F-TDC326TS60U2B,F-TDC326TS60U2B,F-TDC326TS60U2B,F-TDC326TS60U2B,F-TDC364TS60U2B,F-TDC364TS60U2B,F-TDC364TS60U2B,F-TDC364TS60U2B,F-TDC364TS75U2B,F-TDC364TS75U2B,F-TDC364TS75U2B,F-TDC364TS75U2B,F-TDC365TS75U2B,F-TDC365TS75U2B,F-TDC365TS75U2B,F-TDC365TS75U2B,F-TDC365TS100U2B,F-TDC365TS100U2B,F-TDC365TS100U2B,F-TDC365TS100U2B,F-TDC405TS100U2B,F-TDC405TS100U2B,F-TDC405TS100U2B,F-TDC405TS100U2B,F-TDC404TS125U2B,F-TDC404TS125U2B,F-TDC404TS125U2B,F-TDC404TS125U2B,F-TDC444TS125U2B,F-TDC444TS125U2B,F-TDC444TS125U2B,F-TDC444TS125U2B,F-TDC405TS150U2B,F-TDC405TS150U2B,F-TDC405TS150U2B,F-TDC405TS150U2B,F-TDC445TS150U2B,F-TDC445TS150U2B,F-TDC445TS150U2B,F-TDC445TS150U2B,F-TDC444TS200U2B,F-TDC444TS200U2B,F-TDC444TS200U2B,F-TDC444TS200U2B,F-TDC447TS200U2B,F-TDC447TS200U2B,F-TDC447TS200U2B,F-TDC447TS200U2B,F-TDC449TS250U2B,F-TDC449TS250U2B,F-TDC449TS250U2B,F-TDC449TS250U2B,F-TDC447TS300U2B,F-TDC447TS300U2B,F-TDC447TS300U2B,F-TDC449TS300U2B,F-TDC449TS300U2B,F-TDC449TS300U2B,F-TDC449TS300U2B,F-TDC447TS350U2B,F-TDC447TS350U2B,F-TDC447TS350U2B,F-TDC449TS350U2B,F-TDC449TS350U2B,F-TDC449TS350U2B,F-TDC449TS350U2B,F-TDC449TS400U2B,F-TDC449TS400U2B,F-TDC449TS400U2B,F-TDC449TS400U2B,F-TDC449TS450U2B,F-TDC449TS450U2B,F-TDC449TS450U2B,F-TDC449TS450U2B,F-TDC449TS500U2B,F-TDC449TS500U2B,F-TDC449TS500U2B,F-TDC254T15U4B,F-TDC254T15U4B,F-TDC254T15U4B,F-TDC254T15U4B,F-TDC256T20U4B,F-TDC256T20U4B,F-TDC256T20U4B,F-TDC256T20U4B,F-TDC284T25U4B,F-TDC284T25U4B,F-TDC284T25U4B,F-TDC284T25U4B,F-TDC286T30U4B,F-TDC286T30U4B,F-TDC286T30U4B,F-TDC286T30U4B,F-TDC324T40U4B,F-TDC324T40U4B,F-TDC324T40U4B,F-TDC324T40U4B,F-TDC326T50U4B,F-TDC326T50U4B,F-TDC326T50U4B,F-TDC326T50U4B,F-TDC364T60U4B,F-TDC364T60U4B,F-TDC364T60U4B,F-TDC364T60U4B,F-TDC365T75U4B,F-TDC365T75U4B,F-TDC365T75U4B,F-TDC365T75U4B,F-TDC405T100U4B,F-TDC405T100U4B,F-TDC405T100U4B,F-TDC405T100U4B,F-TDC405T125U4B,F-TDC405T125U4B,F-TDC405T125U4B,F-TDC405T125U4B,F-TDC444T125U4B,F-TDC444T125U4B,F-TDC444T125U4B,F-TDC444T125U4B,F-TDC444T150U4B,F-TDC444T150U4B,F-TDC444T150U4B,F-TDC444T150U4B,F-TDC445T150U4B,F-TDC445T150U4B,F-TDC445T150U4B,F-TDC445T150U4B,F-TDC445T200U4B,F-TDC445T200U4B,F-TDC445T200U4B,F-TDC445T200U4B,F-TDC447T200U4B,F-TDC447T200U4B,F-TDC447T200U4B,F-TDC447T200U4B,F-TDC447T250U4B,F-TDC447T250U4B,F-TDC447T250U4B,F-TDC447T250U4B,F-TDC449T250U4B,F-TDC449T250U4B,F-TDC449T250U4B,F-TDC449T250U4B,F-TDC449T300U4B,F-TDC449T300U4B,F-TDC449T300U4B,F-TDC449T300U4B,F-TDC449T350U4B,F-TDC449T350U4B,F-TDC449T350U4B,F-TDC449T350U4B,F-



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>



# CERTIFICATE OF COMPLIANCE

Certificate Number EX26635  
Report Reference EX26635-20200127  
Issue Date 2020-FEBRUARY-14

TDC449T350U4B,F-TDC449T350U4B,F-TDC449T400U4B,F-TDC449T400U4B,F-  
TDC449T400U4B,F-TDC449T400U4B,F-TDC449T450U4B,F-TDC449T450U4B,F-TDC449T450U4B,

  
Bruce Mahrenholz, Director North American Certification Program  
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>





## QYZS.EX3971 Pump Controllers, Fire

[Page Bottom](#)

### Pump Controllers, Fire

[See General Information for Pump Controllers, Fire](#)

#### TORNATECH INC

EX3971

#132  
7075 PLACE ROBERT-JONCAS  
ST LAURENT, QC H4M 2Z2 CANADA

**Fire Pump Controllers:** Models AF, AFP, AFR, AFY, ATF, ATR, ATP or ATY followed by C or N, followed by additional suffixes. All of the above controllers are suitable for use on circuits capable of delivering high fault currents. The withstand ratings are as follows:

Circuit Breaker	Max V AC	Max Short Circuit Current RMS Symmetrical Amps
MZMH6-63, MZMH6-100,	208; 240	25000; 42,000
MZMH6-160, MZMH6-250		
MZMH6-63, MZMH6-100,	480	65,000
MZMH6-160, MZMH6-250		

The controllers provided with Automatic Transfer Switches are suitable for use on circuits capable of delivering high fault currents. The withstand rating of the normal power source side is determined by the transfer switch as indicated below:

ASCO Transfer Switch	Max Controller Short Circuit Withstand Rating
9403704	22KA, 480 VAC Max
94031004	22KA, 480 VAC Max
94032604	35KA, 480 VAC Max

The withstand ratings for the alternate power source side will be dependent upon the ratings of the external circuit breaker provided. But in no case will they exceed those of the normal power source side.

Models AL or AL1 followed by additional suffixes.

All of the above controllers are suitable for use on circuits capable of delivering high fault currents. The withstand ratings are as follows:

Circuit Breaker	Max V AC	Max Short Circuit Current RMS Symmetrical Amps
NZM6B-63,	480	25,000
NZM6B-100, NZM6B-160		

The controllers provided with automatic Transfer Switches are suitable for use on circuits capable of delivering high fault currents. The withstand rating of the entire controller is determined by the transfer switch as indicated below:

ASCO Transfer Switch	Max Controller S. C. Withstand Rating
9403704	22KA, 480 VAC Max
94031004	22KA, 480 VAC Max
94032604	25KA, 480 VAC Max

The withstand ratings for the alternate power source side will be dependent upon the ratings of the external circuit breaker provided. But in no case will they exceed those of the normal power source side.

Authorities having jurisdiction should be consulted in all cases.

Model FPD Series controller for engine-driven centrifugal fire pumps.

Models FPA, FPP, FPR, FPS, FPV, FPW, FPY, VPA, VPR, and VPS may be followed by additional suffixes. The withstand ratings are as follows:

#### Withstand Ratings of Controllers Without Transfer Switch:

Short Circuit Withstand Ratings (Ampere Symmetrical)		
VOLTAGE	STANDARD	OPTIONAL HIGH
200 to 480 V	100,000A RMS	150,000A RMS
575 to 600 V	50,000A RMS	100,000A RMS

Models ATG , ATU, VPG or VPU. The controllers provided with Automatic Transfer Switches are suitable for use on circuits capable of delivering high fault currents. The withstand rating of the normal power side is the same as the withstand ratings of controllers without transfer switches. The withstand rating of the alternate power side is determined by the transfer switch as indicated by the following tables:

**Withstand ratings of controllers with 120 A Tornatech Inc. Transfer Switch**

200-208V 50/60 Hz MAX HP	230-240V 50/60 Hz MAX HP	380-416V 50/60 Hz MAX HP	440-480V 50/60 Hz MAX HP	600V 60Hz MAX HP	Withstand Rating (A)
40	40	—	—	—	65,000
—	—	60	75	—	25,000
—	—	—	—	100	18,000

**Withstand Ratings For Controllers with Ascoelectric Transfer Switches**

Transfer Switch (A)	200-208V 50/60 Hz Max HP	230-240V 50/60 Hz Max HP	Withstand Rating		Specific** Withstand Rating (A)
			(A)	Time (Cycles)	
100	30	30	10000	1.5	22000
150	50	50	1000	1.5	22000
400	150	150	35000	3	42000
600	N/A	N/A	50000	3	65000

\*\* Tested and found suitable for 100kA

**Withstand Ratings for Controllers with Ascoelectric Transfer Switches, Continued**

Transfer Switch (A)	600V 60 Hz Max HP	Withstand Rating		Specific Withstand Rating (A)
		(A)	Time (Cycles)	
100	75	10000	1.5	N/A
150	150	1000	1.5	N/A
400	400	22000	3	N/A
600	N/A	N/A	N/A	N/A

<b>Model ATU or VPU:</b>	Normal Power Side:	Same as withstand rating of controller without transfer switch.
	Alternate Power Side:	Same as withstand rating of controller without transfer switch.

<b>Model FPL:</b>	Limited Service controllers with withstand ratings as follows:
-------------------	--

Short Circuit Withstand Ratings of Limited Service Controllers Without Transfer Switches		
VOLTAGE	STANDARD	OPTIONAL HIGH
200 to 480 V	25,000 A RMS	65,000 A RMS
575 to 600 V	18,000 A RMS	25,000 A RMS

<b>Model LTG, GLG:</b>	Automatic transfer switch for connection to a generator set.
<b>Model LTU:</b>	Automatic transfer switch for connection to a 2 <sup>nd</sup> utility.

Withstand ratings of Controller with transfer switch Model FPAT (Tornatech):

<b>Model LTG:</b>	Normal Power Side:	Same as withstand rating of controller without transfer switch.
	Alternate Power Side:	Withstand rating only applies when the generator set is protected by a molded case circuit breaker

<b>TRANSFER SWITCH AMPERES</b>	<b>200-480 V H.P.</b>	<b>WITHSTAND RATING AMPERES</b>
120	30	25,000

<b>TRANSFER SWITCH AMPERES</b>	<b>600 V H.P.</b>	<b>WITHSTAND RATING AMPERES</b>
120	30	18,000

<b>Model LTU:</b>	Normal Power Side:	Same as withstand rating of controller without transfer switch.
	Alternate Power Side:	Same as withstand rating of controller without transfer switch.

Withstand ratings of controller with transfer switch Model 940 (Ascoelectric):

<b>Model LTG:</b>	Normal Power Side:	Same as withstand rating of controller without transfer switch.
	Alternate Power Side:	Withstand rating only applies when the generator set is protected by a molded case circuit breaker not exceeding the ampere rating of the transfer switch.

<b>Transfer Switch A</b>	<b>200-480 V Max HP</b>	<b>Withstand Rating</b>		<b>Specific Withstand Rating A</b>
		<b>A</b>	<b>Time</b>	
120	30	10,000	1.5	22,000

<b>Transfer Switch A</b>	<b>600 V Max HP</b>	<b>Withstand Rating</b>		<b>Specific Withstand Rating A</b>
		<b>A</b>	<b>Time</b>	
120	30	10,000	1.5	N/A

<b>Model LTU:</b>	Normal Power Side:	Same as withstand rating of controller without transfer switch.
	Alternate Power Side:	Same as withstand rating of controller without transfer switch.

Models CPA, CPP, CPR, CPS, CPV, CPW, CPY, may be followed by additional suffixes. The withstand ratings are as follows:

Withstand ratings of controllers without transfer switch:

<b>Short circuit withstand ratings (ampere symmetrical)</b>		
<b>voltage</b>	<b>standard</b>	<b>optional</b>
200 to 480 V	100 kA	150 kA
575 to 600 V	50 kA	100 kA

Model CPU - The controllers provided with automatic transfer switches are suitable for use on circuits capable of delivering high fault currents. The withstand rating of the normal power side and the alternate power side is the same as the withstand ratings of controllers without transfer switches.

Model CPU

<b>Short circuit withstand rating for alternate power circuit with transfer switch (RMS Symmetrical)</b>		
<b>V</b>	<b>Standard</b>	<b>High (optional)</b>
200 to 480 V	100 kA	150 kA
575 to 600 V	50 kA	100 kA

Model GPD Series controller for engine-driven centrifugal fire pumps.

**Overcurrent Protection Panels**, Model OPD; may be followed by a number 200 through 575 with - or /; followed by a number 200 through 600 with /; followed by a number 10 through 500 with /; followed by 1 or 3 with /; followed by 50 or 60 or 50/60. - These panels provide separate overcurrent protection and disconnect to comply with NFPA 70 Article 695.4(B)(2)(a) and 695.4(B)(3) and NFPA 20 Article 9.2.3.1, 9.2.3.4, and 9.2.3.4.1.

<b>Short Circuit Withstand Ratings, A Symmetrical</b>			
<b>V</b>	<b>Standard</b>	<b>High (Optional)</b>	<b>High Capacity</b>
200-480	25,000	35,000 to 65,000	150,000

575-600	18,000	20,000 to 25,000	50,000 to 100,00
---------	--------	------------------	------------------

**Battery chargers**, BCE10, followed by 12 or 24, followed by 120 or 220.

**Fire pump controllers**, horsepower rated, Models GPA, GPAe, GPP, GPR, GPS, GPV, GPY, GPYe or GPW; may be followed by a number 110 through 575 with - or /; followed by a number 200 through 600 with /; followed by a number 1 through 500 with /; followed by 1 or 3 with /; followed by 50 or 60 or 50/60.

**Fire pump controllers**, kilowatt rated, Models GPA, GPAe, GPP, GPR, GPS, GPV, GPY, GPYe or GPW; followed by -400/; followed by a number 0.75 through 315 with kW/; followed by 3 with /; followed by 50 or 60 or 50/60.

**Transfer switch**, horsepower rated, Model GPU; may be followed by a number 110 through 575 with - or /; followed by a number 200 through 600 with /; followed by a number 1 through 500 with /; followed by 1 or 3 with /; followed by 50 or 60 or 50/60.

**Transfer switch**, kilowatt rated, Model GPU; followed by -400/; followed by a number 0.75 through 315 with kW/; followed by 3 with /; followed by 50 or 60 or 50/60.

**Withstand ratings of normal power circuit for GPA, GPAe, GPP, GPR, GPS, GPV, GPY, GPYe and GPW controllers with or without gpu transfer switch.**

Short Circuit Withstand Ratings for normal power circuit with or without transfer switch, A Symmetrical		
V	Standard	High (Optional) +
200-480	100,000	150,000
575-600 +	50,000	100,000
+ - Not applicable to controllers that use NOARK Power Components.		

**Limited service fire pump controllers**, kilowatt rated, Models GPL; followed by -400/; followed by a number 0.75 through 315 with kW/; followed by 3 with /; followed by 50 or 60 or 50/60.

**Limited service fire pump controllers**, , kilowatt rated, Models GPL; followed by -400/; followed by a number 0.75 through 315 with kW/; followed by 3 with /; followed by 50 or 60 or 50/60.

**Limited service transfer switch**, for connection to a second utility, horsepower rated, Model GLU; may be followed by a number 110 through 575 with - or /; followed by a number 200 through 600 with /; followed by a number 1 through 500 with /; followed by 1 or 3 with /; followed by 50 or 60 or 50/60.

**Limited service transfer switch**, for connection to a second utility, kilowatt rated, Model GLU; followed by -400/; followed by a number 0.75 through 315 with kW/; followed by 3 with /; followed by 50 or 60 or 50/60.

**Withstand ratings of normal power circuit for GPL controller with or without GLU transfer switch.**

Short Circuit Withstand Ratings for normal power circuit with or without transfer switch, A Symmetrical		
V	Standard	High (Optional)
200-240	65,000	-
380-480	25,000	65,000
575-600	18,000	25,000

[Click here to view the Colombia Market Access Certification](#)

[Last Updated](#) on 2017-02-09

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2017 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2017 UL LLC".



# Certificate of Compliance

This certificate is issued for the following:

**Controllers for Electric Motor Driven and  
Diesel Engine Driven Fire Pumps**

**Model GPx Series electric motor driven and  
Model GPD diesel engine driven fire pump controllers  
manufactured at Tornatech FZE in Dubai, UAE**

**Prepared for:**

**TornaTech Inc.**  
7075 Pl Robert-Joncas, #132  
St Laurent, QC H4M 2Z2  
Canada

**Manufactured at:**

TornaTech FZE  
Warehouse CC-4 near R/A 08  
P.O. Box 18435, Jebel Ali  
Dubai, United Arab Emirates

FM Approvals Class: 1321/1323

Approval Identification: 0003052698

Approval Granted: June 24, 2014

To verify the availability of the Approved product, please refer to [www.approvalguide.com](http://www.approvalguide.com)

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

A handwritten signature in dark ink, appearing to read 'Richard B. Dunne', is written over a horizontal line.

Richard B. Dunne  
Manager, Fire Protection  
FM Approvals  
1151 Boston-Providence Turnpike  
Norwood, MA 02062



*Member of the FM Global Group*



Member of the FM Global Group

FM Approvals
1151 Boston-Providence Turnpike, PO Box 9102
Norwood, MA 02062 USA
Tel: +1 (781) 255-4000
Fax: +1 (781) 762-9375
Email: certificates@fmaprovals.com
Website: www.fmaprovals.com

CERTIFICATE OF COMPLIANCE

This certificate of compliance validates the following

TEST REPORT NUMBER: 3052698 TEST CERTIFICATE NUMBER: 3052698
DATE OF ISSUE: 24 June, 2014 DATE OF ISSUE: 24 June, 2014
DATE OF EXPIRY: NONE DATE OF EXPIRY: NONE

NAME OF FACTORY/ MANUFACTURER: TORNATECH INC. NAME OF THE BRAND(S): TORNATECH FZE Warehouse CC-4 near R/A 08
ADDRESS/REGION: 7075 PLACE ROBERT-JONCAS, #132 SAINT LAURENT, QUEBEC H4M 2Z2 CANADA P.O. Box 18435, Jebel Ali Dubai, United Arab Emirates
MODEL/NO: GPx series GPD series



LOGO ON THE PRODUCT:



DESCRIPTION OF THE PRODUCT: Samples of the GPx series and GPD series were submitted for examination and testing. All testing and analysis was conducted and verified to be in compliance with the Standards listed in the Test Standards section below

TEST STANDARD: FM Approvals, Approval Standard for Controllers for Electric Motor and Diesel Engine Driven Fire Pumps, Class 1321/1323, dated November 2007

TEST DESCRIPTION: All testing and analysis considered appropriate was conducted and verified to be in compliance with the Standards listed in the Test Standards section. All data is on file at FM Approvals along with other documentation and correspondence applicable to this program.

SPECIFICATION OF TEST SPECIMEN: The samples were considered to be representative of the product line and were examined, tested, and compared to the manufacturer's drawings.

TEST RESULTS: Pass

NAME OF TEST FACILITY: FM Approvals
TEST FACILITY ADDRESS/REGION:
LABORATORY CONTACT: Mr. Richard Dunne
CONTACT PHONE: 1-401-567-5701
CONTACT EMAIL: Richard.Dunne@fmaprovals.com
PRODUCT APPLICATION GUIDELINE (END USE): Installations shall comply with the manufacturer's instructions.

SIGNED BY: [Signature]

The above certificate is valid only when installed in accordance with the "Product Application Guideline (End Use)" as stated above. To verify the validity of the product please log into our website, www.approvalguide.com.



# Certificate of Compliance

This certificate is issued for the following:

**Fire Pump Flowmeter Systems**  
(See complete listing details below)

**Prepared for:**

Quest Engineering dba Gerand Engineering  
2300 Edgewood Avenue South  
St. Louis Park, MN 55426

FM Approvals Class: 1046

Approval Identification: 3058542

Approval Granted: April 26, 2016

To verify the product continues to be Approved please refer to [www.approvalguide.com](http://www.approvalguide.com).

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.

A handwritten signature in black ink that reads 'David B. Fuller'.

---

David B. Fuller  
AVP, Manager of Fire Protection  
FM Approvals  
1151 Boston-Providence Turnpike  
Norwood, MA 02062 USA



*Member of the FM Global Group*



## Certificate of Compliance

Pump Rating, gal/min (dm <sup>3</sup> /min)	Nominal Meter Line Size in.	Model Designation	
		Venturi (1)	Orifice (2)
25 (95)	1 1/4	GV-25-1 1/4	-
50 (190)	2	GV-50-2	-
100 (380)	2 1/2	GV-100-2 1/2	GO-100-2 1/2
150 (570)	3	GV-150-3	GO-150-3
200 (755)	3, 4	GV-200-3, 4	GO-200-3, 4
250 (945)	4, 5	GV-250-4, 5	GO-250-4, 5
300 (1135)	4	GV-300-4	GO-300-4
400 (1515)	4, 5	GV-400-4, 5	GO-400-4, 5
450 (1705)	4, 5	GV-450-4, 5	GO-450-4, 5
500 (1895)	5, 6	GV-500-5, 6	GO-500-5, 6
750 (2840)	5, 6	GV-750-5, 6	GO-750-5, 6
1000 (3785)	6, 8	GV-1000-6, 8	GO-1000-6, 8
1250 (4730)	6, 8	GV-1250-6, 8	GO-1250-6, 8
1500 (5680)	8, 10	GV-1500-8, 10	GO-1500-8, 10
2000 (7570)	8, 10	GV-2000-8, 10	GO-2000-8, 10
2500 (9465)	8, 10	GV-2500-8, 10	GO-2500-8, 10
3000 (11 355)	8, 10	GV-3000-8, 10	GO-3000-8, 10



Member of the FM Global Group



## Certificate of Compliance

Pump Rating, gal/min (dm <sup>3</sup> /min)	Nominal Meter Line Size in.	Model Designation	
		Venturi (1)	Orifice (2)
3500 (13 245)	10, 12	GV-3500-10, 12	GO-3500-10, 12
4000 (15 140)	10, 12	GV-4000-10, 12	GO-4000-10, 12
4500 (17 035)	10, 12	GV-4500-10, 12	GO-4500-10, 12
5000 (18 925)	10, 12	GV-5000-10, 12	GO-5000-10, 12

Each system consists of a Gerand Venturi (GV) or a Gerand Orifice (GO), a differential meter reading in gpm or dm<sup>3</sup>/min and associated fittings.

GV systems can be equipped with either a 4 1/2 in. dial meter (Gerand Model K) or a 6 in. dial meter (Gerand Model M). GO systems are only available with a 4 1/2 in. dial meter (Gerand Model I). Permanent installations (wall or panel mount) or portable installations are available on all systems. Rated working pressure is 500 psi (3445 kPa) except that:

GV systems with Model M dial meter have a rated working pressure of 175 psi (1205 kPa).

GV systems with Model K dial meter and Class 150 flanges have a rated working pressure of 275 psi (1905 kPa).

The following end-connection styles are available:

Venturi (1)VS. Brass screw ends, 1 1/4 through 2 1/2 in.

Venturi (1)VW-B. Steel butt-welded ends, 2 1/2 through 12 in.

Venturi (1)V-GE. Steel grooved ends, 2 1/2 through 12 in.

Venturi (1)VW-F. Steel flanged ends, 2 1/2 through 12 in. Class 150 flanges rated at 275 psi (1905 kPa). Class 300 flanges rated at 500 psi (3445 kPa).

Orifice (2). Steel socket-welded ends with adaptability for flanging, 2 1/2 through 12 in.



Member of the FM Global Group



## VQDI.EX27976 - Valves, System Pressure Relief

## Valves, System Pressure Relief

[See General Information for Valves, System Pressure Relief](#)

**FLUID PUMPS & EQUIPMENT INDIA PVT LTD**

EX27976

7/222 Nagamanaickenpalayam Pattanam  
Coimbatore, Tamil Nadu 641016 INDIA

Model	Type	Nom Pipe Size, NPS	Set Pressure Value, psig	Installation Orientation
513 - LP	Adjustable	1/2, 3/4	20 - 150	H,V
513 - HP	Adjustable	1/2, 3/4	150 - 300	H,V
513A - LP	Adjustable	1/2, 3/4	20 - 150	H,V
513A - HP	Adjustable	3/4	150 - 300	H,V

T - Threaded

H - Horizontal installation

V - Vertical installation

Last Updated on 2020-06-05

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2022 UL LLC"

# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX28005  
**Report Reference** EX28005-2021-09-20  
**Date** 2021-September-28

**Issued to:** **WEFLO VALVE CO LTD**  
Intersection of Huadong Rd and Chunyang Rd  
Qingdao National High-tech Industrial Development Zone  
QINGDAO SHANDONG 266111 CN

**This is to certify that representative samples of** VALVES, AUTOMATIC AIR RELEASE  
See Addendum Page for Product Designation(s).

Have been investigated by UL in accordance with the Standard(s) indicated on this Certificate.


**Standard(s) for Safety:** Subject 2573- Outline of Investigation for Automatic Air Release and Air/Vacuum for Fire Protection Service

**Additional Information:** See the UL Online Certifications Directory at <https://iq.ulprospector.com> for additional information

This Certificate of Compliance does not provide authorization to apply the UL Mark. Only the UL Follow-Up Services Procedure provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>




# CERTIFICATE OF COMPLIANCE

**Certificate Number** EX28005  
**Report Reference** EX28005-2021-09-20  
**Date** 2021-September-28

This is to certify that representative samples of the product as specified on this certificate were tested according to the current UL requirements

Automatic air release valves in the following Models, sizes and rated pressures:

Model	Valve Size, in.	Outlet Size, in.	Orifice Size, in.	Max C.W.P.	Inlet Connection
9701	1/2	1/2	1/16	300	NPT
9701	3/4	1/2	1/16	300	NPT
9701	1	1/2	1/16	300	NPT
9701	1/2	1/2	3/32	300	NPT
9701	3/4	1/2	3/32	300	NPT
9701	1	1/2	3/32	300	NPT



Bruce Mahrenholz, Director North American Certification Program

UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact a local UL Customer Service Representative at <http://ul.com/aboutul/locations/>





# Certificate of Compliance

This certificate is issued for the following:

**AIR RELEASE VALVES 1/2 INCH THROUGH 1 INCH NOMINAL SIZE**

**Model 9701**

**Sizes 1/2, 3/4 and 1 inch NPS**

Rated Working Pressure = 300 psi (2070 kPa)

**Prepared for:**

Weflo Valve Co Ltd  
Inter of Huadong Rd & Chunyang Rd  
Qingdao Nat'l High-Tech Ind Dev Zone  
Qingdao, Shandong 266111  
China

FM Approvals Class: 1344 (January 2010)

Approval Identification: PR456700

Approval Granted: November 2, 2020


To verify the availability of the Approved product, please refer to [www.approvalguide.com](http://www.approvalguide.com)

Said Approval is subject to satisfactory field performance, continuing Surveillance Audits, and strict conformity to the constructions as shown in the Approval Guide, an online resource of FM Approvals.





A handwritten signature in dark red ink, appearing to read 'D.B. Fuller', is written over a horizontal line.

David B. Fuller  
VP, Manager – Fire Protection  
FM Approvals  
1151 Boston-Providence Turnpike  
Norwood, MA 02062

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## COMPANY PROFILE

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

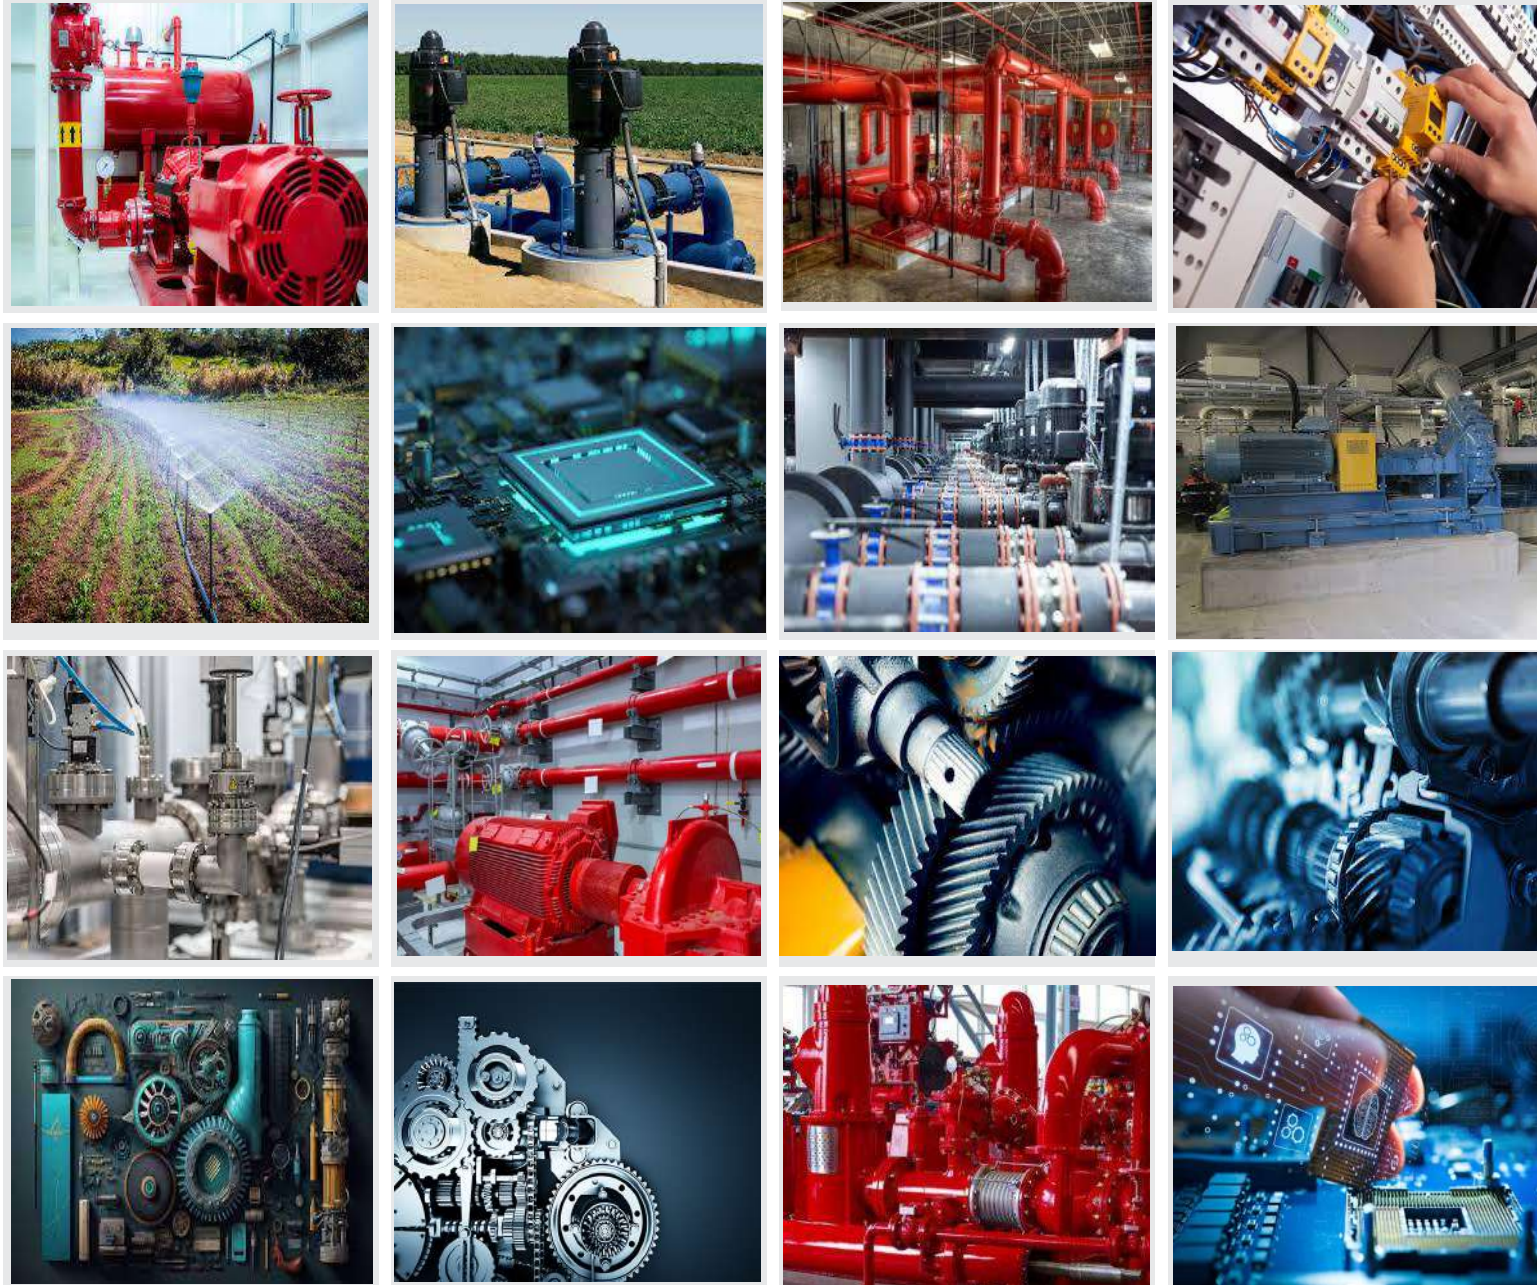

# COMPANY PROFILE



# CEO MESSAGE

Mena Mech Ind co has undergone a remarkable evolution in the past six years in the UAE. In the last 37 years in the Middle East, we've pursued our vision to become the leading fire pump systems provider in the Middle East and north Africa. But one of the most profound changes that have taken place over time is that we have a deeper and richer understanding, commitment and sustainability that has come into focus as we have refined our views of what it means to be a leader.

Today, as a result, we are increasingly adapting Mena strategies, operations and culture to drive positive results across our experience and provide a superior quality product to serve the commitments.

Our commitment in MENA is much stronger than ever. Indeed, one of the most important aspects of growth, opportunities for our company depends on solving engineering challenges a reality that is making sustainability a competitive imperative in the industry.

We also know our Customer's expectations from a leading company like Mena.

Our Company Profile will provide multiple examples of our commitment for supply, operation and after sales service, across wide range of products, from Fire Pump Solutions to pumps of the water sector, along with engineering Solutions etc.

MENA branches expands in all UAE emirates, Egypt, Palestine, Sudan, GCC Countries, and North Africa to serve our client.

With your continuous support and trust, Mena now poised to further grow its Middle east and north Africa network. In the end, I appreciate your business commitment.

**Eng. Mamoun A. Al-Burieni**  
Chief Executive Officer



## VISION

MENA MECH aspires to be among the leading companies of the field in the MENA region, renowned and recognized around the globe for offering comprehensive, professional services & products of the highest quality for its distinctive clients.

## MISSION

MENA is committed to providing its clients with service and products of the highest quality; offering a comprehensive platform of services and products. Promoting the personal, and social career growth of all employees, adding to the human knowledge of contributing to culture, social and economic progress of society preserving and promoting the Arab, Islamic culture, heritage and history; and contributing to the advancement of firefighting and security of lives of people living in the middle east and north Africa.

## VALUES

- Commitment to our clients.
- Be reliable and add value to our customers.
- Empowerment, Intergrity, Excellence and Collaboration.
- Trust our employees to make the right decisions.
- Show transparency in everything we do.
- Operate professionally, safely & effectively.
- Cooperation; work as one team to deliver value.




## OUR STRATEGY

## GUIDING PRIORITIES

A major and comprehensive company: Mena Fire Fighting offers varieties of Pumping Solutions, in the field of firefighting and Water Applications.

- **Client Success:**  
The company is committed to enriching its client's success within an economy rich environment.
- **Emphasis on Quality:**  
The standard of our company enhances us to practice a diversity of designs that allow and evaluates the client's request. Our effectiveness and practicality of all the services and products offered by the company are to provide the best result for our clients.

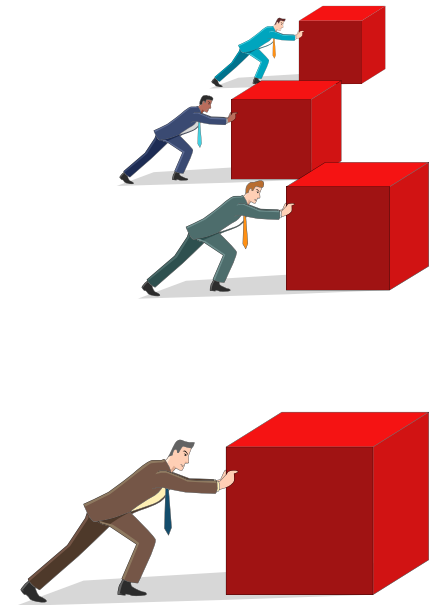

- **Supportive:**  
Our company emphasizes the importance of our services and products by providing the required training to operate the product and maintenance period to ensure that the client receives the maximum benefit of our services and products supplied.

- **Global Vision:**  
Our Company takes pride in being a part of an international Supply chain with partner companies around the globe.

- **Research Intensive:**  
Our company is continuously making strident moves to establish itself nationally and internationally through extensively researching the latest technologies in the field.



- **Engagement With The Community:**  
Our company plays a vital role in the social and economic development and safety of UAE and middle east by introducing the most advanced technologies with affordable and competitive prices.

## GUIDING PRIORITIES

A major and comprehensive company: MENA MECH IND CO offers varieties of Pumping Solutions, in the field of firefighting and Water Applications.

- **Client Success:**

The company is committed to enriching its client's success within an economy rich environment.

- **Emphasis on Quality:**

The standard of our company enhances us to practice a diversity of designs that allow and evaluates the client's request. Our effectiveness and practicality of all the services and products offered by the company are to provide the best result for our clients.



- **Supportive:**

Our company emphasizes the importance of our services and products by providing the required training to operate the product and maintenance period to ensure that the client receives the maximum benefit of our services and products supplied.

- **Global Vision:**


Our Company takes pride in being a part of an international Supply chain with partner companies around the globe.

- **Research Intensive:**

Our company is continuously making strident moves to establish itself nationally and internationally through extensively researching the latest technologies in the field.

- **Engagement With The Community:**

Our company plays a vital role in the social and economic development and safety of UAE and middle east by introducing the most advanced technologies with affordable and competitive prices.

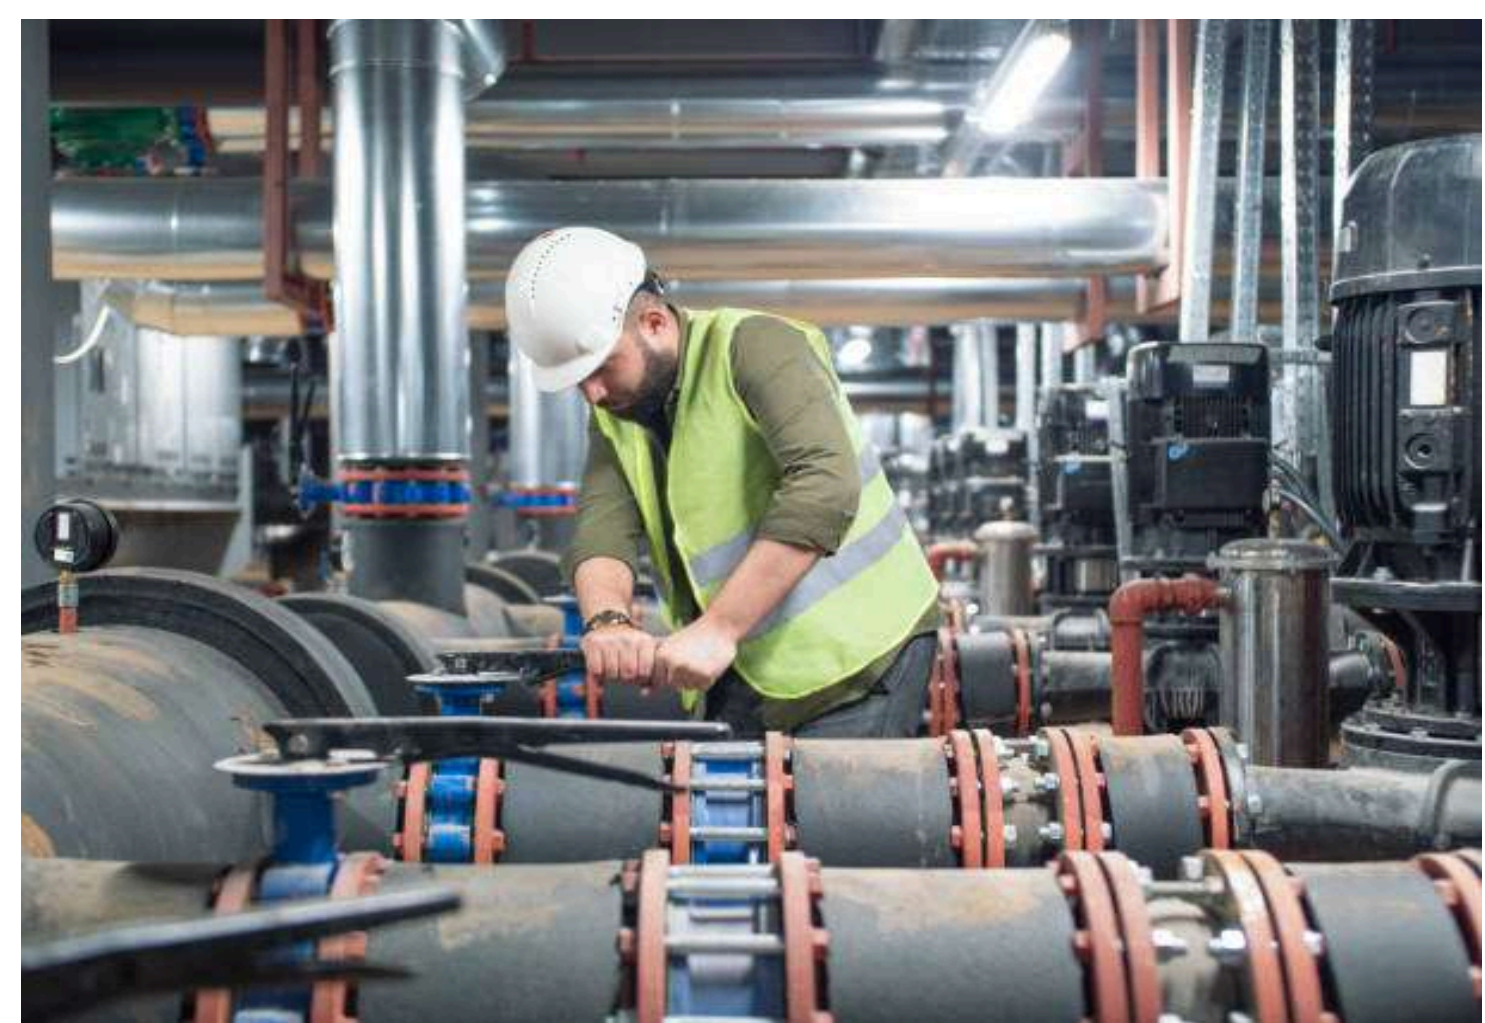

## SAFETY POLICY

MENA MECH IND CO is committed to emphasize on the education, interest and awareness of new employees in safety concepts in a safe environment before the assumption of duty.

Ensure that the organization's environment, facilities, equipment and substances are subject to safe systems of work to prevent risks to health or safety.

Just as we are keen for our client's safety, our employees have to be provided by the safest working environment including a spacious atmosphere, excellent ventilation, pest control, etc.

 <p><b>END SUCTION &amp; SPLIT CASE PUMPS</b> VERTICAL TURBINE FIRE PUMP MENA MECHANICAL INDUSTRIES- UAE</p>	 <p><b>DIESEL DRIVER</b> KIRLOSKAR, INDIA UL LISTED &amp; FM APPROVED</p>	 <p><b>DIESEL DRIVER</b> NM FIRE, CHINA UL LISTED &amp; FM APPROVED</p>	 <p><b>DIESEL DRIVER</b> GREAVES COTTON UL LISTED &amp; FM APPROVED</p>
 <p><b>DIESEL DRIVER</b> TAIDONG, CHINA UL LISTED LISTED</p>	 <p><b>DIESEL DRIVER</b> CLARKE, UK /USA UL LISTED &amp; FM APPROVED</p>	 <p><b>FIRE PUMP MOTOR</b> WEG, BRAZIL UL LISTED APPROVED</p>	 <p><b>FIRE PUMP MOTOR</b> MARATHON, USA UL LISTED</p>
 <p><b>FIRE PUMP CONTROLLERS</b> TORNATECH, CANADA UL LISTED &amp; FM APPROVED</p>	 <p><b>PRESSURE RELIEF VALVE</b> SINGER VALVE, CANADA UL LISTED &amp; FM APPROVED</p>	 <p><b>FIRE PUMP MOTOR</b> TECHTOP, INC UL LISTED APPROVED</p>	 <p><b>FLOWMETER</b> GERAND, USA FM APPROVED</p>
<p><b>VENDORS</b></p>		   	 <p>AMERILLO GEARS - USA</p>

## THE COMPANY

Since 2017, our Headquarters has been located in the Emirate of Dubai. MENA MECH IND CO is charged with an ambitious growth with the mission to protect people of the United Arab Emirates, and middle east Countries by providing world-class fire pump solutions manufacture by MENA MECH IND CO.

**Mena** is efficiently covering its Services by having a regional office in Egypt, Sudan and various other locations in the Middle East.

**Mena Mech IND CO** is the sole distributor throughout the Gulf Countries for its products, which are approved from Civil defense in many countries including UAE.


This company profile includes a complete illustration and real pictures of production process, starting from engineering, casting, machining, manufacturing, and ending with assembly.

The experts of MENA MECH IND CO are well managed, dedicated and well-versed with knowledge research and development in all aspects of Pumping Solutions. They are also supported with a qualified team of engineers and technicians with years of experiences to provide the best quality service to clients. and has an outstanding track record of delivering products on time and are punctual in providing services at regular intervals; this has been the bases of establishing a strong relationship with the clients.

**MENA MECH IND CO** has a well-equipped workshop for maintenance service as per International standards.

**MENA MECH IND CO** commits to consistently demonstrate the highest ethical standards in our actions through innovative solutions, honoring our agreements and being transparent in our communications.

Our value and service meets our customer expectations because we build and maintain a good relationship with them to ensure long-term satisfaction.


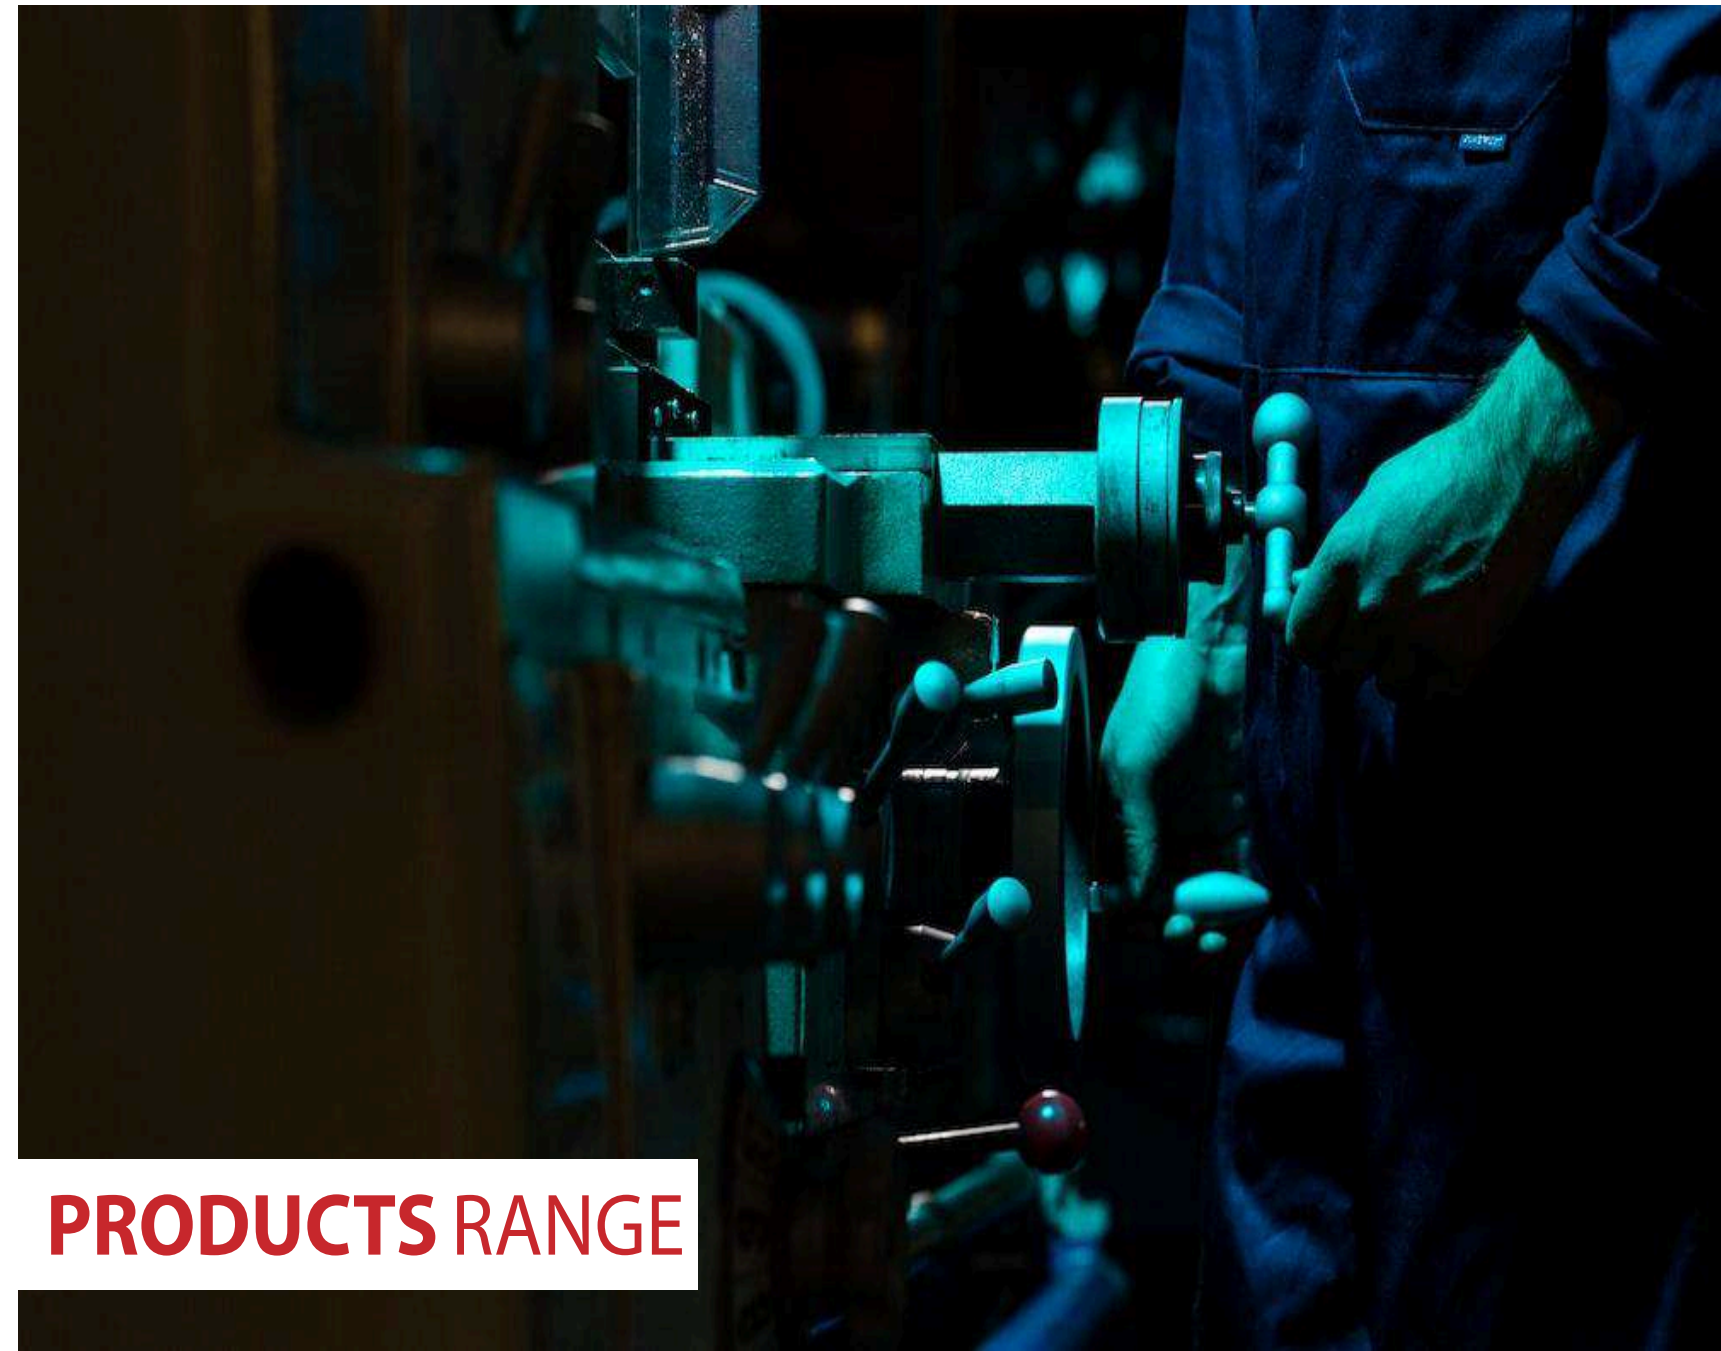


# PRODUCTS RANGE



Vertical Turbine Fire Pumps



## Horizontal End Suction

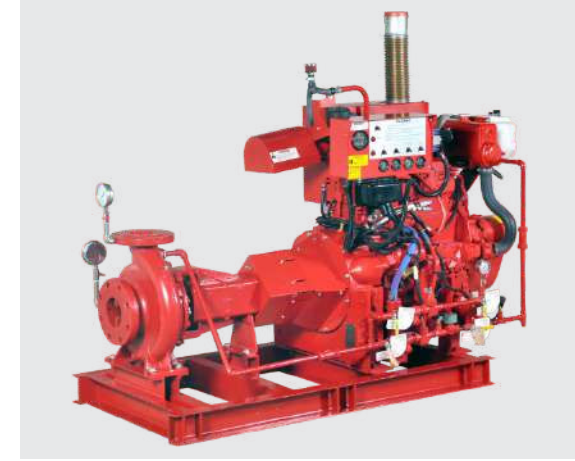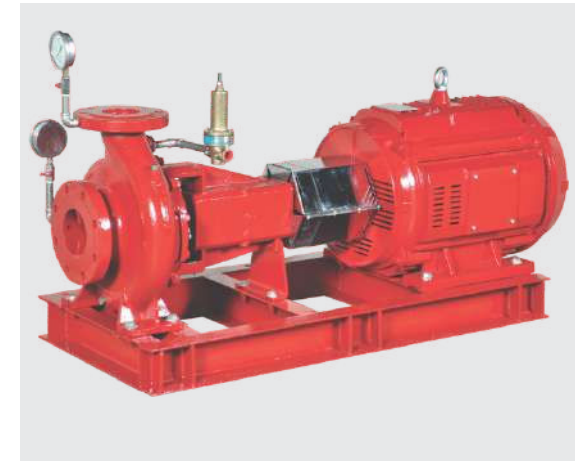

## Horizontal Split Case

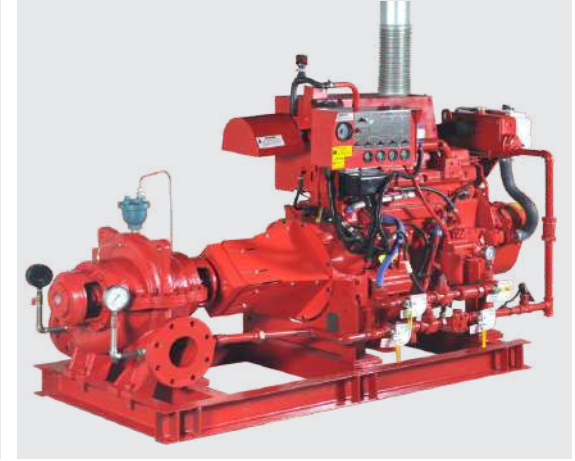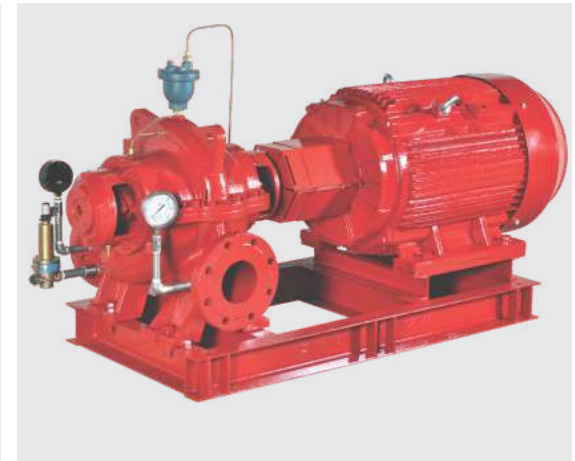


### Product Range Overview


- UL Listed Horizontal End Suction Fire Pumps
- UL Listed Horizontal Split Case Fire Pumps
- UL Listed Vertical Turbine Fire Pumps
- UL/FM Industrial Packaged Fire Pump Set
- Diesel Engine Driven Pump Set
- Electric Motor Driven Pump Set
- Jockey Pump
- Fire Pump Packaged as per NFPA



# PRODUCTION CAPABILITIES



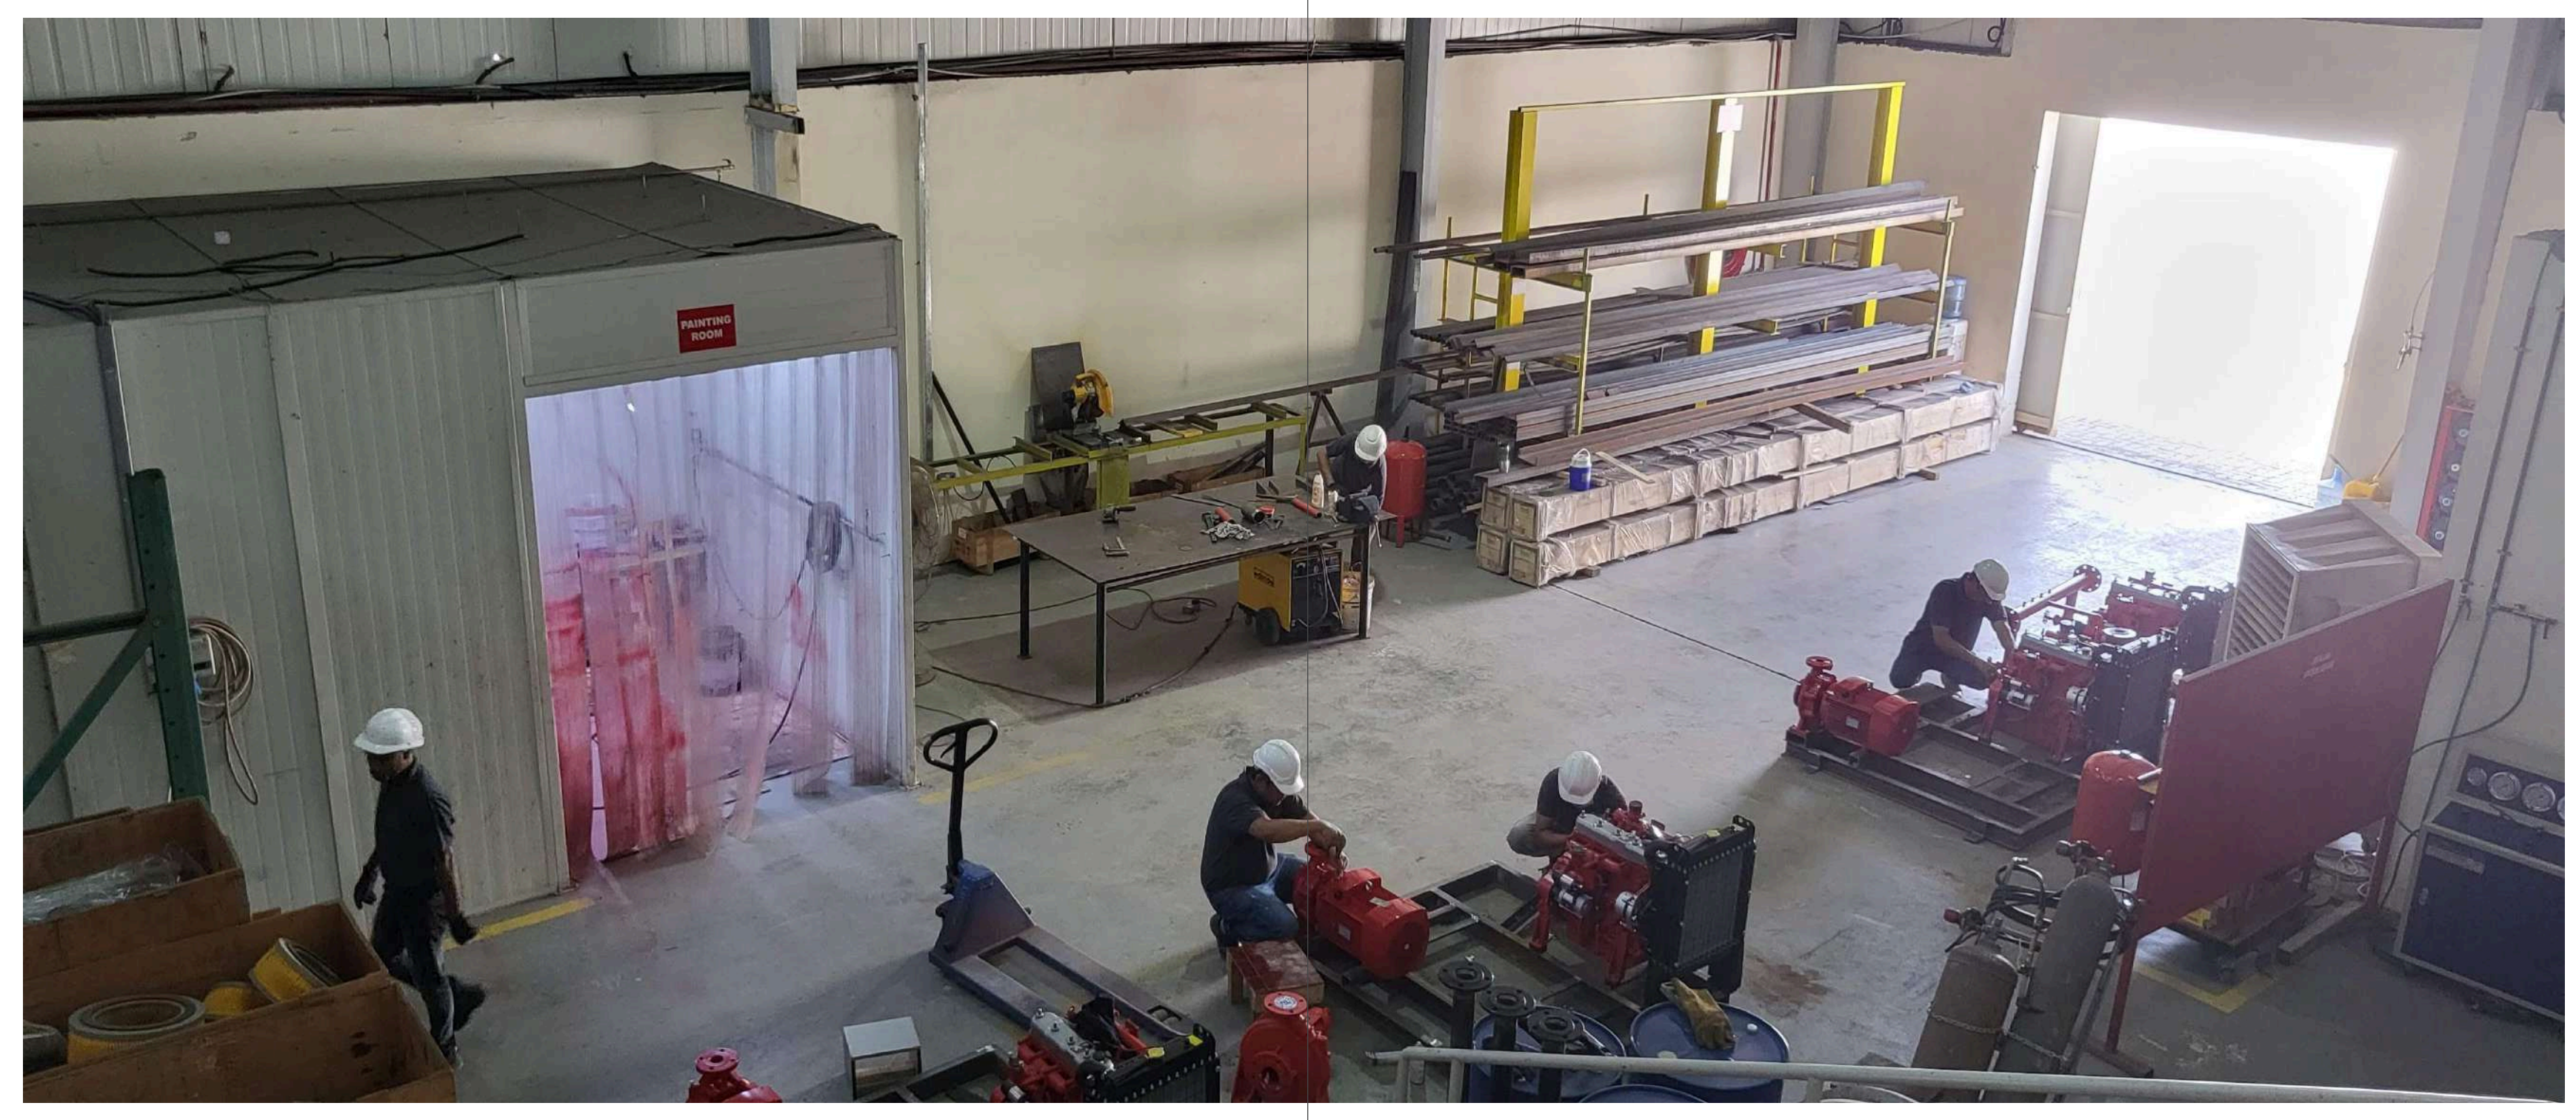

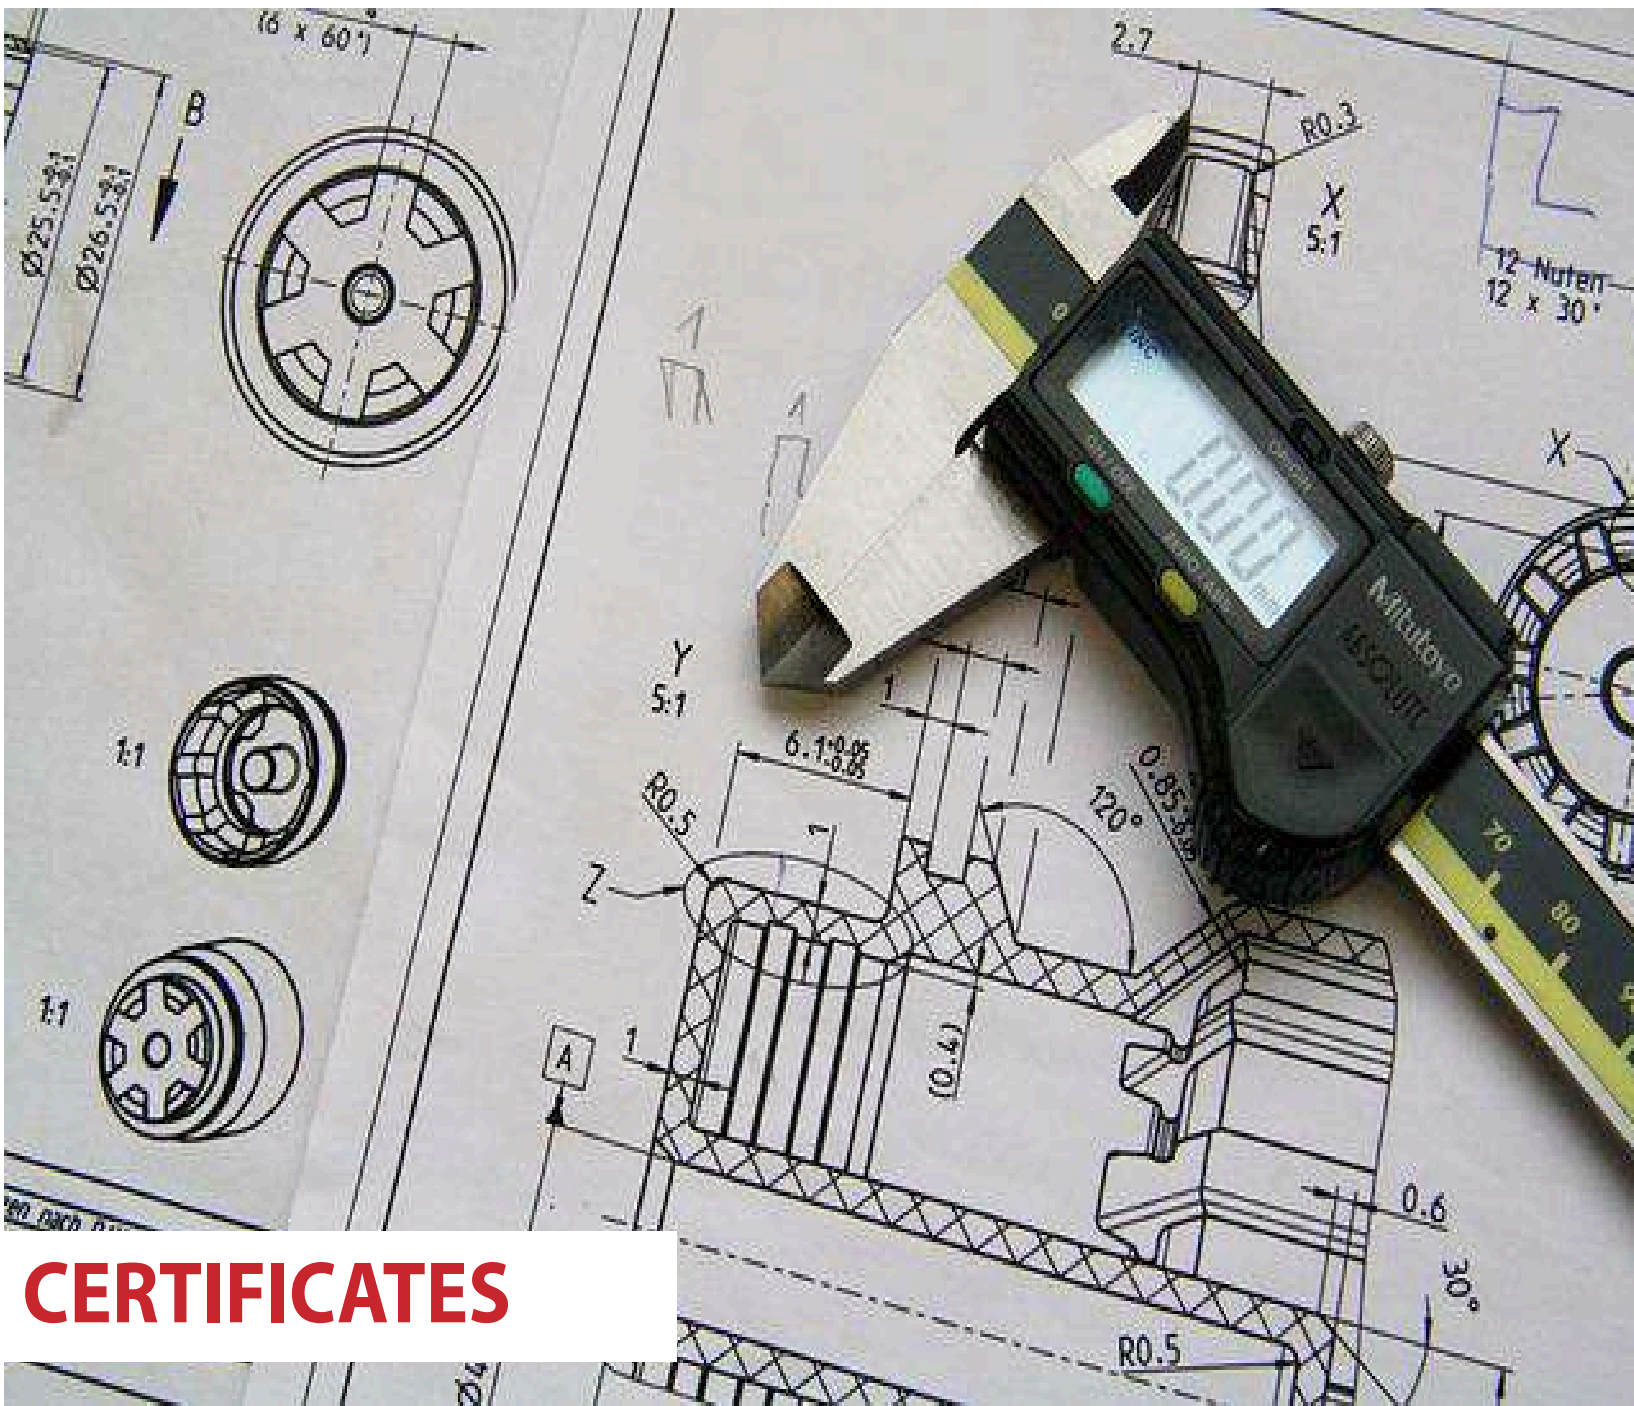

# CERTIFICATES

## CERTIFICATE OF COMPLIANCE

**Certificate Number** EX28929  
**Report Reference** EX28929  
**Issue Date** 2023-JANUARY-04

**Issued to:** MENA MECH IND CO.  
 Sharjah Al Sajaa Industrial Shed 6  
 Victory Warehouse, Sajja New Industrial Area  
 Sharjah, United Arab Emirates

**This certificate confirms that representative samples of** Centrifugal Fire Pumps, End Suction  
 See Addendum for Models

Have been evaluated by UL in accordance with the Standard(s) indicated on this Certificate.

**Standard(s) for Safety:** ANSI/CAN/UL 448 – Centrifugal Stationary Pumps for Fire-Protection Service

**Additional Information:** See UL Product iQ® at <https://iq.ulprospector.com> for additional information.

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

*Deborah Jennings-Power*  
 Deborah Jennings-Power, VP Regulatory Services  
 UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at <http://ul.com/about/locations/>



## CERTIFICATE OF COMPLIANCE

Certificate Number EX28977  
Report Reference EX28977-2023-04-05  
Issue Date 2023-APRIL-18

Issued to: MENA MECH IND CO.  
Sharjah Al Sajaa Industrial Shed 6  
Victory Warehouse, Sajja New Industrial Area  
Sharjah, United Arab Emirates

This certificate confirms that representative samples of  
Centrifugal Fire Pumps, Split Case  
See Addendum for Models

Have been evaluated by UL in accordance with the  
Standard(s) indicated on this Certificate.


Standard(s) for Safety: ANSI/CAN/UL 448 – Centrifugal Stationary Pumps for Fire-  
Protection Service

Additional Information: See UL Product iQ® at <https://iq.ulprospector.com> for  
additional information.

This Certificate of Compliance indicates that representative samples of the product described in the certification report have met the requirements for UL certification. It does not provide authorization to apply the UL Mark. Only the Authorization Page that references the Follow-Up Services Procedure for ongoing surveillance provides authorization to apply the UL Mark.

Only those products bearing the UL Mark should be considered as being UL Certified and covered under UL's Follow-Up Services.

Look for the UL Certification Mark on the product.

  
Deborah Jennings, Corner, VP Regulatory Services  
UL LLC

Any information and documentation involving UL Mark services are provided on behalf of UL LLC (UL) or any authorized licensee of UL. For questions, please contact UL Customer Service at [ULCustomerService@ulprospector.com](mailto:ULCustomerService@ulprospector.com)



## UL Product iQ®



## Centrifugal Fire Pumps, Vertical Turbine

### COMPANY

#### Volute Engineering Pvt Ltd

No. 37, Muthiya Mudali Second Street  
Royapettah  
Chennai, Tamil Nadu 600014 India

EX28924

Trademark and/or Tradename: "VOLUTE",



Note: For additional marking information, refer to the [Guide Information Page](#).

*View model for additional information*

**Centrifugal Fire Pumps, Vertical Turbine**, Model(s): [VT100-155](#), [VT125-180](#), [VT145-270](#), [VT150-265](#), [VT170-304](#), [VT185-335](#), [VT200-350](#), [VT225-400](#), [VT250-400](#), [VT275-430](#), [VT80-145](#)

Last Updated on 2023-01-03

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.


UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2023 UL LLC."



## PROJECTS REFERENCE

Sr No.	Project Details (2022)					Capacity	
	Client	Main Contractor	Consultant	Project Name	Location	Flow (US GPM)	Head (Bar)
1	Sheikh Mohamed Zayed Al Nehyan	Miami Contracting Company	Development Engineering Consultant	G+M+4 Commercial Office Building	Dubai	500	10
2	Ismail Abdullah Al - Gergawi	Talai Contracting	Fourth Dimension Engineering Consultant	Commercial Building	Dubai	500	9
3	Al Bahidh General Trading LLC	Quick Steel Building Contracting LLC	Capital Engineering Consultant	G+M Cold Storage Building	Dubai	750	7
4	Mrs. Hawa Abdullah	Abdullah Bin Dasmal Contracting	Circle Engineering Consultant	G+3+R Residential Building, Muhaisnah	Dubai	750	8
5	Mr. Hassan Arab Darwish	Remal Al Sahara Building Contracting Company LLC	Sharjah Engineering Consultant	G+1 Commercial Building	Sharjah	300	9
6	Mr. Hassan Arab Darwish	Remal Al Sahara Building Contracting Company LLC	Sharjah Engineering Consultant	G+3 Commercial Building	Sharjah	300	9
7	Mr. Essa Abdulla Buhumaid	Solid Building Contracting LLC	Retaj Engineering Consultancy	G+M Warehouse & G+M Office	Dubai	500	9
8	Mr. Younis Abdelaziz Al Nimr	Ideal Building Contracting	Emirates Engineer Consultant	G+5 Residential Building	Sharjah	500	10
9	H.H Saud bin Rashid Al Mualla	Zamalek Contracting	ATI Engineer Consultant	Commercial Building / School	Umm Al Quain	1500	9
10	Mr. Mohammed Abdulazez Ahmad	Hilal Al Emarate Contracting	High Arc Engineering Consultants	G+5 Residential Building	Sharjah	500	10
11	Shaikha Moudi Hamad Al Shami	Remal Al Sahara Contracting	Al Bait Engineering Consultants	G+2 building	Sharjah	500	9
12	Al Fahim Group	Hamed El Sayah Contracting	MAZ Engineering Consultant	Industrial Garage	Dubai	300	9
13	Ms. Metha Ahmed Ali Al Weis	Al Muntaser Building Contracting	Arabic Architecture Engineering Consultant	Commercial Building G+4 TYP	Dubai	750	10




	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## DIESEL ENGINE DRIVEN PUMP SPECIFICATIONS

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# END SUCTION FIRE PUMP


END SUCTION FIRE PUMP

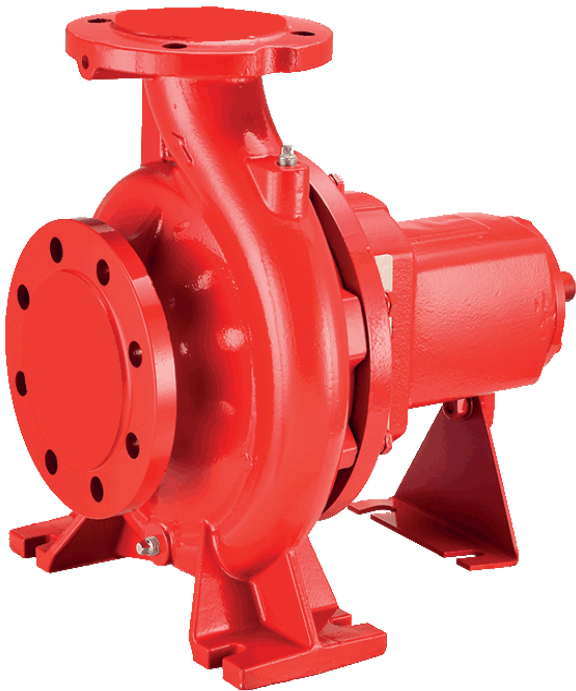

Technical Specifications	
Suction fange	1.5-6 Inch
Discharge fange	2.5-4 inch
Flow	50-1000 GPM
Discharge pressure	84-230PSI

Material Specifications	
Casing	Ductile Iron
Impeller	Bronze or stainless steel
Shaft	ATSM420
Sealing	Gland packing
Bearing Housing	Rolling bearing
Suction/discharge fanges	ANSI

## Pump Naming

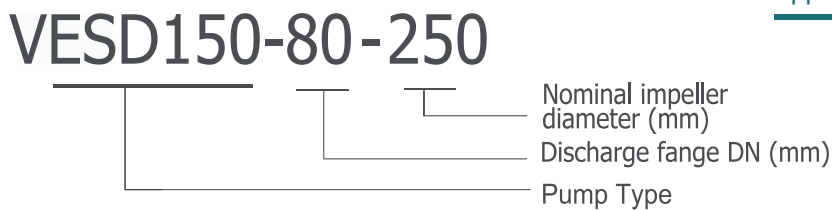

## Product Standard

UL 448, NFPA

## Product Approvals



## Flange Standards

Pump Installing Dimensions are confirming to ISO2858 Standard, and Tested according to with UL 448 -2013

## Driver Options



Electrical



Diesel

## Application Areas



Hydrant



Sprinkler



Overflow



Foam

## Risk Class




Ordinary



High

# END SUCTION FIRE PUMP

## General Pump Features

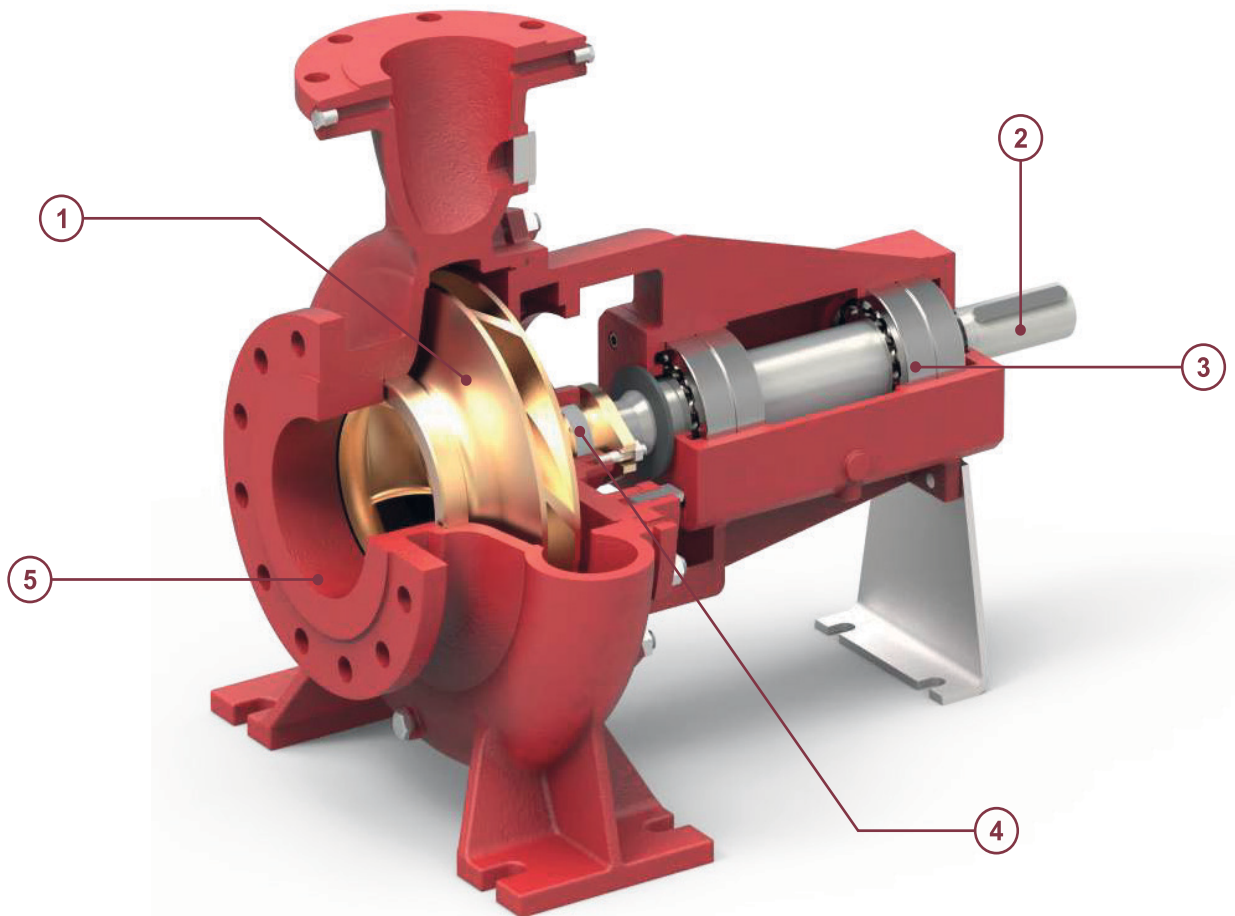

END SUCTION FIRE PUMP

### 1 - Impeller & Casing

- Impeller is dynamically balanced to grade G6.3 balance quality in accordance to ISO 1940-1.
- Impeller & Casing are designed using state of art CFD tools to ensure optimal performance.

### 2 - Shaft

- Heavy duty stainless steel shaft completely sealed and dry for zero corrosion available upon request.
- Short and rigid with negligible vibrations.
- Replaceable shaft protecting sleeves.
- No threads exposed to pump medium, long operating life and no corrosion.
- Adjustment-free assembly.

### 3 - Bearing

- Heavy duty and permanently grease lubricated antifriction bearings for long service life.
- Open gland, enough space for service activities.

### 4 - Seal


- Asbestos - free, soft packed stuffing boxes.

### 5 - Casing

- End Suction backpullout design permits maintenance of the pump without removing the pipes.
- Rugged Ball Bearings on Drive as well as Non Drive end.
- Flange drilled as per ANSI B16.1 class 250.
- Smooth surface inside & CED coated for superior corrosion protection.
- Replaceable wear ring protect the casing and the impeller running clearances.
- Heavy duty casing design for high working pressure.

# END SUCTION FIRE PUMP

## VES Series - Exploded View & Part list

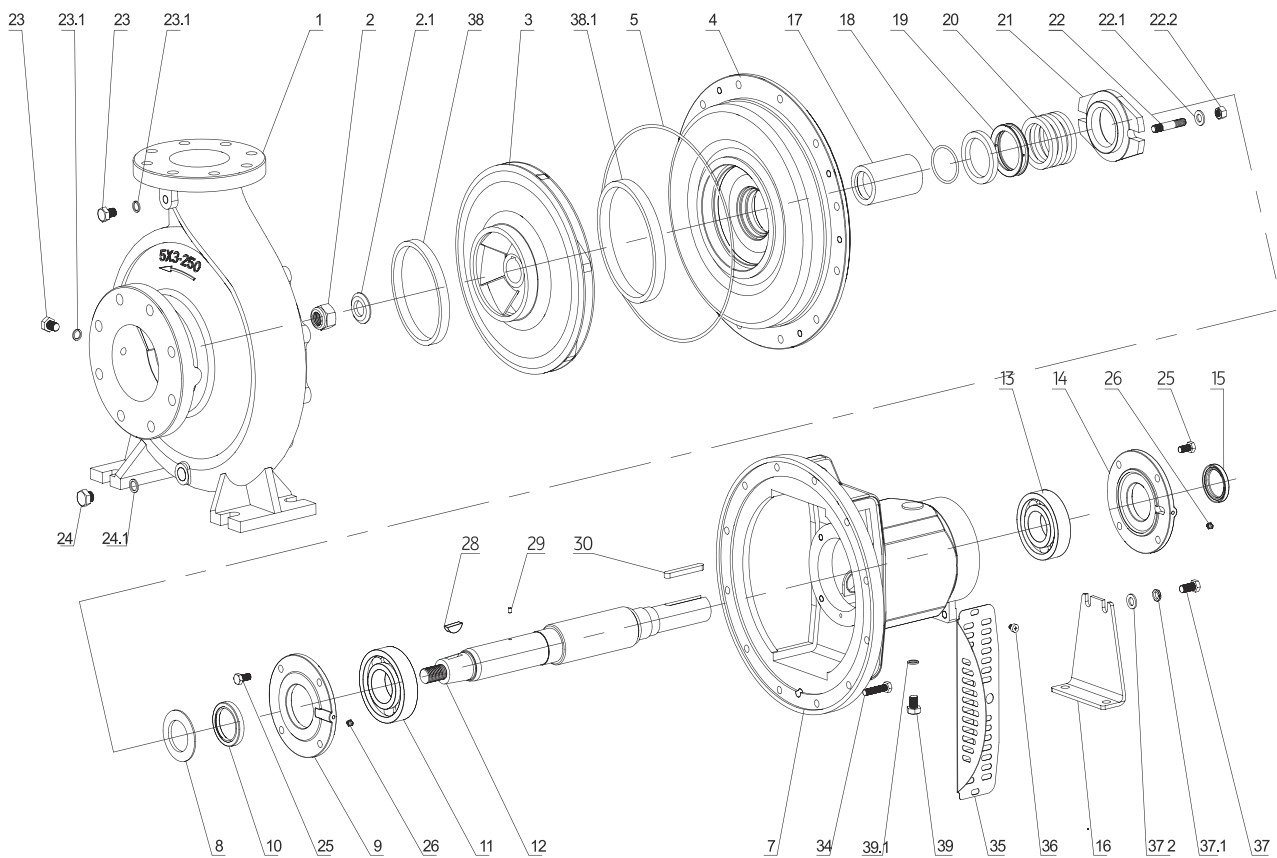


END SUCTION FIRE PUMP

Code	Part Name	Code	Part Name	Code	Part Name
1	Casing	16	Support Foot	26	Oil Cup M6
2	Impeller Nut	17	Packing Sleeve	28	key
2.1	Lock washer for impeller	18	O-ring	29	pin
3	Impeller	19	Gland Packing	30	key
4	Gland Cover	20	Packing Seal Cage	34	Screw Bolt
5	O-ring	21	Gland Cover	35	Protective cover
7	Bearing Housing	22	Stud Bolt	36	Bolt
8	Rubber Slinger	22.1	Flat Washer	37	Screw Bolt
9	NDE Bearing Cover	22.2	Screw Nut	37.1	Elastic Washer
10	NDE Oil Seal	23	Plug	37.2	Flat Washer
11	NDE Bearing	23.1	Plug Spacer	38	Front-Wearing
12	Shaft	24	Plug	38.1	Back-Wearing
13	DE Bearing	24.1	Plug Spacer	39	Plug
14	DE Bearing Cover	25	Screw Bolt	39.1	Plug Spacer
15	DE Oil Seal				

# END SUCTION FIRE PUMP

## VES SERIES INSTALLATION DIMENSION

END SUCTION FIRE PUMP

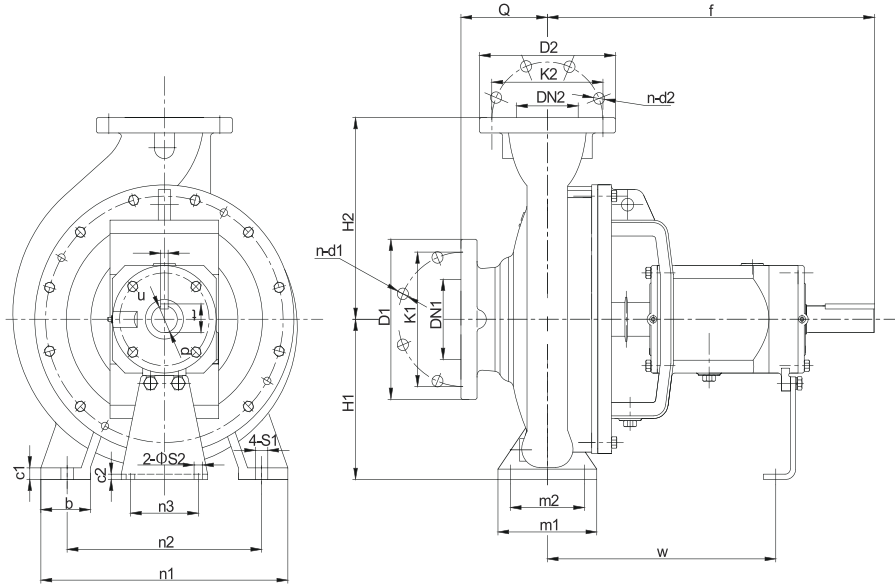

Model	DN1		DN2		Impeller Dia.	Shaft No.	a	f	h1	h2	b	m1	m2	n1	n2	n3	c1	c2	w	S1	S2	d	t	u	l	Weight (kg)
	inch	mm	inch	mm																						
40-250	2.5"	65	1.5"	40	250	2	100	500	180	225	65	125	95	320	250	110	14	6	370	M12	M12	32	35	10	80	71
50-250	3"	80	2"	50	250	2	125	500	180	225	65	125	95	320	250	110	15	6	370	M12	M12	32	35	10	80	76
65-250	4"	100	2.5"	65	250	2	125	500	200	250	80	160	120	360	280	110	16	6	370	M16	M12	32	35	10	80	84
80-250	5"	125	3"	80	250	2	125	500	225	280	80	160	120	400	315	110	18	6	370	M16	M12	32	35	10	80	88
80-315	5"	125	3"	80	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
100-315	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
100-250	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
100-200	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
80-200	5"	125	3"	80	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
150-100-200	6"	150	4"	100	200	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
150-100-315	6"	150	4"	100	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130

	Flange standard : ASTM B16.42-1998 Class150					Flange standard : ASTM B16.42-1998 Class300				
DN1/DN2	1.5"	2"	2.5"	3"	4"	5"	3"	4"	5"	
D1/D2	127	152.4	177.8	190.5	228.6	254	209.6	254	279.4	
K1/K2	98.6	120.7	139.7	152.4	190.5	215.9	168.1	200.2	234.9	
n-d1/ n-d2	4-φ15.7	4-φ19.1	4-φ19.1	4-φ19.1	8-φ19.1	8-φ22.4	8-φ22.4	8-φ22.4	8-φ22.4	

### FIRE PUMP SKIDS

MENA MECH IND CO is an established well reputed manufacturer of Premium Custom Engine Driven Centrifugal Fire Pump Skids. We specialized in designing and developing packages in compliance to NFPA 20 requirements with Listed & Approved Drivers.

MENA offers listed Centrifugal Fire Pump Skids that meet every fire protection need.

- Driven by Listed & Approved Diesel Engines or Electric Motors.
- Well aligned and Coupled for Direct Operation.
- Skid Packages are Pre-Tested and Inspected thoroughly before release to customers.
- One piece base plate with Anchor Bolt holes.
- Engineered, coated, hot rolled mild steel to resist corrosion and abrasion.
- Heavy Fabricated C-Channel Structure constructed to provide proper alignment of Pump with Diesel Engine or Pump with Motor.
- Compact skid Design with Small Foot-Print for Retrofit.
- High standard of Quality in material Construction finish and Workmanship.

## DIESEL DRIVEN SKIDS

MENA maintains its standard with using it's proudly own listed & approved Black Stallion Diesel Engines and Centrifugal Fire Pumps to package Heavy Duty and High Quality Compact Skids.


Our Listed and Approved Fire Pumps can also be coupled with any other Listed Diesel Engine of any specific brand as per customers requirement.



## MOTOR DRIVEN SKIDS

MENA maintains its standard with using WEG which is High Efficiency Fire Pump Motors with our own Listed and Approved Centrifugal Fire Pumps to package Heavy Duty and High Quality Compact Skids.

Our Listed and Approved Fire Pumps can also be coupled with any other Listed Fire Pump Motors of any specific brand as per client requirement.

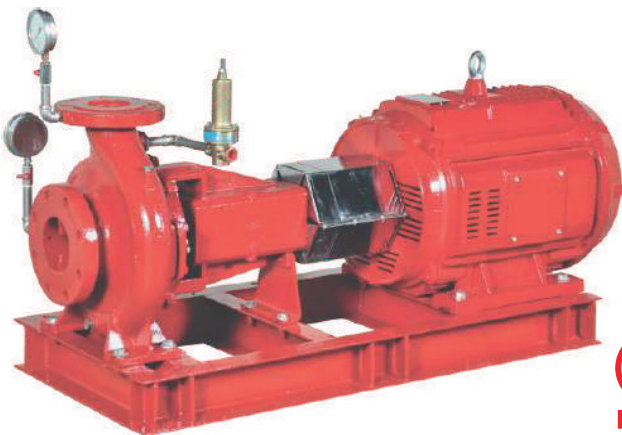


# END SUCTION -RANGE

## APPROVED UL LISTING RANGE

Rated Capacity, US GPM	Size, In.	Model	Pressure Rating, psi	Approx Speed RPM	Maximum Working Pressure Psi
50	2.5x1.5	VES 40-250	101 - 142	2900	200
50	2.5x1.5	VES 40-250	144 - 207	3500	290
100	2.5x1.5	VES 40-250	97 - 140	2900	200
100	2.5x1.5	VES 40-250	140 - 203	3500	290
150	2.5x1.5	VES 40-250	87 - 131	2900	200
150	2.5x1.5	VES 40-250	133 - 196	3500	290
150	3x2	VES 50-250	104 - 147	2980	225
150	3x2	VES 50-250	144 - 202	3500	290
200	3x2	VES 50-250	101 - 145	2980	225
200	3x2	VES 50-250	140 - 200	3500	290
250	3x2	VES 50-250	97 - 140	2980	225
250	3x2	VES 50-250	136 - 196	3500	290
250	4x2.5	VES 65-250	91 - 143	2900	225
250	4x2.5	VES 65-250	131 - 207	3500	290
300	4x2.5	VES 65-250	89 - 142	2900	225
300	4x2.5	VES 65-250	130 - 206	3500	290
400	4x2.5	VES 65-250	82 - 137	2900	225
400	4x2.5	VES 65-250	125 - 203	3500	290
400	5x3	VES 80-200	89 - 141	3500	225
400	5x3	VES 80-250	88 - 140	2900	225
400	5x3	VES 80-250	128 - 207	3500	290
450	5x3	VES 80-200	86 - 139	3500	225
450	5x3	VES 80-250	86 - 140	2900	225
450	5x3	VES 80-250	127 - 206	3500	290
450	5x3	VES 80-315	131 - 207	2900	290
450	5x4	VES 100-200	88 - 143	3500	225
450	5x4	VES 100-250	83 - 135	2900	290
450	5x4	VES 100-250	123 - 198	3500	290
450	5x4	VES 100-315	133 - 210	2900	290
450	5x4	VES 100-315	140 - 222	2980	290
500	5x3	VES 80-200	83 - 136	3500	225
500	5x3	VES 80-250	84 - 139	2900	225
500	5x3	VES 80-250	125 - 205	3500	290
500	5x3	VES 80-315	127 - 204	2900	290
500	5x4	VES 100-200	88 - 141	3500	225
500	5x4	VES 100-250	83 - 134	2900	290
500	5x4	VES 100-250	122 - 198	3500	290
500	5x4	VES 100-315	132 - 209	2900	290
500	5x4	VES 100-315	139 - 221	2980	290
500	6x4	VESD 150-100-200	116 - 142	3500	225
500	6x4	VESD 150-100-315	119 - 192	2900	250
750	5x4	VES 100-200	82 - 138	3500	225
750	5x4	VES 100-250	115 - 191	3500	290
750	5x4	VES 100-315	125 - 202	2900	290
750	5x4	VES 100-315	133 - 214	2980	290
750	6x4	VESD 150-100-200	112 - 137	3500	225
750	6x4	VESD 150-100-315	113 - 186	2900	250
1000	6x4	VESD 150-100-200	99 - 128	3500	225
1000	6x4	VESD 150-100-315	101 - 173	2900	250

LISTING RANGE



	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## DIESEL ENGINE SPECIFICATIONS

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



## UL Listed Fire Pump Engines 24HP-262HP



### Specification

Engine Model	<b>6110THE</b>	
Engine Type	Vertical, Water-cooling 4-stroke, direct-injection	
Cooling Method	Heat Exchanger	
Aspiration	Turbo-Charged	
Number of Cylinders	6	
Bore x Stroke (mm)	110*125	
Compression Ratio	17.5:1	
Total Displacement(L)	7.12	
Net Power	KW/HP	136/185
Rated Speed	r/min	2920
Rated Torque	N.m	507
Fuel Consumption	Gal/hr	12.84
Rotating Direction at Output End	Counter-clockwise	
Lubrication Oil Standard	CD15W40	
Lubrication Oil Content	L	14
Lubrication Method	Pressure and Splash	
Starting Method	Electric 24V	
PTO Type	Stub Shaft	
Net Weight	kgs	880



### Engine Ratings Baselines

Engines are not to be used for continuous duty. Engines are to be used only for stationary emergency standby fire pump.

Engines are rated at standard SAE conditions of 29.61 in. (7,521 mm) Hg barometer and 77°F (25°C) inlet temperature (approximates 300ft. (91.4m) above sea level)

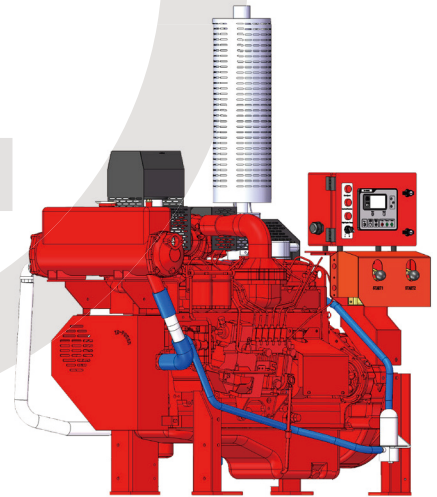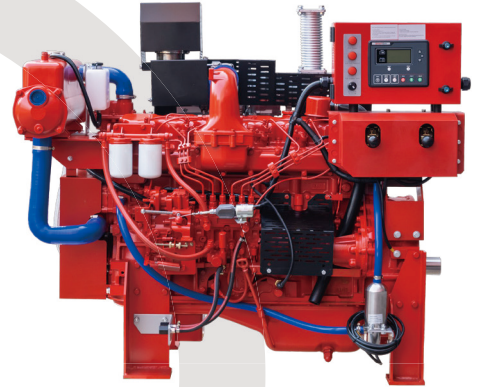

Performance Curve

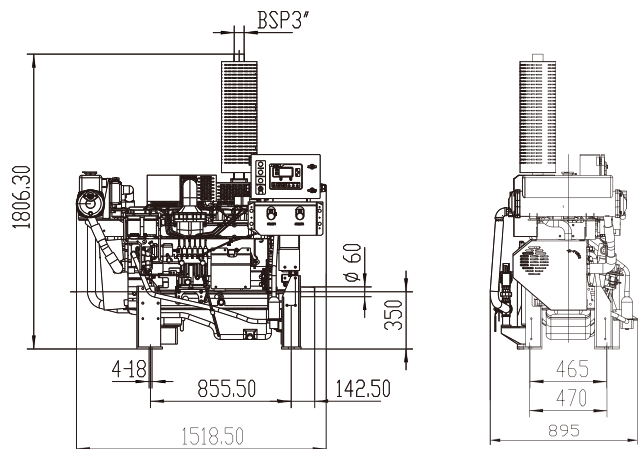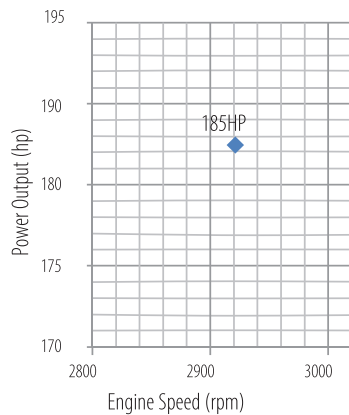



## UL Listed Fire Pump Engines 24HP-262HP

<b>General Engine Data Sheet</b>	
Engine Model	6110THE
Ignition Type	Compression ( Diesel )
Number of Cylinders	6
Bore and Stroke - mm(inch)	110x 125(4.31x4.90)
Displacement - L(inch <sup>3</sup> )	7.12(614)
Compression Ratio	17.5 : 1
Valve per cylinder - Intake	1
Exhaust	1
Combustion System	Direct Injection
Engine Type	In-Line, 4 Stroke, Direct injector
Aspiration	Turbo
Firing Order	1-5-3-6-2-4
Charge Air Cooling Type	Turbo-charged
Rotation(Viewed from Flywheel end) - Clockwise	Counter-Clockwise
Engine Crankcase Vent System	Open
Installation Drawing	6110THE-01(refer to Opertaion manual)
<b>Power Rating - Approved</b>	
Engine Nameplate Power - HP(kW)	185(136)
Max Power - HP(kW)	210(155)
Speed - r/min	2920
<b>Cooling system</b>	
Engine Coolant Heat - Btu/sec(kW)	95( 100)
Engine Radiated Heat - Btu/sec(kW)	70.53( 74.8 )
Heat Exchanger minimum Flow	
60°F (16°C) Raw Water - US.gal/min (LPM)	37.5( 142)
100°F (38°C) Raw Water - US.gal/min (LPM)	40(151)
Heat Exchanger Maximum Cooling Water	
Inlet Pressure - lb/in <sup>2</sup> (bar)	13.8 ( 2 )
Flow - gal/min (LPM)	40( 150)
Raw water inlet size- Inch	BSP1¼
Raw water outlet size- Inch	BSP1½
Thermostat, Start to Open - °F (°C)	149 ( 65 )




## UL Listed Fire Pump Engines 24HP-262HP

Fully Opened - °F (°C)	167 (75)
Engine Coolant capacity - L	38
Engine Coolant High Temp. Switch - °F (°C)	203 (95)
Engine Coolant Low Temp. Switch - °F (°C)	120 (49)
Raw water High Temp. Switch - °F (°C)	104 (40)
<b>Electric System - DC</b>	
System Voltage (Nominal)	24V
Battery Capacity for Ambient above 32°F (0°C)	
Voltage (Nominal)	24V
Current Capacity - Amp/hr	150
Qty. per Battery Bank	1
CCA @ 40°F (4.3°C)	320
Reserve Capacity - Minutes	45
Battery Cable Minimum Size - mm <sup>2</sup>	35
Charging Alternator Output - Amp	26.7
Starter Cranking Amps - @ 60°F (15°C)	250-290
Stop solenoid	ETS
<b>Exhaust System</b>	
Exhaust Flow - ft <sup>3</sup> /min (m <sup>3</sup> /min)	376( 10.66)
Exhaust Temperature - °F (°C)	1022 ( 550)
Max. Allowable Back Pressure - in H <sub>2</sub> O(kPa)	16 ( 4)
Exhaust pipe Dia. In (mm) for further exhaustpiping(Min.)	3( 76)
<b>Fuel System</b>	
Fuel Consumption - US.gal/hr (L/hr)	12.84(49.6)
Fuel Return - US.gal/hr (L/hr)	2.56( 9.9)
Total Supply Fuel Flow - gal/hr (L/hr)	15.4(59.5)
Fuel Pressure - lb/in <sup>2</sup> (kPa)	29 ( 200)
Fuel Supply Line Size(Min.) - in(mm)	BSP3/8 ( 9.5)
Fuel Return Line Size(Min.) - in(mm)	BSP3/8 ( 9.5)
Max. Allowable Fuel Pump Suction With CleanFilter - in H <sub>2</sub> O (m H <sub>2</sub> O)	31 ( 0.8)
Max. Allowable Fuel Head Above Fuel Pump Supply or Return - m (ft)	5 (16.4)
Fuel Filter Size - Micron	5-10 micron



## UL Listed Fire Pump Engines 24HP-262HP

<b>Heater System</b>	
Jacket Water Heater	Standard
Wattage (Nominal)	2200W
Voltage - AC, 1P	220V
<b>Air Intake System</b>	
Air Cleaner Type	Dry type
Air Intake Restriction Maximum Limit	
Dirty Air Cleaner - in H <sub>2</sub> O (kPa)	8 ( 2 )
Clean Air Cleaner - in H <sub>2</sub> O (kPa)	4 ( 1.0 ) - 5 ( 1.25 )
Engine Air Flow - ft <sup>3</sup> /min (m <sup>3</sup> /min)	381(10.82)
Air Temperature(At Engine Inlet) - °F (°C)	113 ( 45 ) Max. Allowable
<b>Lubrication System</b>	
Oil Pressure(Normal) - lb/in <sup>2</sup> (kPa)	36.2 to 72.3( 250 to 500)
Oil Temperature(In Pan) - °F (°C) (max.)	194 ( 90 )
Oil Pan Capacity, High - L	14.5
Low - L	13.5
Total Oil Capacity with filter - L	14.5
<b>Performance</b>	
BMEP - lb/in <sup>2</sup> (kPa)	94.2-203 ( 650-1400 )
Piston Speed - ft/min (m/min)	2903( 737.5 )
Mechanical Noise - dB(A) @ 1m	107 approx.
Power Curve	Refer to operation manual

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## DIESEL DRIVEN PUMP CONTROLLER SPECS

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



# TORNATECH

Project: \_\_\_\_\_

Customer: \_\_\_\_\_

Engineer: \_\_\_\_\_

Pump Manufacturer: \_\_\_\_\_

## Technical Data Submittal Document

### Model GPD

## Diesel Engine Driven Fire Pump Controller



### Contents:

- Data Sheets
- Dimensional Data
- Wiring Schematics
- Field Connections

**Note:** The drawings included in this package are for controllers covered under our standard offering. Actual AS BUILT drawings may differ from what is shown in this package.



March 2024



<b>Standard, Listings, Approvals and Certifications</b>	<b>Built to NFPA 20 (latest edition)</b>		
	<b>Underwriters Laboratory (UL)</b>	UL218 - Fire Pump Controllers	
	<b>FM Global</b>	Class 1321/1323	
	<b>New York City</b>	Accepted for use in the City of New York by the Department of Buildings	
	<b>CE Mark</b>	Various EN, IEC & CEE directives and standards	
	Built in Canada or U.A.E	Built in Europe	
	CE Mark Option	Supplied as Standard	
<b>Enclosure</b>	<b>Protection Rating</b>		
	Built in Canada or U.A.E	Built in Europe	
	Standard: NEMA 2	Standard: IP55	
	<b>Optional</b>		
	NEMA 12	NEMA 4X-304 sst painted	IP54
	NEMA 3	NEMA 4X-304 sst brushed finish	IP55
	NEMA 3R	NEMA 4X-316 sst painted	IP65
	NEMA 4	NEMA 4X-316 sst brushed finish	IP66
	<b>Accessories</b> • Bottom entry gland plate • Lifting Lugs • Keylock handle	<b>Paint Specifications</b> • Red RAL3002 • Powder coating • Glossy textured finish	
	<b>Ambient Temperature Rating</b>	<b>Standard</b> 4°C to 40°C / 39°F to 104°F	
<b>Optional</b> 4°C to 55°C / 39°F to 131°F Controllers built in Dubai, UAE (Tornatech FZE) are supplied standard with 55°C rating.			





<b>General</b>	AC	120V / 1ph / 60hz 208V to 240V / 1ph / 50-60hz
	DC	12VDC 24VDC
	Grounding system	• Negative
	Battery chargers	• Two independent fully automatic • 10A continuous charge • 500mA trickle charge
<b>Electrical Reading</b>	<ul style="list-style-type: none"> <li>• Battery 1 &amp; Battery 2 voltage</li> <li>• Battery 1 &amp; Battery 2 charging amperage</li> <li>• Charging mode</li> </ul>	
<b>Pressure Reading</b>	<ul style="list-style-type: none"> <li>• Continuous system pressure display</li> <li>• Cut-in and cut-out pressure setting</li> </ul>	
<b>Pressure and Event Recorder</b>	<ul style="list-style-type: none"> <li>• Pressure readings with date stamp</li> <li>• Event recording with date stamp</li> <li>• Under regular maintained operation, events are stored in memory for the life of the controller.</li> <li>• Data viewable on operator interface display screen</li> <li>• Downloadable by USB port to external memory device</li> </ul>	



<b>Pressure sensing</b>	<ul style="list-style-type: none"> <li>• Pressure transducer and run test solenoid valve assembly for fresh water application</li> <li>• Pressure sensing connection 1/2" Female NPT</li> <li>• Drain connection 3/8"</li> <li>• Rated and calibrated for 0-500psi working pressure</li> <li>• Externally mounted with protective cover</li> </ul>
<b>Audible Alarm</b>	Alarm buzzer - 85dB at 3 meters
<b>Visual Indications</b>	<ul style="list-style-type: none"> <li>• Engine run</li> <li>• Main switch AUTO</li> <li>• Main switch in OFF</li> <li>• Main switch in HAND</li> <li>• Periodic test</li> <li>• Cranking Cycle</li> <li>• AC Power available</li> <li>• Pump room temperature (°F or °C)</li> </ul>
<b>Visual &amp; Audible Alarms</b>	<p>Visual only</p> <ul style="list-style-type: none"> <li>• Pump room trouble</li> <li>• Pump on demand</li> <li>• AC Failure</li> <li>• Charger 1 &amp; 2 Failure</li> <li>• Weak battery 1 &amp; 2</li> <li>• Battery 1 &amp; 2 overvoltage</li> <li>• Loss of continuity 1 &amp; 2</li> <li>• High fuel level</li> <li>• Fuel tank leak</li> <li>• PLD low suction pressure</li> <li>• High raw water temperature</li> <li>• Low pump room temperature</li> <li>• Service required</li> <li>• ECM warning</li> <li>• Weekly test cut-in not reached</li> <li>• Check weekly test solenoid</li> <li>• Pressure transducer fault</li> <li>• Invalid Cut-In</li> </ul> <p>Visual and Audible</p> <ul style="list-style-type: none"> <li>• Engine trouble</li> <li>• Controller trouble</li> <li>• Engine low oil pressure</li> <li>• Engine high temperature</li> <li>• Engine low temperature</li> <li>• Engine overspeed</li> <li>• DC Failure</li> <li>• Battery 1 &amp; 2 Failure</li> <li>• Engine fail to start</li> <li>• Low fuel level</li> <li>• ECM fault</li> <li>• ECM SS in Alternate Position</li> <li>• Fuel injection malfunction</li> </ul>
<b>Remote Alarm Contacts</b>	<p>DPDT-8A-250V.AC</p> <ul style="list-style-type: none"> <li>• Engine run</li> <li>• Common controller trouble             <ul style="list-style-type: none"> <li>• Charger #1 &amp; Charger #2 failure</li> <li>• Pressure transducer fault</li> </ul> </li> <li>• Common engine trouble             <ul style="list-style-type: none"> <li>• High engine temperature</li> <li>• Fail to start</li> <li>• Fuel injection malfunction**</li> <li>• ECM selector switch in alternate position***</li> <li>• Battery #1 &amp; battery #2 failure</li> <li>• DC failure</li> <li>• Loss of continuity (starter) #1 and/or #2</li> <li>• PLD low suction pressure</li> <li>• Overspeed</li> <li>• Fail when running</li> <li>• Low oil pressure</li> </ul> </li> <li>• Common pump room trouble (field re-assignable)*             <ul style="list-style-type: none"> <li>• Low fuel level</li> <li>• High fuel level</li> <li>• Fuel tank leak</li> <li>• Low pump room temperature</li> <li>• High pump room temperature</li> <li>• AC Failure</li> </ul> </li> <li>• H-O-A selector switch in OFF or HAND</li> <li>• Free (field programmable)*</li> </ul>

\*Except if option C13 is ordered. Tornatech reserves the right to use any of these four alarm points for special specific application requirements

\*\*Applicable to electronic engines only.

\*\*\* Applicable to electronic engines only. Alarms when ECM selector switch on the engine is in alternate mode.



<b>Terminals for Field Connections for External Devices</b>	<ul style="list-style-type: none"> <li>• Low fuel level</li> <li>• Remote AUTOMATIC start</li> <li>• Water reservoir low (re-assignable)</li> <li>• Fuel tank leak (re-assignable)</li> <li>• High fuel level (re-assignable)</li> </ul>		
<b>ViZiTouch V2.1 Operator Interface</b>	<ul style="list-style-type: none"> <li>• Embedded microcomputer with software PLC logic</li> <li>• 7.0" color touch screen (HMI technology)</li> <li>• Upgradable software</li> <li>• Multi-language</li> </ul>		
<b>Operation</b>	<b>Selector Switch</b>	<ul style="list-style-type: none"> <li>• Hand-Off-Auto</li> <li>• Behind lockable and breakable cover</li> </ul>	
	<b>Automatic Start</b>	<ul style="list-style-type: none"> <li>• Start on pressure drop</li> <li>• Remote start signal from automatic device</li> </ul>	
	<b>Manual Start</b>	<ul style="list-style-type: none"> <li>• Crank 1 and Crank 2 start pushbuttons</li> <li>• Run test pushbutton</li> </ul>	
	<b>Crank Cycle</b>	<ul style="list-style-type: none"> <li>• 6 consecutive cycle attempts               <ul style="list-style-type: none"> <li>• 3 X 15s crank from battery 1 or 2 alternatively</li> <li>• 15s rest in between each crank attempt</li> </ul> </li> </ul>	
	<b>Stopping</b>	<ul style="list-style-type: none"> <li>• Manual with Stop pushbutton</li> <li>• Automatic after expiration of minimum run timer ****</li> </ul>	
	<b>Timers</b>	<b>Field Adjustable &amp; Visual Countdown</b>	<ul style="list-style-type: none"> <li>• Minimum run timer ****(off delay)</li> <li>• Sequential start timer (on delay)</li> <li>• Periodic test timer</li> </ul>
	<b>Actuation</b>	<b>Visual Indication</b>	<ul style="list-style-type: none"> <li>• Pressure</li> <li>• Non-pressure</li> </ul>
	<b>Mode</b>		<ul style="list-style-type: none"> <li>• Automatic</li> <li>• Non-automatic</li> </ul>
<b>Communication Protocol Capability</b>	<ul style="list-style-type: none"> <li>• Protocol: Modbus</li> <li>• Connection type: Shielded female connector RJ45</li> <li>• Frame Format: TCP/IP</li> <li>• Addresses: See bulletin MOD-GPD</li> </ul>		

<b>Alarm and shutdown schedule</b>		Automatic Start	Manual or Remote Start	Run Test or Periodic Test
	High Coolant	Alarm only	Alarm only	Shutdown
	Low Oil Pressure	Alarm only	Alarm only	Shutdown
	Overspeed	Shutdown	Shutdown	Shutdown

	<b>Wall Mount</b>		<b>Floor Mount</b>	
Starting Voltage	Approx. shipping dimensions in inches (mm)	Approx. Shipping Weight in Lbs (kg)	Approx. shipping dimensions in inches (mm)	Approx. Shipping Weight in Lbs (kg)
12V.DC	32" l x 29" w x 16" h (813 x 737 x 407 )	85 (39)	32" l x 29" w x 26" h (813 x 737 x 661)	115 (52)
24V.DC				

\*\*\*\* Automatic shutdown shall be approved by the AHJ.



A1	Periodic test alarm contact (DPDT)
A2	Overspeed alarm contact (DPDT)
A3	Low oil pressure alarm contact (DPDT)
A4	High coolant temperature alarm contact (DPDT)
A5	Failure to start alarm contacts alarm contact (DPDT)
A6	Battery 1 & 2 failure alarm contact (2 x DPDT)
A7	Charger 1 & 2 failure alarm contact (2 x DPDT)
A8	AC failure alarm contact (DPDT)
A9	System overpressure alarm contact (For engines with PLD) (DPDT)
A11	Extra controller trouble alarm contact (DPDT)
A12	Extra engine trouble alarm contact (DPDT)
Ax	Additional engine alarm contact (DPDT) (specify function)
B1	Low fuel level alarm contact (DPDT)
B2	Water reservoir level low alarm contact (DPDT)
B3	Water reservoir empty alarm contact (DPDT)
B4	Low pump room temperature alarm contact (DPDT)
B5	High fuel level alarm contact (DPDT)
B6	Low system (discharge) pressure alarm contact (DPDT)
B7	Low suction pressure alarm contact (DPDT)
B8	Pump on demand alarm contact (DPDT)
B9	Fuel tank leak alarm contact (DPDT)
B10	Main relief valve open alarm contact (DPDT)
B11	Flow meter loop valve open alarm contact (DPDT)
B12	Water reservoir level high alarm contact (DPDT)
B13	High pump room temperature alarm contact (DPDT)
Bx	Additional pump room alarm contact (DPDT) (specify function)
C5	CE Mark with factory certificate
C6	Nickel – cadmium battery chargers (Battery data sheet required)
C7	Engine block heater circuit - 3KW max (same voltage as battery charger primary)

C7A	Engine block heater circuit - 6KW max (same voltage as battery charger primary) Confirm power rating of block heater
C9	Non pressure actuated controller w/o pressure transducer and run test solenoid valve
C13	Louver activation circuit (battery power specific)
C14	Delayed automatic start on AC power failure (factory set at 15 minutes)
C15	Low zone pump control function
C16	Middle zone pump control function
C17	High zone pump control function
C19	Lockout/interlock circuit from equipment installed inside the pump room
D4	Pressure transducer and run test solenoid valve for fresh water rated for 0-500psi (for factory calibration purposes only)
D6	Pressure transducer and run test solenoid valve for sea water rated for 0-500PSI
D7A	Low fuel level float switch supplied as separate item (1-1/4")
D7B	Low fuel level float switch supplied as separate item (1-1/2")
D8A	High fuel level float switch supplied as separate item (1-1/4")
D8B	High fuel level float switch supplied as separate item (1-1/2")
D9A	Anti-condensation heater & thermostat
D9B	Anti-condensation heater & humidistat
D9C	Anti-condensation heater & thermostat & humidistat
D11	Low suction pressure transducer for fresh water rated at 0-300PSI with visual indication and alarm contact
D11A	Low suction pressure transducer for sea water rated at 0-300PSI with visual indication and alarm contact
D12	Tropicalization
D25	Mounting stand
D25A	Mounting stand SST- 304 painted
D25B	Mounting stand SST- 304 brushed finish
D25C	Mounting stand SST- 316 painted
D25D	Mounting stand SST- 316 brushed finish
D26	Combined low and high fuel level float switch (1-1/4")

Note: Options chosen from this page are not electrically represented on the wiring schematics in this submittal package.



D26A	Combined low and high fuel level float switch (1-1/2")
D27	Fuel level probe (2") Level indication
D28A	Field programmable I/O board - 5 Input / 5 output
D30	Redundant pressure transducer for fresh water rated for 0-500PSI
D31	Redundant pressure transducer for sea water rated for 0-500PSI
D32	Modbus with RTU frame format and RS485 connection
D35	Seismic Certification compliant to CBC 2019, IBC 2018 rigid base/wall mounted only
D38	Special Seismic Certification compliant to OSHPD rigid base/wall mounted only

L01	Other language and English (bilingual)
L02	French
L03	Spanish
L04	German
L05	Italian
L06	Polish
L07	Romanian
L08	Hungarian
L09	Slovak
L10	Croatian
L11	Czech
L12	Portuguese
L13	Dutch
L14	Russian
L15	Turkish
L16	Swedish
L17	Bulgarian
L18	Thai
L19	Indonesian
L20	Slovenian
L21	Danish
L22	Greek
L23	Arabic
L24	Hebrew
L25	Chinese

Additional Options:

---



---



---




---



---

Note: Options chosen from this page are not electrically represented on the wiring schematics in this submittal package.

ViZiTouch V2.1 Operator Interface

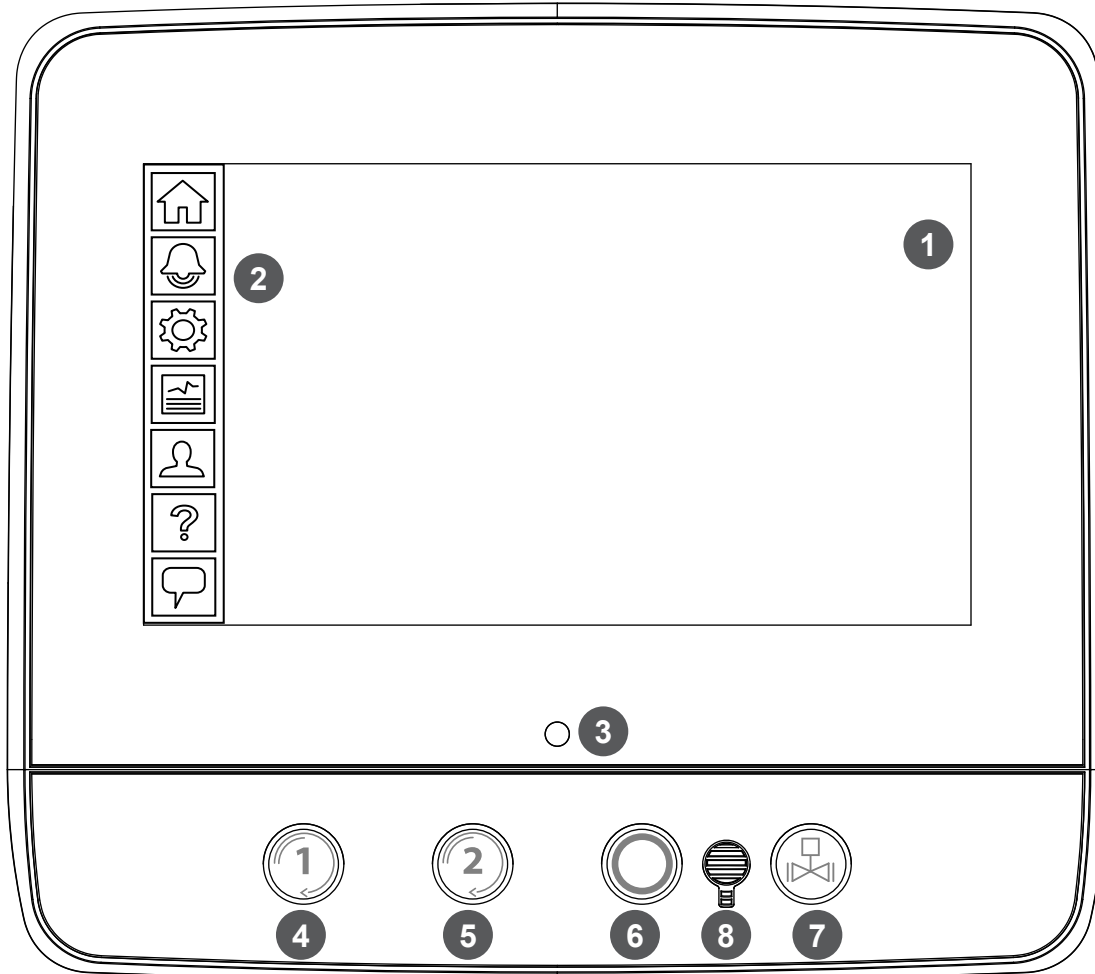

- |                        |                          |
|------------------------|--------------------------|
| 1 - Color touch screen | 3 - Power LED (3 colors) |
| 2 - Onscreen menu      | 4 - CRANK 1 button       |
| • HOME page            | 5 - CRANK 2 button       |
| • ALARM page           | 6 - STOP button          |
| • CONFIGURATION page   | 7 - RUN TEST button      |
| • HISTORY page         | 8 - Alarm buzzer         |
| • SERVICE page         |                          |
| • MANUAL page          |                          |
| • LANGUAGES page       |                          |



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

	BY	DD/MM/YY
DRAWN BY	ACD	28/02/23
FINAL APPROVAL	FC	28/02/23


# DIESEL ENGINE FIRE PUMP CONTROLLER 12VDC OR 24VDC NEGATIVE GROUND

**MODEL: GPD**

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70



DRAWING NUMBER	GPD-DI800/E
DWG REV. 0	
SHEET 1 OF 1	

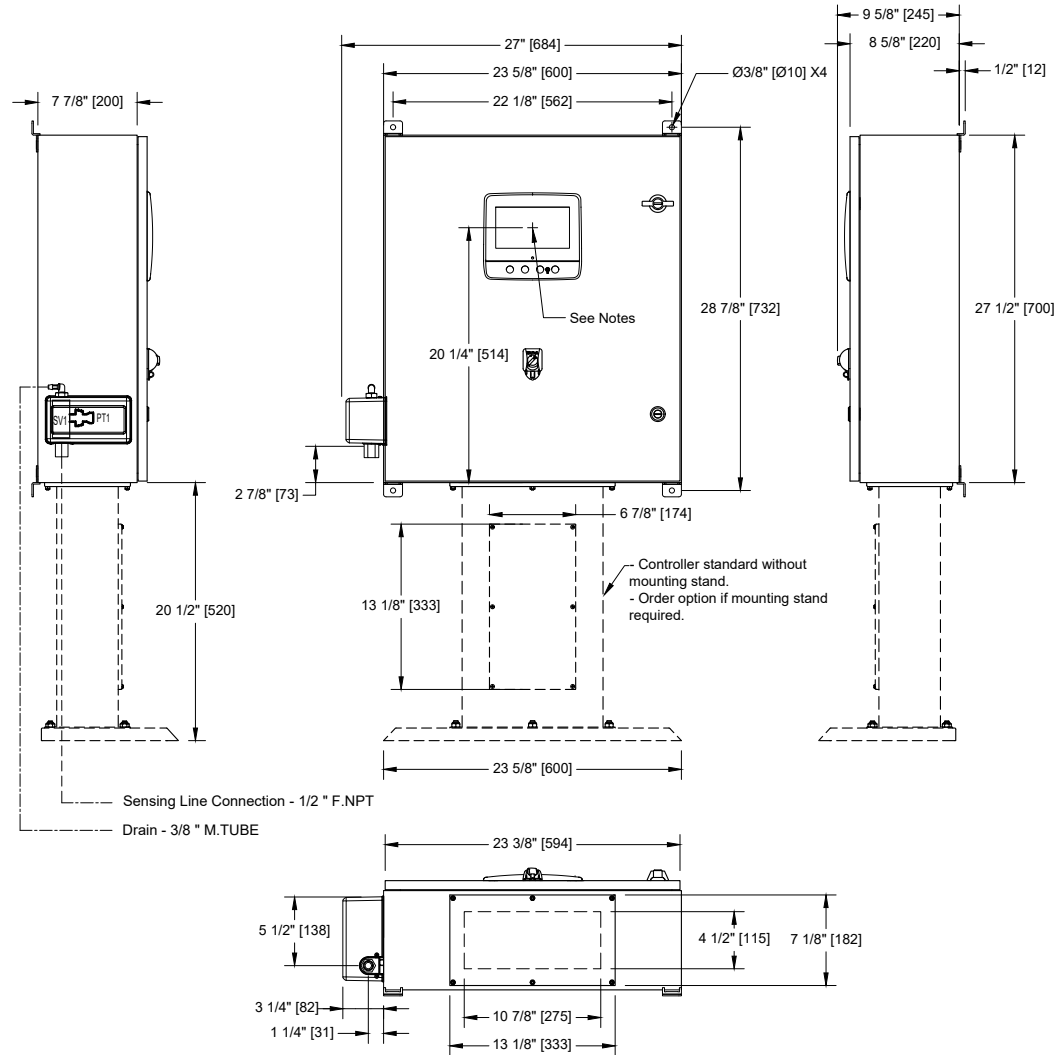

- Notes:**
- Standard: NEMA 2
  - Standard paint : textured red RAL 3002.
  - All dimensions are in inches [millimeters].
  - Center of screen: 20-1/4" [514] from bottom (no feet).
  - Bottom conduit entrance through removable gland plate recommended.
  - Use watertight conduit and connector only.
  - Protect equipment against drilling chips.
  - Door swing equal to door width.



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

	BY	DD/MM/YY
DRAWN BY	ACD	28/02/23
FINAL APPROVAL	FC	28/02/23

# DIESEL ENGINE FIRE PUMP CONTROLLER




## 12VDC OR 24VDC NEGATIVE GROUND

**MODEL: GPD**

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70



DRAWING NUMBER	GPD-WS800/E
DWG REV. 0	
SHEET 1 OF 2	

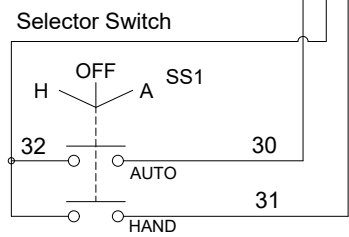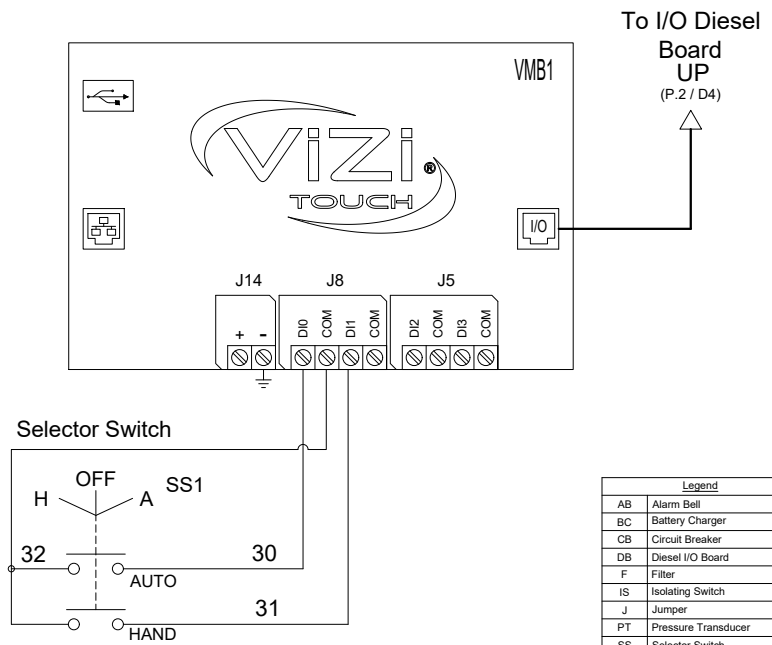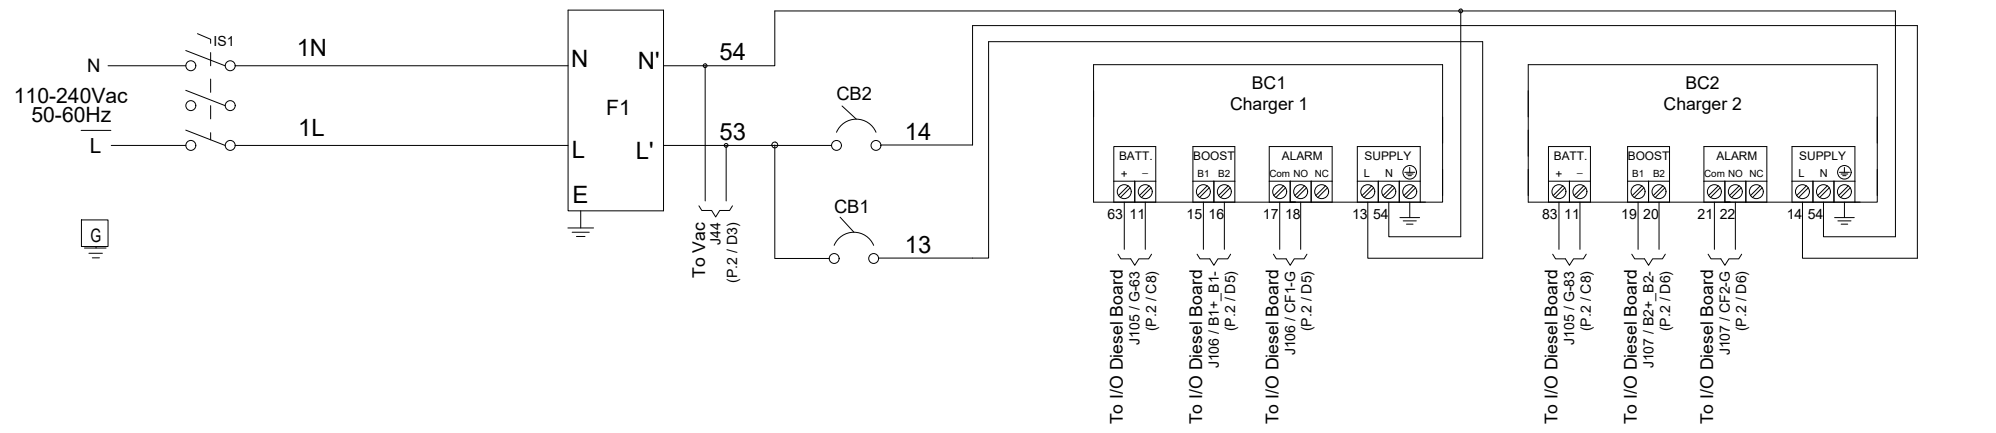

Legend	
AB	Alarm Bell
BC	Battery Charger
CB	Circuit Breaker
DB	Diesel I/O Board
F	Filter
IS	Isolating Switch
J	Jumper
PT	Pressure Transducer
SS	Selector Switch
SV	Solenoid Valve
VMB	Main Board



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

BY		DD/MM/YY	
DRAWN BY	ACD	28/02/23	
FINAL APPROVAL	FC	28/02/23	


# DIESEL ENGINE FIRE PUMP CONTROLLER 12VDC OR 24VDC NEGATIVE GROUND

**MODEL: GPD**

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70



DRAWING NUMBER	GPD-WS800/E
DWG REV. 0	
SHEET 2 OF 2	

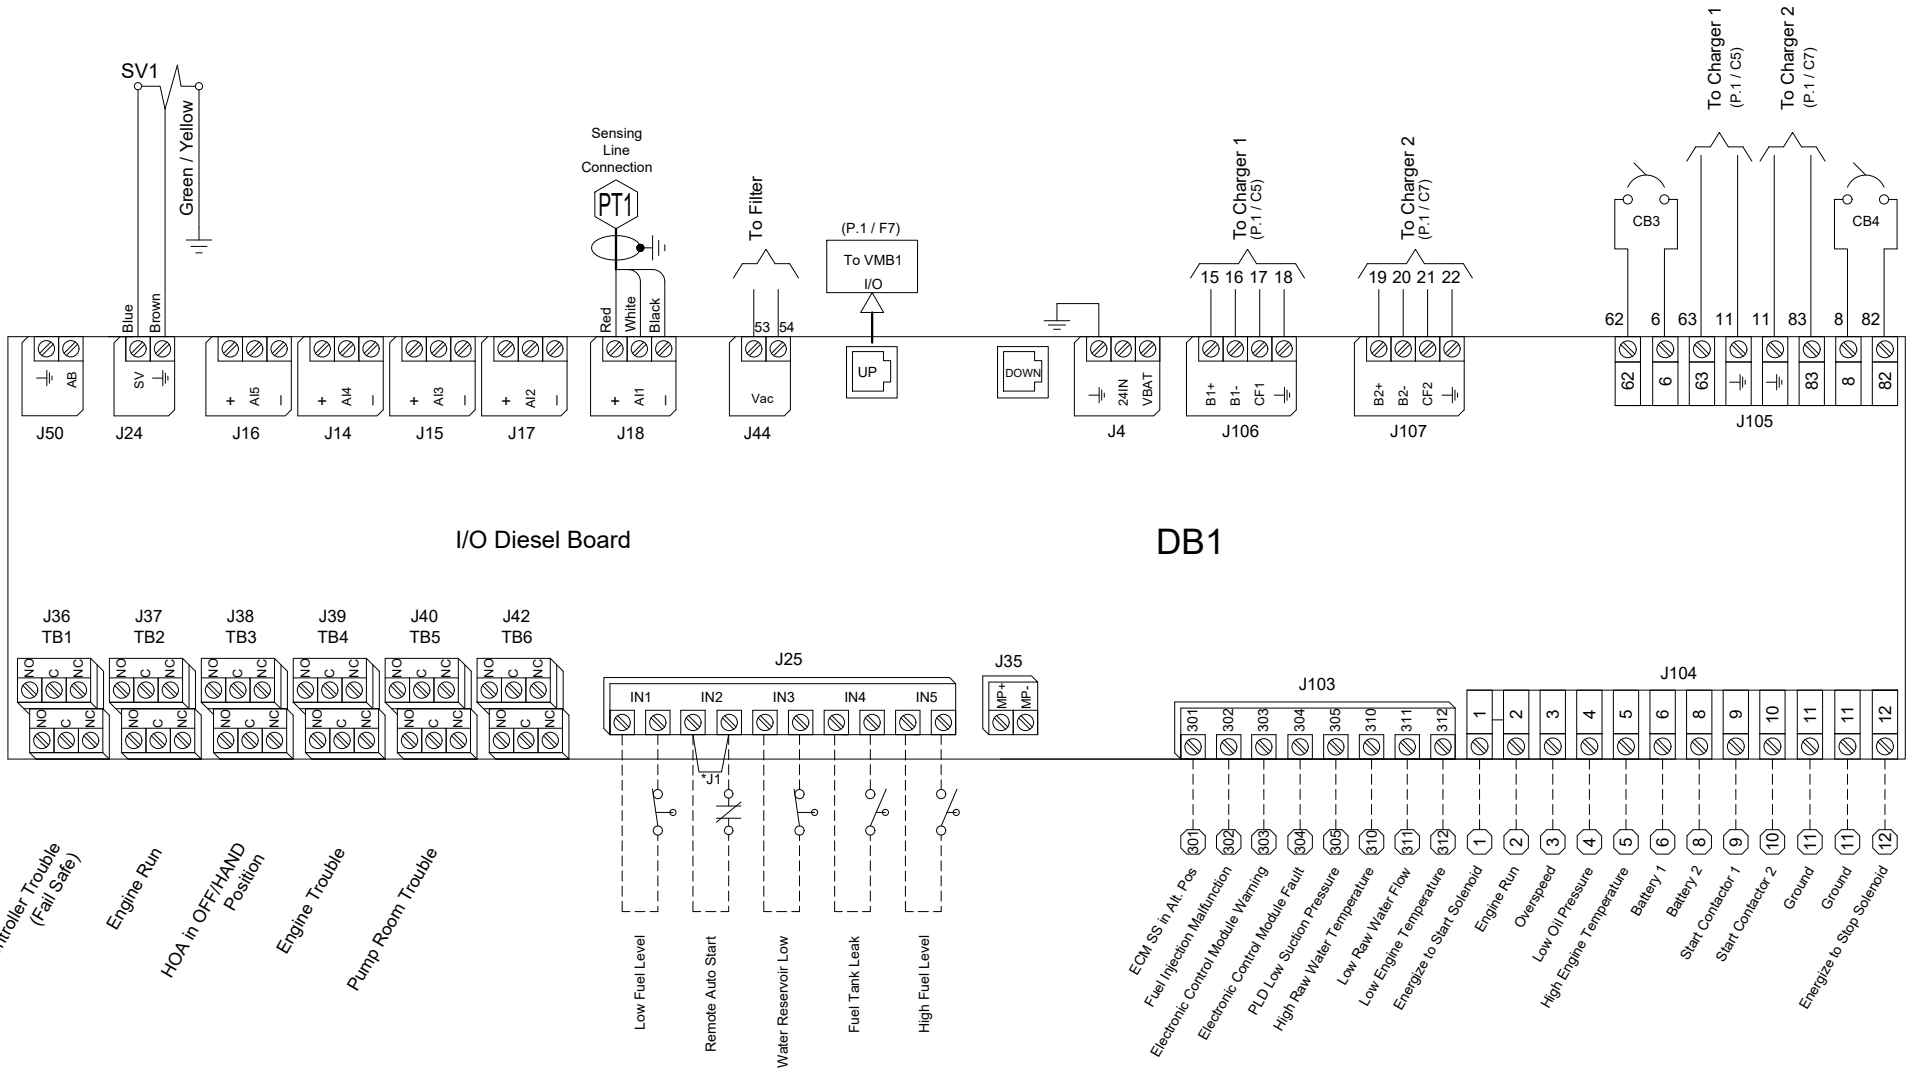

\* Remove this jumper to use this feature



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

	BY	DD/MM/YY
DRAWN BY	ACD	28/02/23
FINAL APPROVAL	FC	28/02/23

## DIESEL ENGINE FIRE PUMP CONTROLLER 12VDC OR 24VDC NEGATIVE GROUND

**MODEL: GPD**


BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70




THIRD ANGLE  
PROJECTION

DRAWING NUMBER	GPD-LY800/E
DWG REV. 0	
SHEET 1 OF 1	

Designation	Description
BC1-BC2	Battery Charger #1 and #2
CB1-2	Magnetic Breaker 1 Pole 10 A
CB3-4	Magnetic Breaker 1 Pole 16 A
DB1	I/O Diesel Board
F1	Filter
IS1	Isolating Switch
SS1	Lockable 3 Position Selector Switch
VMB1	Main Board

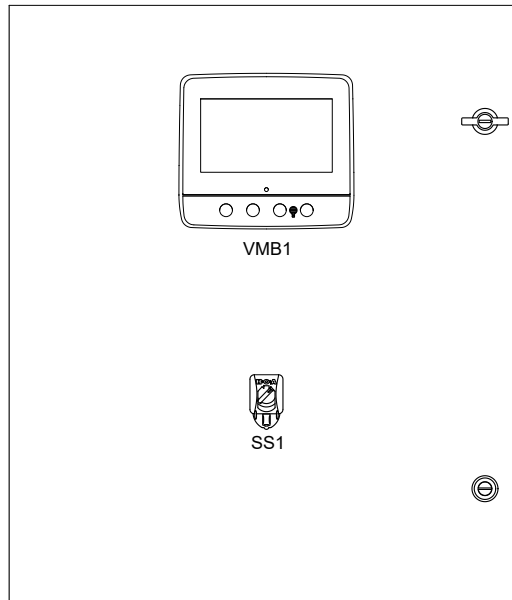

Front Door Layout

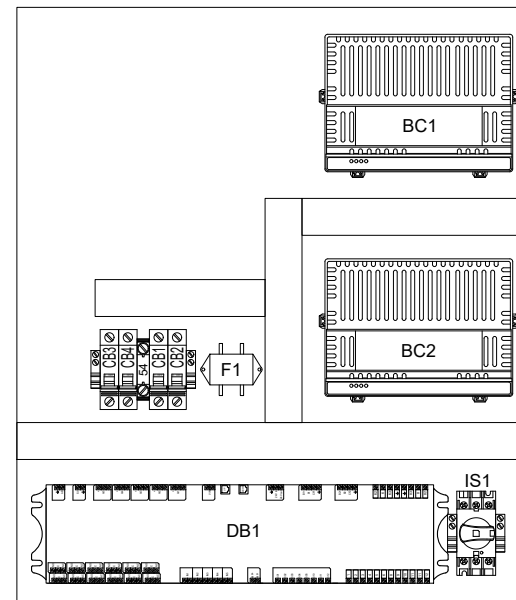

Internal Layout



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

BY		DD/MM/YY
DRAWN BY	ACD	28/02/23
FINAL APPROVAL	FC	28/02/23

# DIESEL ENGINE FIRE PUMP CONTROLLER 12VDC OR 24VDC NEGATIVE GROUND

**MODEL: GPD**

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70




DRAWING NUMBER  
**GPD-TD800/E**  
DWG REV. 0  
SHEET 1 OF 1

## Power Supply

Terminals Wire Size:  
14 - 6 AWG  
1.8-2 Nm


110-240Vac  
50-60Hz



## Engine Connections

All wiring between the controller and diesel engine shall be stranded (NFPA20)  
Wiring between controller and engine (terminals 301, 302, 303, 304, 305, 310, 311, 312, 2, 3, 4, 5) must be #14AWG as minimum.  
Wiring between controller and engine (terminals 12 [rated at 10A or 22A for 20 seconds] 1, 9, 10 [rated at 10A]) must be stranded #10AWG as minimum.  
Wiring between controller and engine (terminals 6, 8, 11 [rated at 30A]) must be stranded and sized according to distance.


0-5' (0-1.5m) - 12 AWG (4 mm2)  
6-10' (1.8-3m) - 10 AWG (6 mm2)  
11-15' (3.3-4.5m) - 8 AWG (10 mm2)  
16-20' (4.8-6m) - 2x10 AWG (2x6 mm2)  
21-32' (6.4-9.75m) - 2x8 AWG (2x10 mm2)

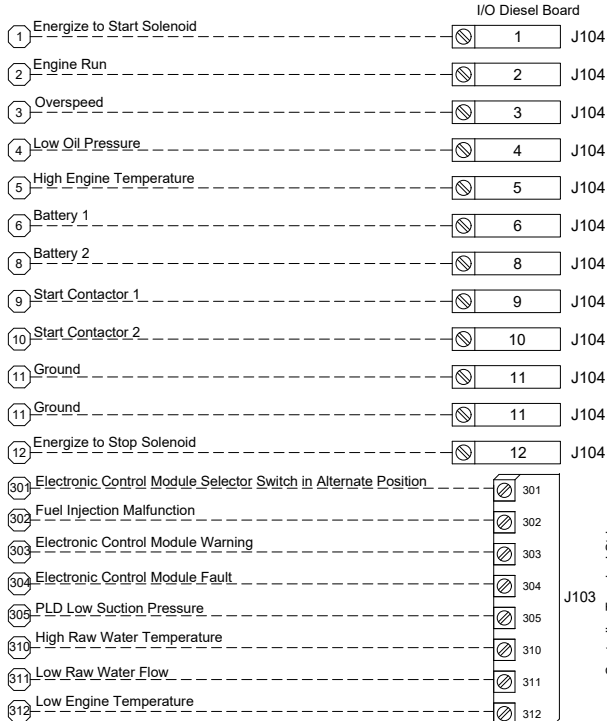

## Field Connections

Terminals Wire Size:  
24 - 12 AWG  
0.5 Nm

- Low Fuel Level
- Remote Auto Start
- Water Reservoir Low
- Fuel Tank Leak
- High Fuel Level



## Network Connections

Terminals Wire Size:  
Shielded Female Connector RJ45


Modbus TCP/IP

Located on Main Board



## Alarm Contacts

Terminals Wire Size:  
24 - 12 AWG  
0.5 Nm

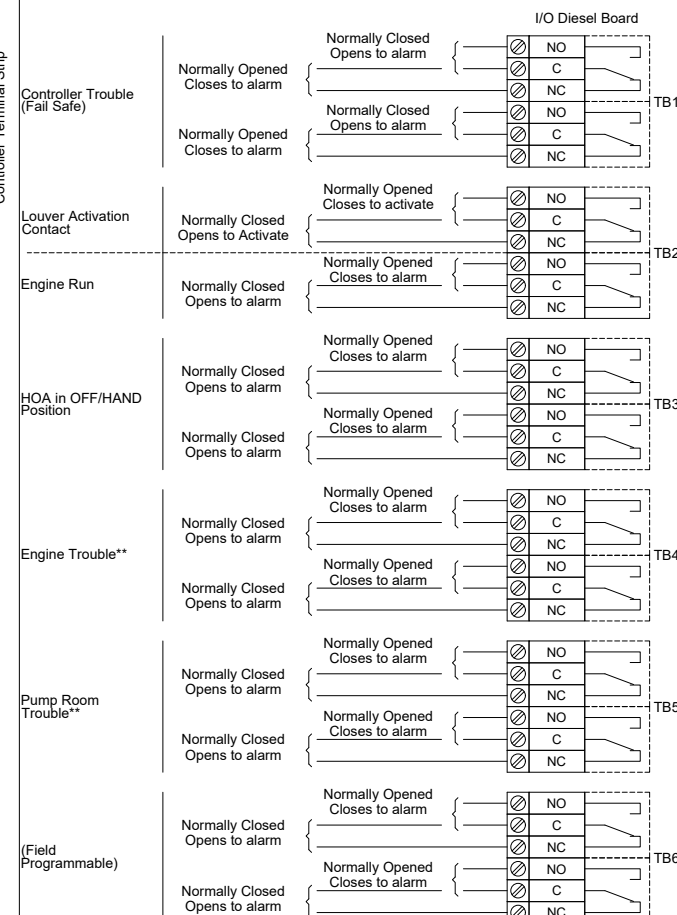

\* Remove this jumper to use this feature

\*\* Re-assignable



© Tornatech, Inc. Not for construction.  
Subject to change without notice.

	BY	DD/MM/YY
DRAWN BY	ACD	28/02/23
FINAL APPROVAL	FC	28/02/23

# DIESEL ENGINE FIRE PUMP CONTROLLER 12VDC OR 24VDC NEGATIVE GROUND



## MODEL: GPD

BUILT TO THE LATEST EDITION OF THE NFPA20 & NFPA70





DRAWING NUMBER	GPD-TD801/E
DWG REV.	0
SHEET 1 OF 1	

### Located in Controller

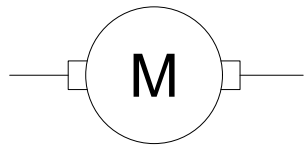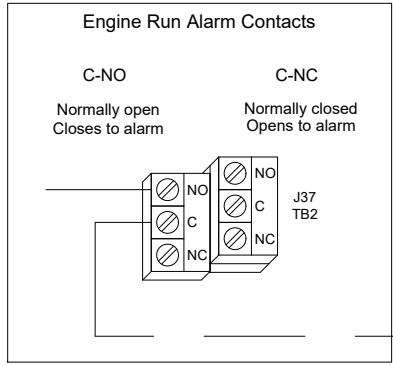

Louvers Motor




	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

**ELECTRIC MOTOR DRIVEN PUMP  
SPECIFICATIONS**

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# END SUCTION FIRE PUMP


END SUCTION FIRE PUMP

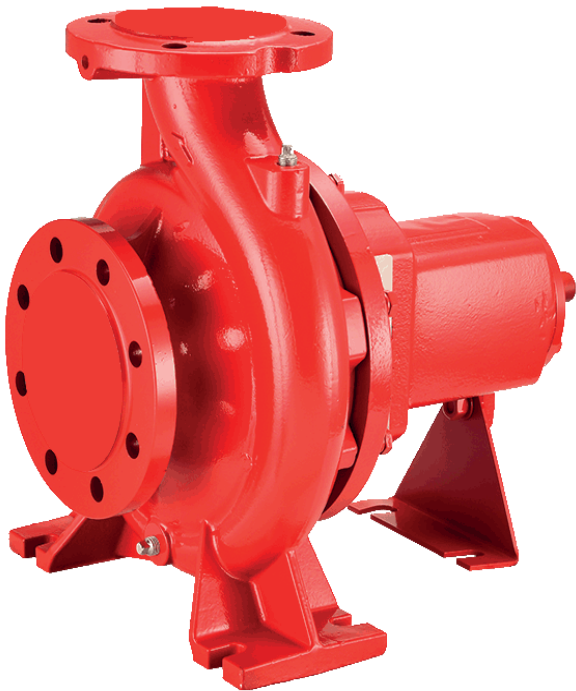

Technical Specifications	
Suction fange	1.5-6 Inch
Discharge fange	2.5-4 inch
Flow	50-1000 GPM
Discharge pressure	84-230PSI

Material Specifications	
Casing	Ductile Iron
Impeller	Bronze or stainless steel
Shaft	ATSM420
Sealing	Gland packing
Bearing Housing	Rolling bearing
Suction/discharge fanges	ANSI

## Pump Naming

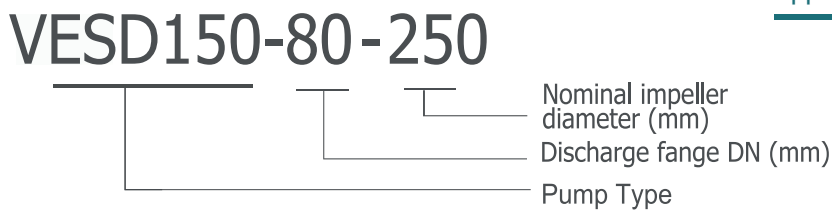

## Product Standard

UL 448, NFPA

## Product Approvals



## Flange Standards

Pump Installing Dimensions are confirming to ISO2858 Standard, and Tested according to with UL 448 -2013

## Driver Options



Electrical



Diesel

## Application Areas



Hydrant



Sprinkler



Overflow



Foam

## Risk Class




Ordinary



High

# END SUCTION FIRE PUMP

## General Pump Features

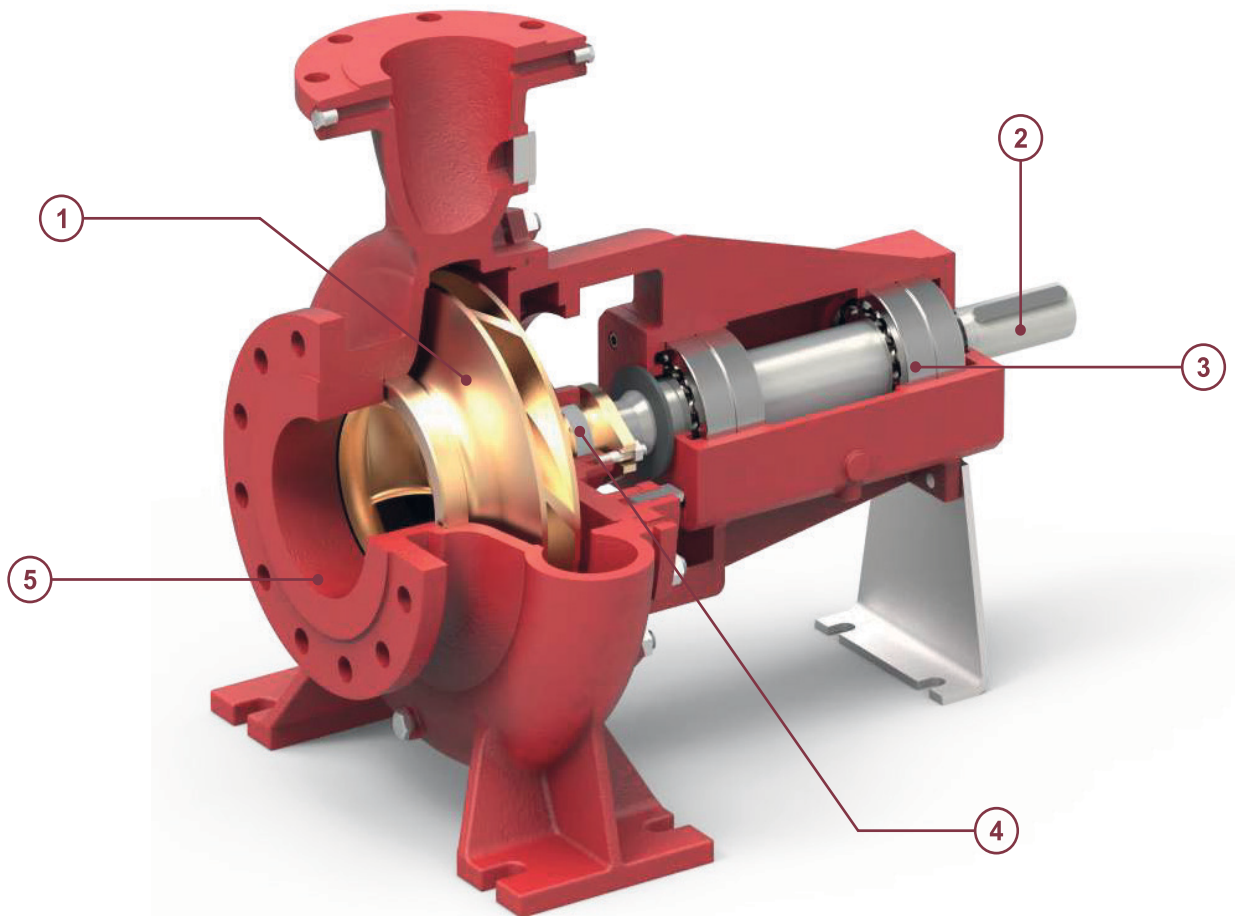

END SUCTION FIRE PUMP

### 1 - Impeller & Casing

- Impeller is dynamically balanced to grade G6.3 balance quality in accordance to ISO 1940-1.
- Impeller & Casing are designed using state of art CFD tools to ensure optimal performance.

### 2 - Shaft

- Heavy duty stainless steel shaft completely sealed and dry for zero corrosion available upon request.
- Short and rigid with negligible vibrations.
- Replaceable shaft protecting sleeves.
- No threads exposed to pump medium, long operating life and no corrosion.
- Adjustment-free assembly.

### 3 - Bearing

- Heavy duty and permanently grease lubricated antifriction bearings for long service life.
- Open gland, enough space for service activities.

### 4 - Seal


- Asbestos - free, soft packed stuffing boxes.

### 5 - Casing

- End Suction backpullout design permits maintenance of the pump without removing the pipes.
- Rugged Ball Bearings on Drive as well as Non Drive end.
- Flange drilled as per ANSI B16.1 class 250.
- Smooth surface inside & CED coated for superior corrosion protection.
- Replaceable wear ring protect the casing and the impeller running clearances.
- Heavy duty casing design for high working pressure.

# END SUCTION FIRE PUMP

## VES Series - Exploded View & Part list

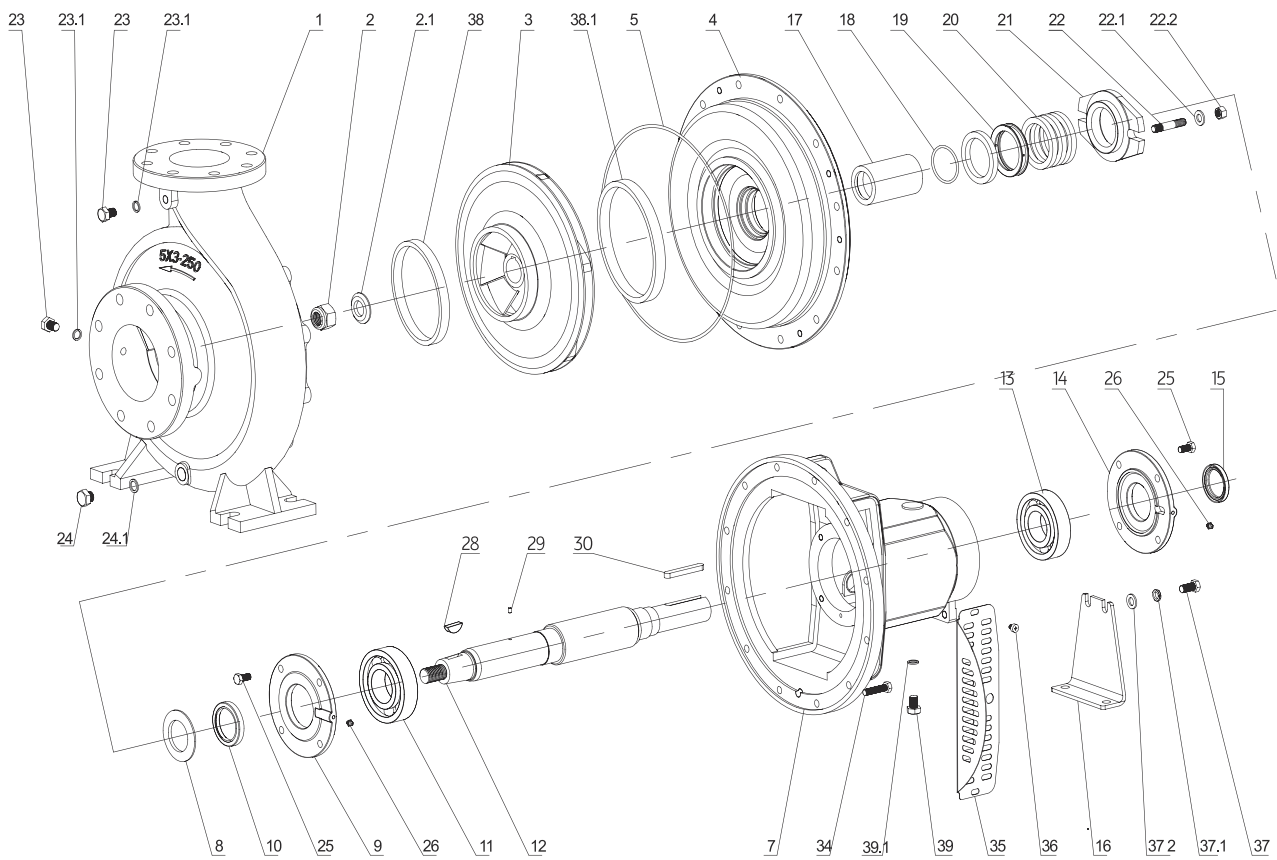


END SUCTION FIRE PUMP

Code	Part Name	Code	Part Name	Code	Part Name
1	Casing	16	Support Foot	26	Oil Cup M6
2	Impeller Nut	17	Packing Sleeve	28	key
2.1	Lock washer for impeller	18	O-ring	29	pin
3	Impeller	19	Gland Packing	30	key
4	Gland Cover	20	Packing Seal Cage	34	Screw Bolt
5	O-ring	21	Gland Cover	35	Protective cover
7	Bearing Housing	22	Stud Bolt	36	Bolt
8	Rubber Slinger	22.1	Flat Washer	37	Screw Bolt
9	NDE Bearing Cover	22.2	Screw Nut	37.1	Elastic Washer
10	NDE Oil Seal	23	Plug	37.2	Flat Washer
11	NDE Bearing	23.1	Plug Spacer	38	Front-Wearing
12	Shaft	24	Plug	38.1	Back-Wearing
13	DE Bearing	24.1	Plug Spacer	39	Plug
14	DE Bearing Cover	25	Screw Bolt	39.1	Plug Spacer
15	DE Oil Seal				

# END SUCTION FIRE PUMP

## VES SERIES INSTALLATION DIMENSION

END SUCTION FIRE PUMP

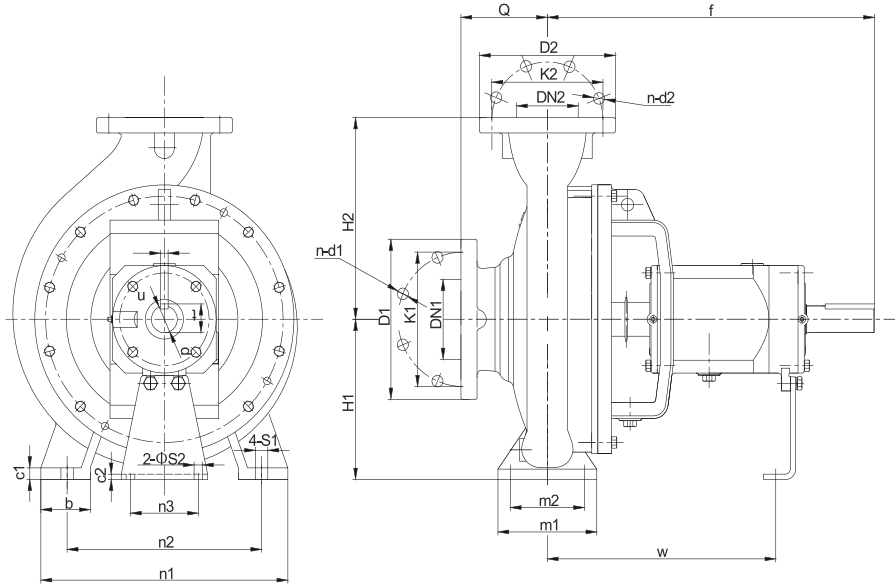

Model	DN1		DN2		Impeller Dia.	Shaft No.	a	f	h1	h2	b	m1	m2	n1	n2	n3	c1	c2	w	S1	S2	d	t	u	l	Weight (kg)
	inch	mm	inch	mm																						
40-250	2.5"	65	1.5"	40	250	2	100	500	180	225	65	125	95	320	250	110	14	6	370	M12	M12	32	35	10	80	71
50-250	3"	80	2"	50	250	2	125	500	180	225	65	125	95	320	250	110	15	6	370	M12	M12	32	35	10	80	76
65-250	4"	100	2.5"	65	250	2	125	500	200	250	80	160	120	360	280	110	16	6	370	M16	M12	32	35	10	80	84
80-250	5"	125	3"	80	250	2	125	500	225	280	80	160	120	400	315	110	18	6	370	M16	M12	32	35	10	80	88
80-315	5"	125	3"	80	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
100-315	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
100-250	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
100-200	5"	125	4"	100	315	3	140	530	250	315	80	160	120	400	315	110	19	8	370	M16	M12	42	45	12	110	138
80-200	5"	125	3"	80	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
150-100-200	6"	150	4"	100	200	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130
150-100-315	6"	150	4"	100	315	3	125	530	250	315	80	160	120	400	315	110	20	8	370	M16	M12	42	45	12	110	130

	Flange standard : ASTM B16.42-1998 Class150					Flange standard : ASTM B16.42-1998 Class300				
DN1/DN2	1.5"	2"	2.5"	3"	4"	5"	3"	4"	5"	
D1/D2	127	152.4	177.8	190.5	228.6	254	209.6	254	279.4	
K1/K2	98.6	120.7	139.7	152.4	190.5	215.9	168.1	200.2	234.9	
n-d1/ n-d2	4-φ15.7	4-φ19.1	4-φ19.1	4-φ19.1	8-φ19.1	8-φ22.4	8-φ22.4	8-φ22.4	8-φ22.4	

### FIRE PUMP SKIDS

MENA MECH IND CO is an established well reputed manufacturer of Premium Custom Engine Driven Centrifugal Fire Pump Skids. We specialized in designing and developing packages in compliance to NFPA 20 requirements with Listed & Approved Drivers.

MENA offers listed Centrifugal Fire Pump Skids that meet every fire protection need.

- Driven by Listed & Approved Diesel Engines or Electric Motors.
- Well aligned and Coupled for Direct Operation.
- Skid Packages are Pre-Tested and Inspected thoroughly before release to customers.
- One piece base plate with Anchor Bolt holes.
- Engineered, coated, hot rolled mild steel to resist corrosion and abrasion.
- Heavy Fabricated C-Channel Structure constructed to provide proper alignment of Pump with Diesel Engine or Pump with Motor.
- Compact skid Design with Small Foot-Print for Retrofit.
- High standard of Quality in material Construction finish and Workmanship.

## DIESEL DRIVEN SKIDS

MENA maintains its standard with using it's proudly own listed & approved Black Stallion Diesel Engines and Centrifugal Fire Pumps to package Heavy Duty and High Quality Compact Skids.


Our Listed and Approved Fire Pumps can also be coupled with any other Listed Diesel Engine of any specific brand as per customers requirement.



## MOTOR DRIVEN SKIDS

MENA maintains its standard with using WEG which is High Efficiency Fire Pump Motors with our own Listed and Approved Centrifugal Fire Pumps to package Heavy Duty and High Quality Compact Skids.

Our Listed and Approved Fire Pumps can also be coupled with any other Listed Fire Pump Motors of any specific brand as per client requirement.

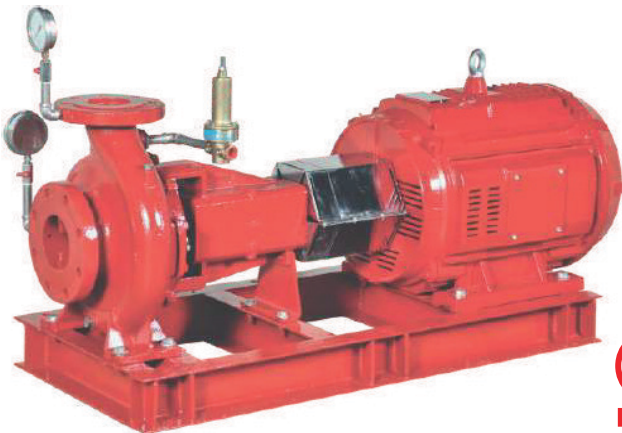


# END SUCTION -RANGE

## APPROVED UL LISTING RANGE

Rated Capacity, US GPM	Size, In.	Model	Pressure Rating, psi	Approx Speed RPM	Maximum Working Pressure Psi
50	2.5x1.5	VES 40-250	101 - 142	2900	200
50	2.5x1.5	VES 40-250	144 - 207	3500	290
100	2.5x1.5	VES 40-250	97 - 140	2900	200
100	2.5x1.5	VES 40-250	140 - 203	3500	290
150	2.5x1.5	VES 40-250	87 - 131	2900	200
150	2.5x1.5	VES 40-250	133 - 196	3500	290
150	3x2	VES 50-250	104 - 147	2980	225
150	3x2	VES 50-250	144 - 202	3500	290
200	3x2	VES 50-250	101 - 145	2980	225
200	3x2	VES 50-250	140 - 200	3500	290
250	3x2	VES 50-250	97 - 140	2980	225
250	3x2	VES 50-250	136 - 196	3500	290
250	4x2.5	VES 65-250	91 - 143	2900	225
250	4x2.5	VES 65-250	131 - 207	3500	290
300	4x2.5	VES 65-250	89 - 142	2900	225
300	4x2.5	VES 65-250	130 - 206	3500	290
400	4x2.5	VES 65-250	82 - 137	2900	225
400	4x2.5	VES 65-250	125 - 203	3500	290
400	5x3	VES 80-200	89 - 141	3500	225
400	5x3	VES 80-250	88 - 140	2900	225
400	5x3	VES 80-250	128 - 207	3500	290
450	5x3	VES 80-200	86 - 139	3500	225
450	5x3	VES 80-250	86 - 140	2900	225
450	5x3	VES 80-250	127 - 206	3500	290
450	5x3	VES 80-315	131 - 207	2900	290
450	5x4	VES 100-200	88 - 143	3500	225
450	5x4	VES 100-250	83 - 135	2900	290
450	5x4	VES 100-250	123 - 198	3500	290
450	5x4	VES 100-315	133 - 210	2900	290
450	5x4	VES 100-315	140 - 222	2980	290
500	5x3	VES 80-200	83 - 136	3500	225
500	5x3	VES 80-250	84 - 139	2900	225
500	5x3	VES 80-250	125 - 205	3500	290
500	5x3	VES 80-315	127 - 204	2900	290
500	5x4	VES 100-200	88 - 141	3500	225
500	5x4	VES 100-250	83 - 134	2900	290
500	5x4	VES 100-250	122 - 198	3500	290
500	5x4	VES 100-315	132 - 209	2900	290
500	5x4	VES 100-315	139 - 221	2980	290
500	6x4	VESD 150-100-200	116 - 142	3500	225
500	6x4	VESD 150-100-315	119 - 192	2900	250
750	5x4	VES 100-200	82 - 138	3500	225
750	5x4	VES 100-250	74 - 128	2900	290
750	5x4	VES 100-250	115 - 191	3500	290
750	5x4	VES 100-315	125 - 202	2900	290
750	5x4	VES 100-315	133 - 214	2980	290
750	6x4	VESD 150-100-200	112 - 137	3500	225
750	6x4	VESD 150-100-315	113 - 186	2900	250
1000	6x4	VESD 150-100-200	99 - 128	3500	225
1000	6x4	VESD 150-100-315	101 - 173	2900	250

LISTING RANGE



	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

**ELECTRIC PUMP  
ELECTRIC MOTOR SPECS**

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# ECHTOP<sup>®</sup>



## MOTOR

*New! Fire Pump Motor Ready*

SHANGHAI TOP MOTOR CO.,LTD.

SHANGHAI HALOTOP IMPORT & EXPORT CO., LTD.  
GLOBAL POWER ENGINEERING CO. LTD.




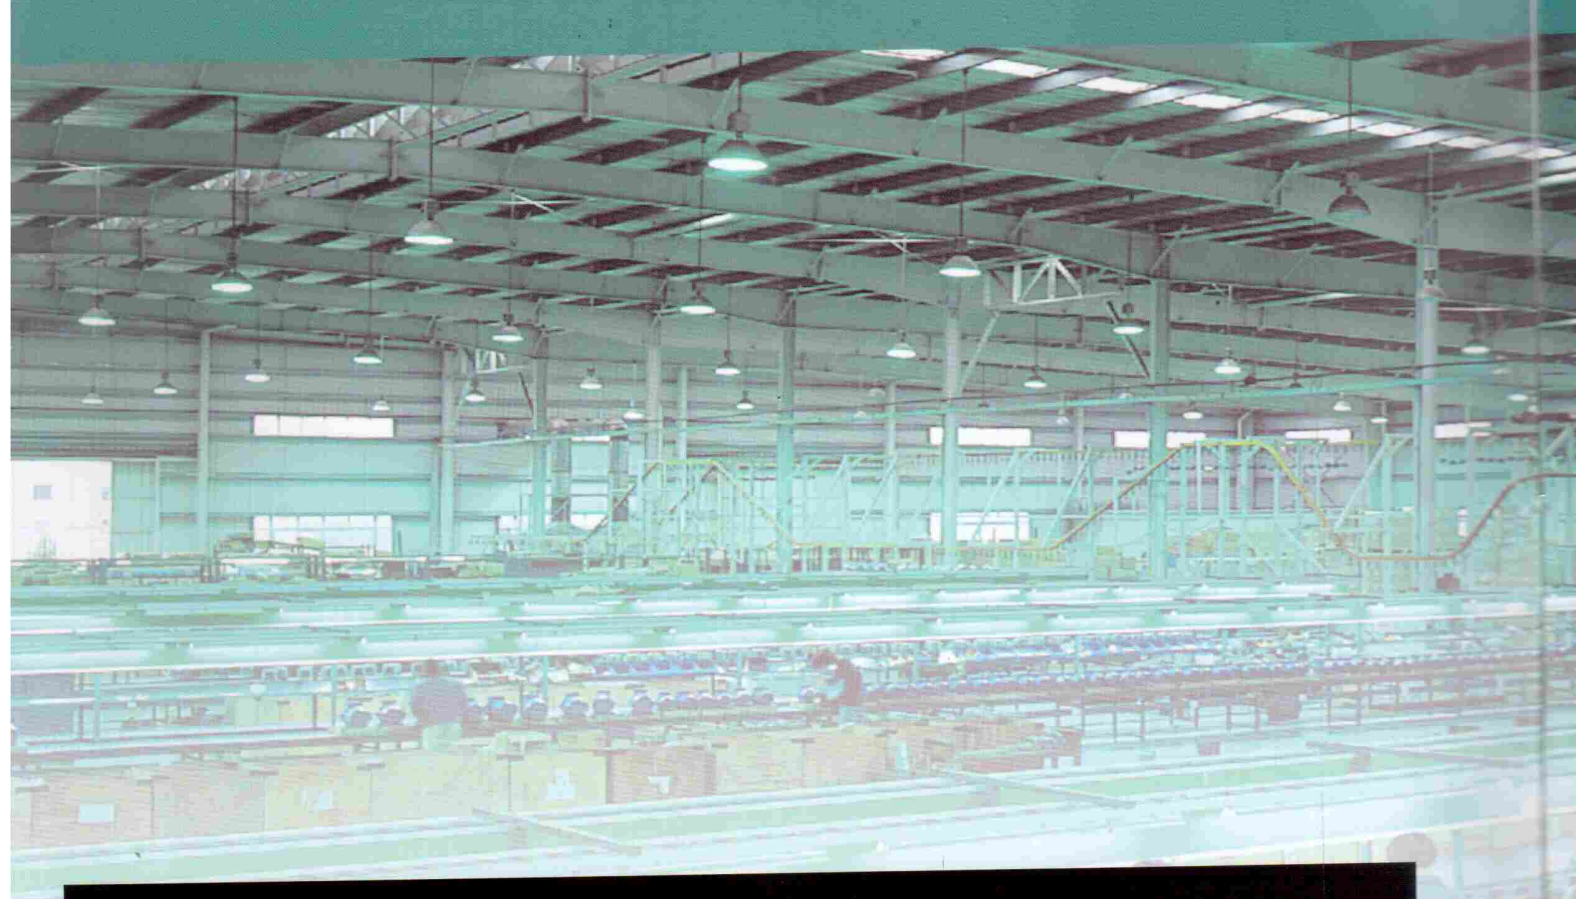

## **WORKSHOP & TECHNOLOGY**

TECHTOP adopts computerized machine tools for metal parts; four cylinder oil hydraulic presses for stator stacking; vacuum high-pressure varnishing units for stator varnishing; clean-dry and auto-phosphorescing machines for motor housing, end shield, fan cover and other parts; electrostatic spraying-water screen-suspending line complexes for product surface painting.


 **TECHTOP**<sup>®</sup>

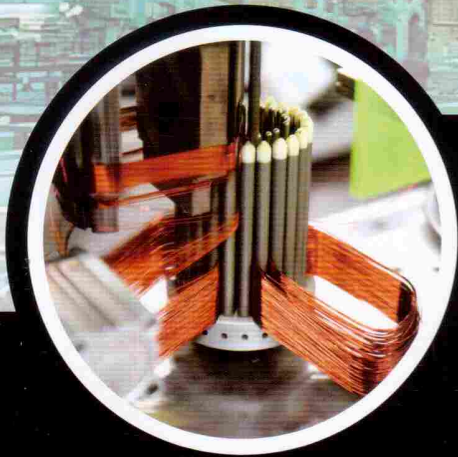


# Various Certificates



ISO9001

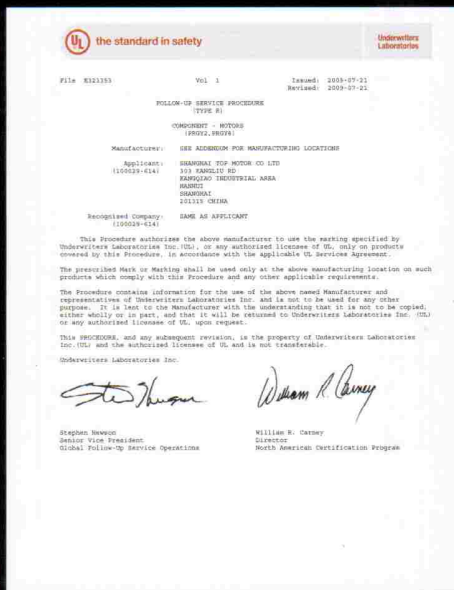


UL

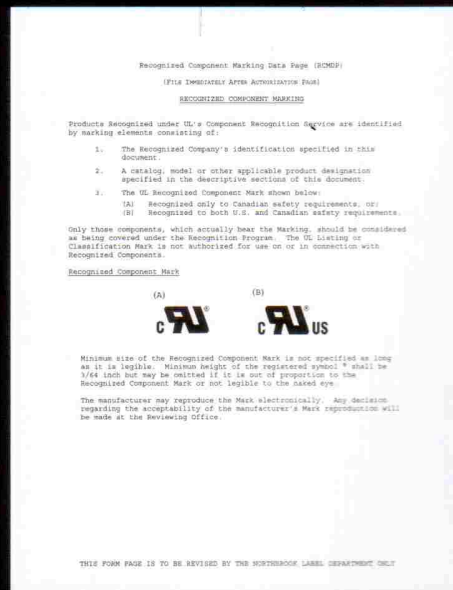



# Motor Spare Part List "Exploded Drawing"

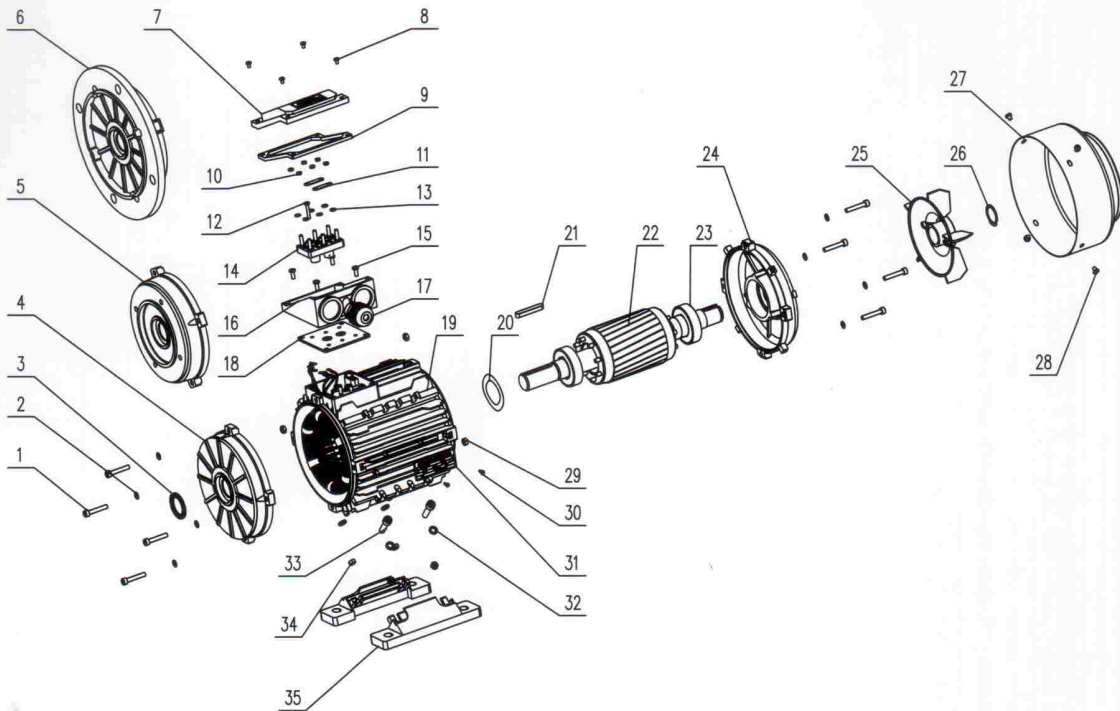

- |                              |                     |                            |
|------------------------------|---------------------|----------------------------|
| 1.screw                      | 13.Terminal shim    | 25.Cooling fan             |
| 2.Gasket                     | 14.Terminal board   | 26.Fan circlip             |
| 3.V-ring                     | 15.TB fixing screws | 27.Fan cover               |
| 4.Front endshield            | 16.TB base          | 28.Fan cover fixing screws |
| 5.B14 flange                 | 17.Cable gland      | 29.Endshield fixing nut    |
| 6.B5 flange                  | 18.TB bottomgasket  | 30.Rivet                   |
| 7.TB cover                   | 19.Frame            | 31.Rivet                   |
| 8.TB fixing screws           | 20.Preload washer   | 32.Foot fixing gasket      |
| 9.TB upper gasket            | 21.Key              | 33.Foot fixing screws      |
| 10.Terminal board fixing nut | 22.Rotor            | 34.Foot fixing nut         |
| 11.Terminal bridge           | 23.Bearing          | 35.Foot                    |
| 12.Terminal pin              | 24.NDE endshield    |                            |



## Serie Fire Pump Motors' Main Performance Parameters (IEC)

Serial NO.	Model NO.	Volts	Output (KW)	Output (HP)	Hz /DC	Locked current A(standard) 400V	Locked torque multiple (standard)	Maximum torque multiple (standard)	Minimum torque multiple (standard)	INS class	RPM	The test environment temperature
1	T 801-2	380-415V	0.75	1.0	50	19.0	175	250	120	F	2848	50°C
2	T 802-2	380-415V	1.1	1.5	50	25.7	175	250	120	F	2846	50°C
3	T 803-2	380-415V	1.5	2.0	50	32.3	170	240	120	F	2852	50°C
4	T 90S-2	380-415V	1.5	2.0	50	32.3	170	240	120	F	2852	50°C
5	T 90L1-2	380-415V	2.2	3.0	50	40.9	160	230	110	F	2845	50°C
6	T 90L2-2	380-415V	3	4.0	50	49.4	155	220	105	F	2851	50°C
7	T 100L-2	380-415V	3	4.0	50	49.4	155	220	105	F	2851	50°C
8	T 100L2-2	380-415V	4	5.5	50	61.8	145	215	105	F	2910	50°C
9	T 112M-2	380-415V	4	5.5	50	61.8	145	215	105	F	2910	50°C
10	T 112L-2	380-415V	5.5	7.5	50	79.8	140	200	100	F	2905	50°C
11	T 132S1-2	380-415V	5.5	7.5	50	79.8	140	200	100	F	2905	50°C
12	T 132S2-2	380-415V	7.5	10.0	50	101.7	135	200	100	F	2910	50°C
13	T 132M1-2	380-415V	9.2	12.0	50	118.8	130	200	100	F	2910	50°C
14	T 132M2-2	380-415V	11	15.0	50	146.3	130	200	100	F	2920	50°C
15	T 160M1-2	380-415V	11	15.0	50	146.3	130	200	100	F	2920	50°C
16	T 160M2-2	380-415V	15	20.0	50	184.3	130	200	100	F	2918	50°C
17	T 160L-2	380-415V	18.5	25.0	50	230.9	130	200	100	F	2922	50°C
18	T 180M-2	380-415V	22	30.0	50	274.6	130	200	100	F	2930	50°C
19	T 200L1-2	380-415V	30	40.0	50	367.7	125	200	100	F	2925	50°C
20	T 200L2-2	380-415V	37	50.0	50	457.9	120	200	100	F	2930	50°C
21	T 225M-2	380-415V	45	60.0	50	549.1	120	200	100	F	2930	50°C
22	T 250M-2	380-415V	55	75.0	50	685.9	105	200	95	F	2940	50°C
23	T 280S-2	380-415V	75	100.0	50	916.8	105	200	95	F	2940	50°C
24	T 280M-2	380-415V	90	125.0	50	1146.7	100	200	90	F	2940	50°C
25	T 315S-2	380-415V	110	150.0	50	1369.0	100	200	90	F	2940	50°C
26	T 315M-2	380-415V	132	175.0	50	1599.8	100	200	90	F	2940	50°C
27	T 315L1 -2	380-415V	160	215.0	50	1900.0	90	175	65	F	2945	50°C
28	T 315L2 -2	380-415V	200	270.0	50	2636.3	70	175	65	F	2945	50°C
29	T 355M-2	380-415V	250	330.0	50	3125.5	70	175	65	F	2945	50°C
30	T 355L-2	380-415V	315	420.0	50	4075.5	70	175	65	F	2945	50°C
31	T 802-4	380-415V	0.75	1.0	50	19.0	275	300	190	F	1420	50°C
32	T 803-4	380-415V	1.1	1.5	50	25.7	250	280	175	F	1425	50°C
33	T 90S-4	380-415V	1.1	1.5	50	25.7	250	280	175	F	1425	50°C
34	T 90L-4	380-415V	1.5	2.0	50	32.3	235	270	165	F	1420	50°C
35	T 90L2-4	380-415V	2.2	3.0	50	40.9	215	250	150	F	1430	50°C
36	T 100L1-4	380-415V	2.2	3.0	50	40.9	215	250	150	F	1430	50°C
37	T 100L2-4	380-415V	3	4.0	50	49.4	200	230	140	F	1430	50°C
38	T 100L3-4	380-415V	4	5.5	50	61.8	180	225	130	F	1435	50°C
39	T 112M-4	380-415V	4	5.5	50	61.8	180	225	130	F	1435	50°C
40	T 112L-4	380-415V	5.5	7.5	50	79.8	175	215	120	F	1430	50°C
41	T 132S-4	380-415V	5.5	7.5	50	79.8	175	215	120	F	1430	50°C
42	T 132M-4	380-415V	7.5	10.0	50	101.7	165	200	115	F	1430	50°C
43	T 132L1-4	380-415V	9.2	12.0	50	118.8	160	200	115	F	1430	50°C
44	T 132L2-4	380-415V	11	15.0	50	146.3	160	200	110	F	1440	50°C
45	T 160M-4	380-415V	11	15.0	50	146.3	160	200	110	F	1440	50°C
46	T 160L-4	380-415V	15	20.0	50	184.3	150	200	105	F	1445	50°C
47	T 180M-4	380-415V	18.5	25.0	50	230.9	150	200	105	F	1445	50°C
48	T 180L-4	380-415V	22	30.0	50	274.6	150	200	105	F	1460	50°C
49	T 200L-4	380-415V	30	40.0	50	367.7	140	200	100	F	1460	50°C
50	T 225S-4	380-415V	37	50.0	50	457.9	140	200	100	F	1470	50°C



## Serie Fire Pump Motors' Main Performance Parameters (IEC)

Serial NO.	Model NO.	Volts	Output (KW)	Output (HP)	Hz /DC	Locked current A(standard) 400V	Locked torque multiple (standard)	Maximum torque multiple (standard)	Minimum torque multiple (standard)	INS class	RPM	The test environment temperature
51	T 225M-4	380-415V	45	60.0	50	549.1	140	200	100	F	1480	50°C
52	T 250M-4	380-415V	55	75.0	50	685.9	140	200	100	F	1480	50°C
53	T 280S-4	380-415V	75	100.0	50	916.8	125	200	100	F	1480	50°C
54	T 280M-4	380-415V	90	125.0	50	1146.7	110	200	100	F	1480	50°C
55	T 315S-4	380-415V	110	150.0	50	1369.0	110	200	100	F	1480	50°C
56	T 315M-4	380-415V	132	175.0	50	1599.8	100	200	90	F	1480	50°C
57	T 315L1-4	380-415V	160	215.0	50	1900.0	90	175	75	F	1480	50°C
58	T 315L2-4	380-415V	200	270.0	50	2636.3	80	175	75	F	1480	50°C
59	T 355M1-4	380-415V	220	300.0	50	2874.7	80	175	75	F	1480	50°C
60	T 355M2-4	380-415V	250	330.0	50	3125.5	80	175	75	F	1480	50°C
61	T 355L1-4	380-415V	280	375.0	50	3604.3	80	175	75	F	1480	50°C
62	T 355L2-4	380-415V	315	420.0	50	4075.5	80	175	75	F	1480	50°C
63	T 355L3-4	380-415V	355	475.0	50	4563.8	80	175	75	F	1480	50°C
64	T 803-6	380-415V	0.75	1.0	50	19.0	170	265	120	F	935	50°C
65	T 90S-6	380-415V	0.75	1.0	50	19.0	170	265	120	F	935	50°C
66	T 90L-6	380-415V	1.1	1.5	50	25.7	165	250	115	F	935	50°C
67	T 100L-6	380-415V	1.5	2.0	50	32.3	160	240	110	F	940	50°C
68	T 112M-6	380-415V	2.2	3.0	50	40.9	155	230	110	F	940	50°C
69	T 112M1-6	380-415V	3	4.0	50	49.4	150	220	105	F	940	50°C
70	T 112M2-6	380-415V	4	5.5	50	61.8	150	215	105	F	940	50°C
71	T 132S-6	380-415V	3	4.0	50	49.4	150	220	105	F	940	50°C
72	T 132M1-6	380-415V	4	5.5	50	61.8	150	215	105	F	945	50°C
73	T 132M2-6	380-415V	5.5	7.5	50	79.8	150	205	105	F	945	50°C
74	T 132M3-6	380-415V	7.5	10.0	50	101.7	150	200	105	F	945	50°C
75	T 160M-6	380-415V	7.5	10.0	50	101.7	150	200	105	F	955	50°C
76	T 160L-6	380-415V	11	15.0	50	146.3	140	200	100	F	960	50°C
77	T 180L-6	380-415V	15	20.0	50	184.3	135	200	100	F	960	50°C
78	T 200L1-6	380-415V	18.5	25.0	50	230.9	135	200	100	F	965	50°C
79	T 200L2-6	380-415V	22	30.0	50	274.6	135	200	100	F	965	50°C
80	T 225M-6	380-415V	30	40.0	50	367.7	135	200	100	F	975	50°C
81	T 250M-6	380-415V	37	50.0	50	457.9	135	200	100	F	975	50°C
82	T 280S-6	380-415V	45	60.0	50	549.1	135	200	100	F	980	50°C
83	T 280M-6	380-415V	55	75.0	50	685.9	135	200	100	F	980	50°C
84	T 315S-6	380-415V	75	100.0	50	916.8	125	200	100	F	980	50°C
85	T 315M-6	380-415V	90	125.0	50	1146.7	125	200	100	F	980	50°C
86	T 315L1-6	380-415V	110	150.0	50	1369.0	120	200	100	F	980	50°C
87	T 315L2-6	380-415V	132	175.0	50	1599.8	120	200	100	F	980	50°C
88	T 355M1-6	380-415V	160	215.0	50	1900.0	100	175	90	F	980	50°C
89	T 355M2-6	380-415V	200	270.0	50	2636.3	100	175	90	F	980	50°C
90	T 355L1-6	380-415V	220	300.0	50	2874.7	100	175	90	F	980	50°C
91	T 355L2-6	380-415V	250	330.0	50	3125.5	100	175	90	F	980	50°C



## DC Serie Fire Pump Motors' Main Performance Parameters(NEMA 415V 50HZ)

Serial NO.	Model NO.	Volts	Output (HP)	Hz /DC	Locked current A(standard) 415V	Locked torque multiple (standard)	Maximum torque multiple (standard)	Minimum torque multiple (standard)	Service factor	INS class	RPM	The test environment temperature
1	TDC254T15U2B	380-415V	15	50	141	130	200	100	1.15	F	2920	50°C
2	TDC256T20U2B	380-415V	20	50	177	130	200	100	1.15	F	2920	50°C
3	TDC284TS25U2B	380-415V	25	50	222	130	200	100	1.15	F	2930	50°C
4	TDC286TS30U2B	380-415V	30	50	264	130	200	100	1.15	F	2930	50°C
5	TDC324TS40U2B	380-415V	40	50	354	125	200	100	1.15	F	2930	50°C
6	TDC326TS50U2B	380-415V	50	50	441	120	200	100	1.15	F	2930	50°C
7	TDC364TS60U2B	380-415V	60	50	529	120	200	100	1.15	F	2930	50°C
8	TDC365TS75U2B	380-415V	75	50	661	105	200	95	1.15	F	2940	50°C
9	TDC405TS100U2B	380-415V	100	50	883	105	200	95	1.15	F	2940	50°C
10	TDC444TS125U2B	380-415V	125	50	1105	100	200	90	1.15	F	2940	50°C
11	TDC445TS150U2B	380-415V	150	50	1319	100	200	90	1.15	F	2940	50°C
12	TDC 254T15U4B	380-415V	15	50	141	160	200	110	1.15	F	1440	50°C
13	TDC 256T20U4B	380-415V	20	50	177	150	200	105	1.15	F	1445	50°C
14	TDC 284T25U4B	380-415V	25	50	222	150	200	105	1.15	F	1450	50°C
15	TDC 286T30U4B	380-415V	30	50	264	150	200	105	1.15	F	1460	50°C
16	TDC 324T40U4B	380-415V	40	50	354	140	200	100	1.15	F	1460	50°C
17	TDC 326T50U4B	380-415V	50	50	441	140	200	100	1.15	F	1470	50°C
18	TDC364T60U4B	380-415V	60	50	529	140	200	100	1.15	F	1480	50°C
19	TDC365T75U4B	380-415V	75	50	661	140	200	100	1.15	F	1480	50°C
20	TDC405T100U4B	380-415V	100	50	883	125	200	100	1.15	F	1480	50°C
21	TDC444T125U4B	380-415V	125	50	1105	110	200	100	1.15	F	1480	50°C
22	TDC445T150U4B	380-415V	150	50	1319	110	200	100	1.15	F	1480	50°C
23	TDC 254T7.5U6B	380-415V	7.5	50	77	150	200	105	1.15	F	955	50°C
24	TDC 256T10U6B	380-415V	10	50	98	150	200	105	1.15	F	960	50°C
25	TDC 284T15U6B	380-415V	15	50	141	140	200	100	1.15	F	960	50°C
26	TDC 286T20U6B	380-415V	20	50	177	135	200	100	1.15	F	965	50°C
27	TDC 324T25U6B	380-415V	25	50	222	135	200	100	1.15	F	965	50°C
28	TDC 326T30U6B	380-415V	30	50	264	135	200	100	1.15	F	975	50°C
29	TDC364T40U6B	380-415V	40	50	354	135	200	100	1.15	F	975	50°C
30	TDC365T50U6B	380-415V	50	50	441	135	200	100	1.15	F	980	50°C
31	TDC404T60U6B	380-415V	60	50	529	135	200	100	1.15	F	980	50°C
32	TDC405T75U6B	380-415V	75	50	661	135	200	100	1.15	F	980	50°C
33	TDC444T100U6B	380-415V	100	50	883	125	200	100	1.15	F	980	50°C
34	TDC445T125U6B	380-415V	125	50	1105	125	200	100	1.15	F	980	50°C



## DC Serie Fire Pump Motors' Main Performance Parameters(NEMA ODP 208~230/460V 60HZ)

Serial NO.	Model NO.	Volts	Output (HP)	Hz /DC	Locked current A(standard) 460V	Locked torque multiple (standard)	Maximum torque multiple (standard)	Minimum torque multiple (standard)	Service factor	INS class	RPM	The test environment temperature
1	TDC254T15U2B	208~230/460V	15	60	116.0	130	200	100	1.15	F	3504	50°C
2	TDC256T20U2B	208~230/460V	20	60	145.0	130	200	100	1.15	F	3504	50°C
3	TDC284TS25U2B	208~230/460V	25	60	182.5	130	200	100	1.15	F	3516	50°C
4	TDC286TS30U2B	208~230/460V	30	60	217.5	130	200	100	1.15	F	3516	50°C
5	TDC324TS40U2B	208~230/460V	40	60	290.0	125	200	100	1.15	F	3516	50°C
6	TDC326TS50U2B	208~230/460V	50	60	362.5	120	200	100	1.15	F	3516	50°C
7	TDC364TS60U2B	208~230/460V	60	60	435.0	120	200	100	1.15	F	3516	50°C
8	TDC365TS75U2B	208~230/460V	75	60	542.5	105	200	95	1.15	F	3528	50°C
9	TDC405TS100U2B	208~230/460V	100	60	725.0	105	200	95	1.15	F	3528	50°C
10	TDC444TS125U2B	460V	125	60	907.5	100	200	90	1.15	F	3528	50°C
11	TDC445TS150U2B	460V	150	60	1085.0	100	200	90	1.15	F	3528	50°C
12	TDC 254T15U4B	208~230/460V	15	60	116.0	160	200	110	1.15	F	1728	50°C
13	TDC 256T20U4B	208~230/460V	20	60	145.0	150	200	105	1.15	F	1734	50°C
14	TDC 284T25U4B	208~230/460V	25	60	182.5	150	200	105	1.15	F	1740	50°C
15	TDC 286T30U4B	208~230/460V	30	60	217.5	150	200	105	1.15	F	1752	50°C
16	TDC 324T40U4B	208~230/460V	40	60	290.0	140	200	100	1.15	F	1752	50°C
17	TDC 326T50U4B	208~230/460V	50	60	362.5	140	200	100	1.15	F	1764	50°C
18	TDC364T60U4B	208~230/460V	60	60	435.0	140	200	100	1.15	F	1776	50°C
19	TDC365T75U4B	208~230/460V	75	60	542.5	140	200	100	1.15	F	1776	50°C
20	TDC405T100U4B	208~230/460V	100	60	725.0	125	200	100	1.15	F	1776	50°C
21	TDC444T125U4B	460V	125	60	907.5	110	200	100	1.15	F	1776	50°C
22	TDC445T150U4B	460V	150	60	1085.0	110	200	100	1.15	F	1776	50°C
23	TDC 254T7.5U6B	208~230/460V	7.5	60	63.5	150	200	105	1.15	F	1146	50°C
24	TDC 256T10U6B	208~230/460V	10	60	81.0	150	200	105	1.15	F	1152	50°C
25	TDC 284T15U6B	208~230/460V	15	60	116.0	140	200	100	1.15	F	1152	50°C
26	TDC 286T20U6B	208~230/460V	20	60	145.0	135	200	100	1.15	F	1158	50°C
27	TDC 324T25U6B	208~230/460V	25	60	182.5	135	200	100	1.15	F	1158	50°C
28	TDC 326T30U6B	208~230/460V	30	60	217.5	135	200	100	1.15	F	1170	50°C
29	TDC364T40U6B	208~230/460V	40	60	290.0	135	200	100	1.15	F	1170	50°C
30	TDC365T50U6B	208~230/460V	50	60	362.5	135	200	100	1.15	F	1176	50°C
31	TDC404T60U6B	208~230/460V	60	60	435.0	135	200	100	1.15	F	1176	50°C
32	TDC405T75U6B	208~230/460V	75	60	542.5	135	200	100	1.15	F	1176	50°C
33	TDC444T100U6B	208~230/460V	100	60	725.0	125	200	100	1.15	F	1176	50°C
34	TDC445T125U6B	460V	125	60	907.5	125	200	100	1.15	F	1176	50°C



## XC Serie Fire Pump Motors' Main Performance Parameters (NEMA ODP 208~230/460V 60HZ)

Serial NO.	Model NO.	Volts	Output (HP)	Hz /DC	Locked current A(standard) 460V	Locked torque multiple (standard)	Maximum torque multiple (standard)	Minimum torque multiple (standard)	Service factor	INS class	RPM	The test environment temperature
1	TXC 143T1U2B	208~230/460V	1	60	15	175	250	120	1.15	F	3450	50°C
2	TXC 143T1.5U2B	208~230/460V	1.5	60	20	175	250	120	1.15	F	3450	50°C
3	TXC 145T2U2B	208~230/460V	2	60	25	170	240	120	1.15	F	3450	50°C
4	TXC 182T3U2B	208~230/460V	3	60	32	160	230	110	1.15	F	3510	50°C
5	TXC 184T5U2B	208~230/460V	5	60	46	150	215	105	1.15	F	3510	50°C
6	TXC 213T7.5U2B	208~230/460V	7.5	60	63.5	140	200	100	1.15	F	3520	50°C
7	TXC 215T10U2B	208~230/460V	10	60	81	135	200	100	1.15	F	3520	50°C
8	TXC 254T15U2B	208~230/460V	15	60	116	130	200	100	1.15	F	3540	50°C
9	TXC 256T20U2B	208~230/460V	20	60	145	130	200	100	1.15	F	3540	50°C
10	TXC 284TS25U2B	208~230/460V	25	60	182.5	130	200	100	1.15	F	3550	50°C
11	TXC 286TS30U2B	208~230/460V	30	60	217.5	130	200	100	1.15	F	3550	50°C
12	TXC 324TS40U2B	208~230/460V	40	60	290	125	200	100	1.15	F	3560	50°C
13	TXC 326TS50U2B	208~230/460V	50	60	362.5	120	200	100	1.15	F	3560	50°C
14	TXC364TS60U2B	208~230/460V	60	60	435	120	200	100	1.15	F	3560	50°C
15	TXC365TS75U2B	208~230/460V	75	60	542.5	105	200	95	1.15	F	3560	50°C
16	TXC405TS100U2B	208~230/460V	100	60	725	105	200	95	1.15	F	3570	50°C
17	TXC444TS125U2B	460	125	60	907.5	100	200	90	1.15	F	3575	50°C
18	TXC445TS150U2B	460	150	60	1085	100	200	90	1.15	F	3575	50°C
19	TXC447TS200U2B	460	200	60	1450	100	200	90	1.15	F	3575	50°C
20	TXC449TS250U2B	460	250	60	1825	70	175	65	1.15	F	3575	50°C
21	TXC 143T1U4B	208~230/460V	1	60	15	275	300	190	1.15	F	1730	50°C
22	TXC 145T1.5U4B	208~230/460V	1.5	60	20	250	280	175	1.15	F	1730	50°C
23	TXC 145T2U4B	208~230/460V	2	60	25	235	270	165	1.15	F	1730	50°C
24	TXC 182T3U4B	208~230/460V	3	60	32	215	250	150	1.15	F	1735	50°C
25	TXC 184T5U4B	208~230/460V	5	60	46	185	225	130	1.15	F	1735	50°C
26	TXC 213T7.5U4B	208~230/460V	7.5	60	63.5	175	215	120	1.15	F	1740	50°C
27	TXC 215T10U4B	208~230/460V	10	60	81	165	200	115	1.15	F	1740	50°C
28	TXC 254T15U4B	208~230/460V	15	60	116	160	200	110	1.15	F	1750	50°C
29	TXC 256T20U4B	208~230/460V	20	60	145	150	200	105	1.15	F	1750	50°C
30	TXC 284T25U4B	208~230/460V	25	60	182.5	150	200	105	1.15	F	1760	50°C
31	TXC 286T30U4B	208~230/460V	30	60	217.5	150	200	105	1.15	F	1760	50°C
32	TXC 324T40U4B	208~230/460V	40	60	290	140	200	100	1.15	F	1770	50°C
33	TXC 326T50U4B	208~230/460V	50	60	362.5	140	200	100	1.15	F	1770	50°C
34	TXC364T60U4B	208~230/460V	60	60	435	140	200	100	1.15	F	1775	50°C
35	TXC365T75U4B	208~230/460V	75	60	542.5	140	200	100	1.15	F	1775	50°C
36	TXC405T100U4B	208~230/460V	100	60	725	125	200	100	1.15	F	1780	50°C
37	TXC444T125U4B	460	125	60	907.5	110	200	100	1.15	F	1780	50°C
38	TXC445T150U4B	460	150	60	1085	110	200	100	1.15	F	1780	50°C
39	TXC447T200U4B	460	200	60	1450	100	200	90	1.15	F	1780	50°C
40	TXC449T250U4B	460	250	60	1825	80	175	75	1.15	F	1780	50°C
41	TXC 145T1U6B	208~230/460V	1	60	15	170	265	120	1.15	F	1150	50°C
42	TXC 182T1.5U6B	208~230/460V	1.5	60	20	165	250	115	1.15	F	1150	50°C
43	TXC 184T2U6B	208~230/460V	2	60	25	160	240	110	1.15	F	1150	50°C
44	TXC 213T3U6B	208~230/460V	3	60	32	155	230	110	1.15	F	1150	50°C
45	TXC 215T5U6B	208~230/460V	5	60	46	150	215	105	1.15	F	1160	50°C
46	TXC 254T7.5U6B	208~230/460V	7.5	60	63.5	150	200	105	1.15	F	1160	50°C
47	TXC 256T10U6B	208~230/460V	10	60	81	150	200	105	1.15	F	1165	50°C
48	TXC 284T15U6B	208~230/460V	15	60	116	140	200	100	1.15	F	1165	50°C
49	TXC 286T20U6B	208~230/460V	20	60	145	135	200	100	1.15	F	1170	50°C
50	TXC 324T25U6B	208~230/460V	25	60	182.5	135	200	100	1.15	F	1170	50°C
51	TXC 326T30U6B	208~230/460V	30	60	217.5	135	200	100	1.15	F	1175	50°C
52	TXC364T40U6B	208~230/460V	40	60	290	135	200	100	1.15	F	1175	50°C
53	TXC365T50U6B	208~230/460V	50	60	362.5	135	200	100	1.15	F	1180	50°C
54	TXC404T60U6B	208~230/460V	60	60	435	135	200	100	1.15	F	1180	50°C
55	TXC405T75U6B	208~230/460V	75	60	542.5	135	200	100	1.15	F	1180	50°C
56	TXC444T100U6B	208~230/460V	100	60	725	125	200	100	1.15	F	1180	50°C
57	TXC445T125U6B	460	125	60	907.5	125	200	100	1.15	F	1180	50°C
58	TXC447T150U6B	460	150	60	1085	120	200	100	1.15	F	1180	50°C
59	TXC449T200U6B	460	200	60	1450	120	200	100	1.15	F	1180	50°C



## TECHNICAL DATA

### PRODUCT FEATURES

Model	<b>F-TDC447TS200U2B</b>		
Standard	<b>NEMA MG-1</b>	Output rating	<b>200 HP</b>
Frequency	<b>60 Hz</b>	Mounting	<b>Foot-mounted</b>
Voltage	<b>380-400 V</b>	Flange	<b>Without</b>
Number of poles	<b>2</b>	Mounting	<b>F-1</b>
Degree of Protection	<b>IP23</b>	Terminal box <sup>1</sup>	<b>Left position</b>
Synchronous speed	<b>3600 rpm</b>	Enclosure	<b>IC01 - ODP</b>

### PRODUCT DETAILS

Frame	<b>447TS</b>	Frequency	<b>60 Hz</b>
Output	<b>200 HP (150 kW)</b>	Number of Poles	<b>2</b>
Slip	<b>0.0083</b>	Rated speed	<b>3570 rpm</b>
Rated voltage	<b>380-400 V</b>	Temperature rise	<b>80 K</b>
Rated current	<b>264.7-251.5 A</b>	Duty Cycle	<b>Cont.(S1)</b>
L. R. Amperes	<b>1770-1665 A</b>	Starting Method	<b>Wye-Delta</b>
LRC	<b>6.6x(Code G)</b>	Ambient temperature	<b>50°C</b>
No load current	<b>53-50 A</b>	Altitude	<b>1000 m.a.s.l.</b>
Rated torque	<b>294.35 ft.lb</b>	Noise level	<b>101 dB(A)</b>
Locked rotor torque	<b>100%</b>	Approx. weight	<b>1540 lb</b>
Breakdown torque	<b>200%</b>	Service factor	<b>1.15</b>
Locked rotor time	<b>30s (cold) 15s (hot)</b>	Design	<b>B</b>
Moment of inertia	<b>21.53 ft.lb<sup>2</sup></b>	Insulation Class	<b>F</b>
Efficiency/Power factor	Load	Efficiency	Power factor
	100%	<b>94.1</b>	<b>0.91</b>
	75%	<b>94.4</b>	<b>0.86</b>
	50%	<b>93.6</b>	<b>0.8</b>
Bearing	Drive-end	<b>6316C3</b>	
	Opposite drive-end	<b>6316C3</b>	




LISTED  
FIRE PUMP MOTOR  
EX26635




# PERFORMANCE CURVES

Torque Values	Torque (lb-ft)	Torque Values	Torque (lb-ft)
Locked Rotor Torque	<b>294.35</b>	Breakdown Torque	<b>588.70</b>
Pull-Up Torque	<b>264.92</b>	Full Load Torque	<b>294.35</b>

### Load Performance Curve

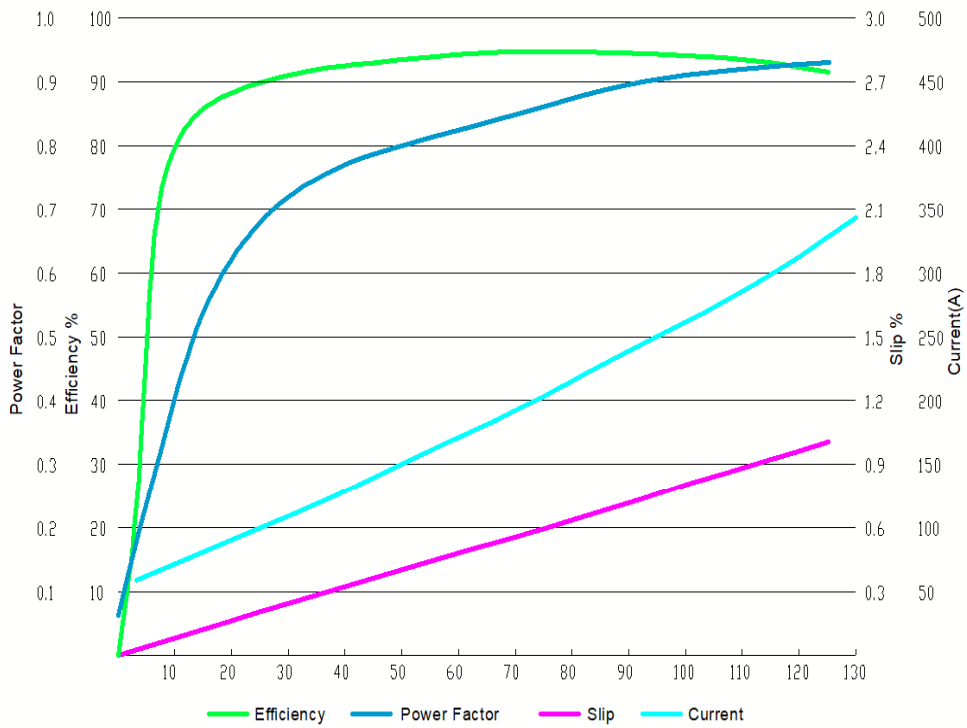





### Torque Speed(T-n)Curve

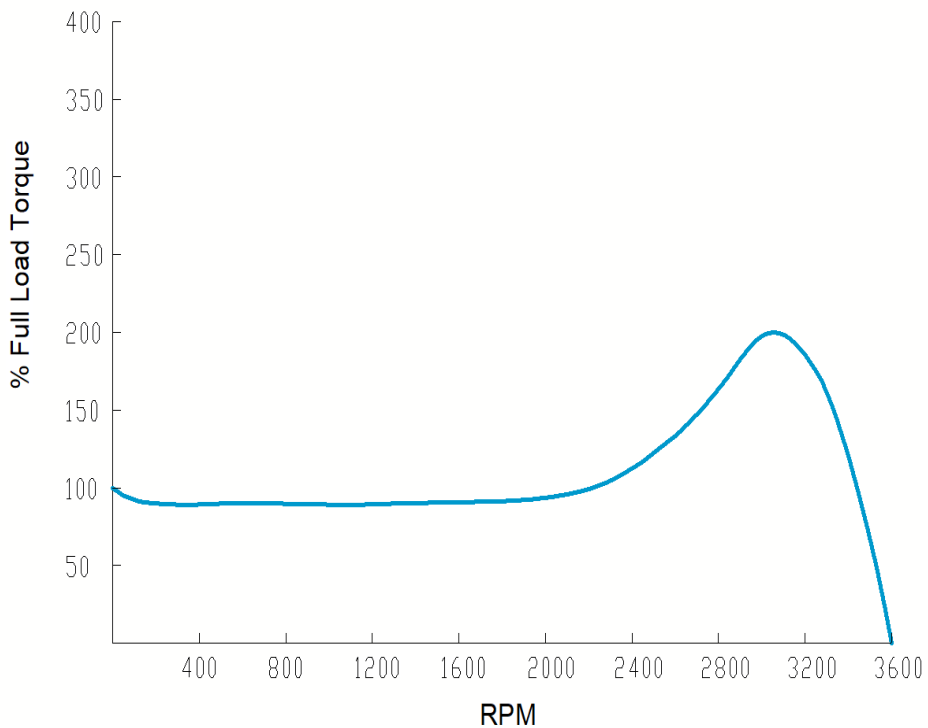




# DRAWINGS

Frame size	<b>447TS</b>	Frame Material	<b>Cast iron</b>
Poles	<b>2</b>	DWG NO	<b>CY232.A16.003</b>
Units	<b>Inch</b>		

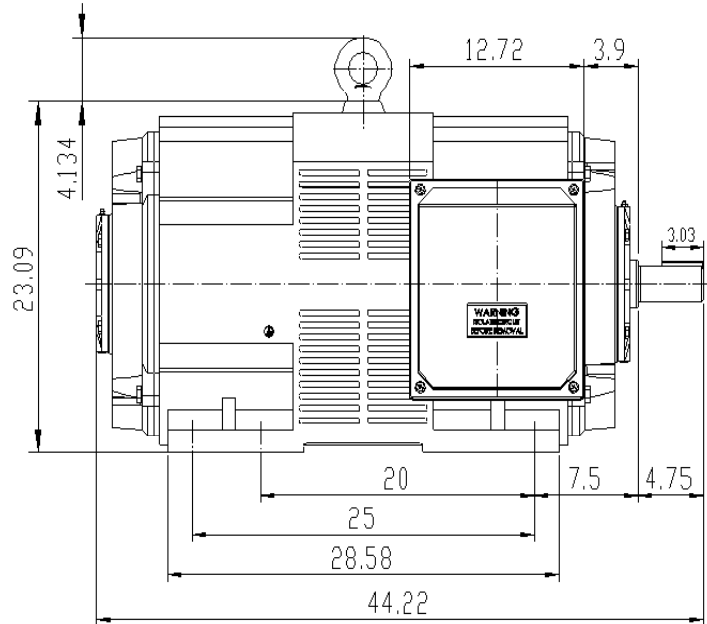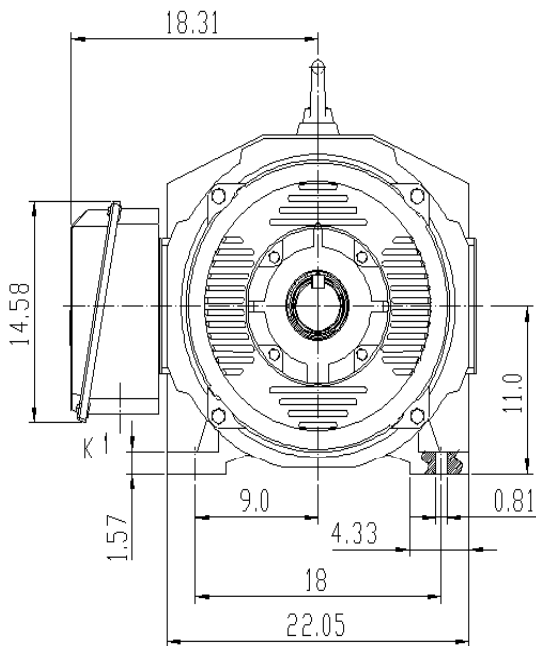

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## ELECTRIC PUMP CONTROLLER SPECIFICATIONS

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



# TORNATECH

Project: \_\_\_\_\_

Customer: \_\_\_\_\_

Engineer: \_\_\_\_\_

Pump Manufacturer: \_\_\_\_\_

## Technical Data Submittal Document

### GPx Series

Full Service

Electric Fire Pump Controller



#### Contents:

Data Sheets

Dimensional Data







Wiring Schematics

Field Connections

**Note:** The drawings included in this package are for controllers covered under our standard offering. Actual AS BUILT drawings may differ from what is shown in this package.



June 2022

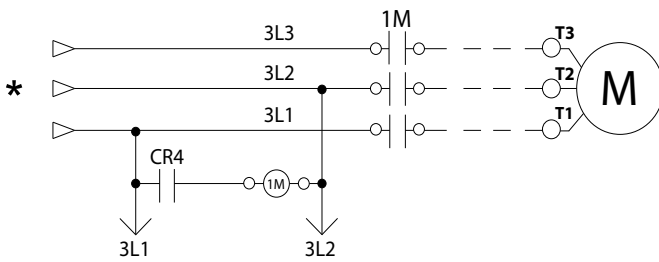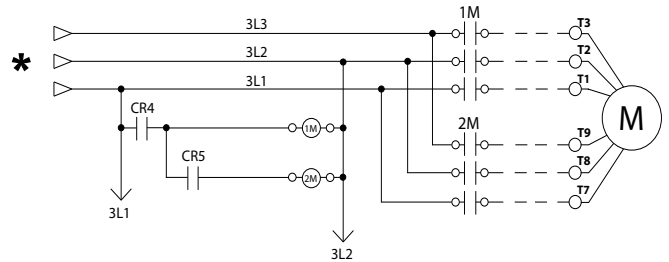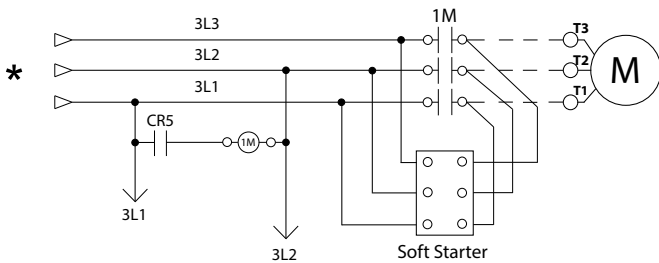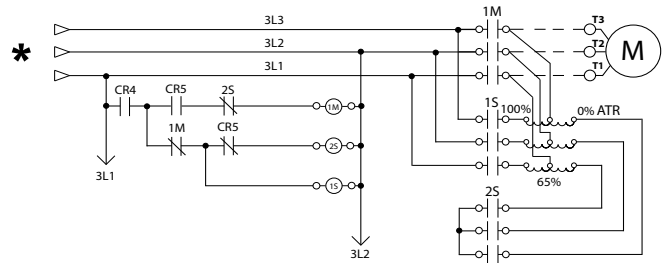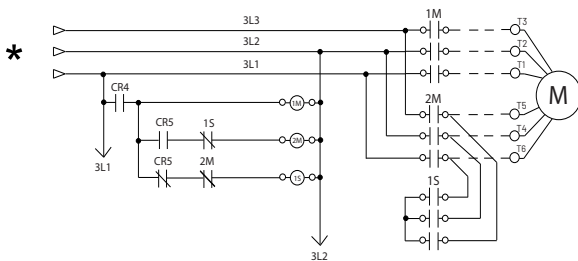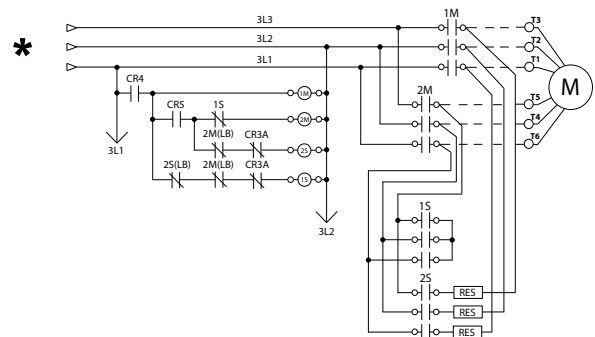**Select starting method**
**Model GPA**  
**Across the line**

**Model GPP**  
**Partwinding**

**Model GPS**  
**Soft Start Soft Stop**

**Model GPR**  
**Autotransformer**

**Model GPY**  
**Wye-Delta Open**

**Model GPW**  
**Wye-Delta Closed**


\*From normal incoming power through Disconnecting Means (IS/CB)





<b>Standard, Listings, Approvals and Certifications</b>	<b>Built to NFPA 20 (latest edition)</b>		
	<b>Underwriters Laboratory (UL)</b>	UL218 - Fire Pump Controllers	
	<b>FM Global</b>	Class 1321/1323	
	<b>New York City</b>	Accepted for use in the City of New York by the Department of Buildings	
	<b>CE Mark</b>	Various EN, IEC & CEE directives and standards	
	Built in Canada or U.A.E	Built in Europe	
	CE Mark Option	Supplied as Standard	
<b>Enclosure</b>	<b>Protection Rating</b>		
	Built in Canada or U.A.E	Built in Europe	
	<b>Standard: NEMA 2</b>	Standard: IP55	
	<b>Optional</b>		
	NEMA 12	NEMA 4X-304 sst painted	IP54
	NEMA 3	NEMA 4X-304 sst brushed finish	IP55
	NEMA 3R	NEMA 4X-316 sst painted	IP65
	NEMA 4	NEMA 4X-316 sst brushed finish	IP66
	<b>Accessories</b> • Bottom entry gland plate • Lifting Lugs • Keylock handle	<b>Paint Specifications</b> • Red RAL3002 • Powder coating • Glossy textured finish	

<b>Shortcircuit Withstand Rating</b>	<b>200V to 208V 60Hz</b>	<b>220V to 240V 60Hz</b>	<b>380V to 415V 50 Hz / 60Hz</b>	<b>440V to 480V 60Hz</b>	<b>575V to 600V 60Hz</b>
	<b>HP (kw)</b>				
<b>Standard 100kA</b>	5 - 150 (3.7 - 110)	5 - 200 (3.7 - 149)	5 - 300 (3.7 - 223)	5 - 400 (3.7 - 298)	N/A
<b>Optional 150kA</b>					
<b>Standard 50kA</b>	200 (149)	250 (186)	350 - 450 (261-335)	450 - 500 (335 - 373)	5 - 500 (3.7- 373)
<b>Optional 100kA</b>	N/A	N/A	350 - 500 (261 - 373)	450 - 500 (335 - 373)	
<b>Optional 200kA</b>	5 - 150 (3.7 - 110)	5 - 200 (3.7 - 149)	5 - 300 (3.7 - 223)	5 - 400 (3.7 - 298)	N/A

\*Please see Disconnecting Means details on page 4



<b>Ambient Temperature Rating</b>	<b>Standard:</b> 4°C to 40°C / 39°F to 104°F <b>Optional:</b> 4°C to 55°C / 39°F to 131°F Controllers built in Dubai, UAE (Tornatech FZE) are supplied standard with 55°C rating.
<b>Surge Suppression</b>	Surge arrestor rated to suppress surges above line voltage
<b>Disconnecting Means</b>	<ul style="list-style-type: none"> <li>• Isolating switch and circuit breaker assembly: <ul style="list-style-type: none"> <li>- Door interlocked in the ON position</li> <li>- Isolating switch rated not less than 115% of motor full load current</li> <li>- Circuit breaker continuous rating not less than 115% of motor full load current</li> <li>- Overcurrent sensing non-thermal type, magnetic only</li> <li>- Instantaneous trip setting of not more than 20 times the motor full load current</li> </ul> </li> <li>• Common flange mounted operating handle</li> </ul>
<b>Service Entrance Rating</b>	Suitable as service entrance equipment
<b>Emergency Start Handle</b>	<ul style="list-style-type: none"> <li>• Flange mounted</li> <li>• Pull and latch activation</li> <li>• Integrated limit switch</li> <li>• Across the line start (direct on line)</li> </ul>
<b>Locked Rotor Protector</b>	<ul style="list-style-type: none"> <li>• Operate shunt trip to open circuit breaker</li> <li>• Factory set at 600% of motor full load current</li> <li>• Trip between 8 and 20 seconds</li> </ul>
<b>Electrical Readings</b>	<ul style="list-style-type: none"> <li>• Voltage phase to phase (normal power)</li> <li>• Amperage of each phase when motor is running</li> </ul>
<b>Pressure Readings</b>	<ul style="list-style-type: none"> <li>• Continuous system pressure display</li> <li>• Cut-in and Cut-out pressure settings</li> </ul>
<b>Pressure and Event recorder</b>	<ul style="list-style-type: none"> <li>• Pressure readings with date stamp</li> <li>• Event recording with date stamp</li> <li>• Under regular maintained operation, events are stored in memory for the life of the controller.</li> <li>• Data viewable on operator interface display screen</li> <li>• Downloadable by USB port to external memory device</li> </ul>
<b>Pressure Sensing</b>	<ul style="list-style-type: none"> <li>• Pressure transducer and run test solenoid valve assembly for fresh water application</li> <li>• Pressure sensing line connection 1/2" Female NPT</li> <li>• Drain connection 3/8"</li> <li>• Rated for 0-500PSI working pressure (standard display at 0-300PSI)</li> <li>• Externally mounted with protective cover</li> </ul>



<b>Audible Alarm</b>	6" alarm bell - 85 dB at 10ft. (3m)		
<b>Visual Indications</b>	<ul style="list-style-type: none"> <li>• Power available</li> <li>• Motor run</li> <li>• Periodic test</li> <li>• Manual start</li> </ul>	<ul style="list-style-type: none"> <li>• Deluge valve start</li> <li>• Remote automatic start</li> <li>• Remote manual start</li> <li>• Emergency start</li> </ul>	<ul style="list-style-type: none"> <li>• Pump on demand/Automatic start</li> <li>• Pump room temperature (°F or °C)</li> <li>• Lockout</li> </ul>
<b>Visual &amp; Audible Alarms</b>	<p>Visual</p> <ul style="list-style-type: none"> <li>• Control voltage not healthy</li> <li>• Invalid cut-in</li> <li>• Lock rotor current</li> <li>• Loss of power</li> <li>• Low ambient temperature</li> <li>• Low water level</li> <li>• Motor trouble</li> <li>• Phase reversal (normal power)</li> </ul> <p>Visual and audible</p> <ul style="list-style-type: none"> <li>• Fail to start</li> </ul>		
<b>Remote Alarm Contacts</b>	<p>DPDT-8A-250V.AC</p> <ul style="list-style-type: none"> <li>• Power available</li> <li>• Phase reversal</li> <li>• Motor run</li> <li>• Common pump room alarm (field re-assignable)**               <ul style="list-style-type: none"> <li>• Overvoltage</li> <li>• Undervoltage</li> <li>• Phase unbalance</li> <li>• Low pump room temperature</li> <li>• High Pump room temperature</li> </ul> </li> <li>• Common motor trouble (field re-assignable)**               <ul style="list-style-type: none"> <li>• Overcurrent</li> <li>• Fail to start</li> <li>• Undercurrent</li> <li>• Ground fault</li> </ul> </li> <li>• Free (field programmable)**</li> </ul>		

\*\*Tornatech reserves the right to use any of these three alarm points for special specific application requirements.



<p><b>ViZiTouch V2 Operator Interface</b></p>	<ul style="list-style-type: none"> <li>• Embedded microcomputer with software PLC logic</li> <li>• 7.0" color touch screen (HMI technology)</li> <li>• Upgradable software</li> <li>• Multi-language</li> </ul>		
<p><b>Communication Protocol Capability</b></p>	<ul style="list-style-type: none"> <li>• Protocol: Modbus</li> <li>• Connection type: Shielded female connector RJ45</li> <li>• Frame Format: TCP/IP</li> <li>• Addresses: See bulletin MOD-GPx</li> </ul>		
<p><b>Operation</b></p>	<p><b>Automatic Start</b></p>	<ul style="list-style-type: none"> <li>• Start on pressure drop</li> <li>• Remote start signal from automatic device</li> <li>• Deluge valve start</li> </ul>	
	<p><b>Manual Start</b></p>	<ul style="list-style-type: none"> <li>• Start pushbutton</li> <li>• Run test pushbutton</li> <li>• Remote start from manual device</li> </ul>	
	<p><b>Stopping</b></p>	<ul style="list-style-type: none"> <li>• Manual with Stop pushbutton</li> <li>• Automatic after expiration of minimum run timer ***</li> </ul>	
	<p><b>Timers</b></p>	<p>Field Adjustable &amp; Visual Countdown</p>	<ul style="list-style-type: none"> <li>• Minimum run timer ***(off delay)</li> <li>• Sequential start timer (on delay)</li> <li>• Periodic test timer</li> </ul>
	<p><b>Actuation</b></p>	<p>Visual Indication</p>	<ul style="list-style-type: none"> <li>• Pressure</li> <li>• Non-pressure</li> </ul>
	<p><b>Mode</b></p>		<ul style="list-style-type: none"> <li>• Automatic</li> <li>• Non-automatic</li> </ul>

\*\*\*Can only be used if approved by the AHJ



A4	Flow switch provision	C19	Emergency start alarm contact (DPDT)
A8	Foam pump application w/o pressure transducer and run test solenoid valve.	C20	Manual start alarm contact (DPDT)
A9	Low zone pump control function	C21	Deluge valve start alarm contact (DPDT)
A10	Middle zone pump control function	C22	Remote automatic start alarm contact (DPDT)
A11	High zone pump control function	C23	Remote manual start alarm contact (DPDT)
A13	Non-pressure actuated controller w/o pressure transducer and run test solenoid valve	C24	High pump room temperature alarm contact (DPDT)
A16	Lockout/interlock circuit from equipment installed inside the pump room	C25	Second set of standard alarm contacts (DPDT) (Typical for city of Los Angeles and Denver)
B11	Built in alarm panel (120V.AC supervisory power) providing indication for: • Audible alarm & silence pushbutton for motor run, phase reversal, loss of phase. • Pilot lights for loss of phase & supervisory power available	Cx	Additional visual and alarm contact (Specify function) (DPDT)
B11B	Built in alarm panel same as B11 but 220-240VAC supervisory power	D1	Low suction pressure transducer for fresh water rated at 0-300PSI with visual indication and alarm contact
B19A	High motor temperature c/w thermostat relay and alarm contacts (DPDT)	D1A	Low suction pressure transducer for sea water rated at 0-300PSI with visual indication and alarm contact
B19B	High motor temperature c/w PT100 relay and alarm contacts (DPDT)	D5	Pressure transducer and run test solenoid valve for fresh water rated for 0-500PSI (for factory calibration purposes only)
B21	Ground fault alarm detection c/w visual indication and alarm contact (DPDT)	D5D	Pressure transducer and run test solenoid valve for sea water rated for 0-500PSI
C1	Extra motor run alarm contact (DPDT)	D10	Omit mounting feet (when applicable)
C4	Periodic test alarm contact (DPDT)	D13	High withstand rating for: • 200V to 208V @ 150HP max. = 150kA* • 200V to 208V @ 200HP = 100kA* • 220V to 240V @ 200HP max. = 150kA* • 220V to 240V @ 250HP = 100kA* • 380V to 415V @ 300HP max. = 150kA* • 380V to 415V @ 350HP to 450HP = 100kA* • 440V to 480V @ 400HP max. = 150kA* • 440V to 480V @ 450HP to 500HP = 100kA* • 600V @ 500HP max. = 100kA*
C6	Low discharge pressure alarm contact (DPDT)	D13A	High withstand rating for: • 380V to 480V = 65kA* • 600V = 25kA*
C7	Low pump room temperature alarm contact (DPDT)	D13B	High withstand rating for: • 200V to 208V @ 150HP max. = 200kA* • 220V to 240V @ 200HP max. = 200kA* • 380V to 415V @ 300HP max. = 200kA* • 440V to 480V @ 400HP max. = 200kA*
C10	Low water reservoir level alarm contact (DPDT)	D14	Anti-condensation heater & thermostat
C11	High electric motor temperature alarm contact (DPDT)	D14A	Anti-condensation heater & humidistat
C12	High electric motor vibration c/w visual indication and alarm contact (DPDT)	D14B	Anti-condensation heater & thermostat & humidistat
C14	Pump on demand / automatic start alarm contact (DPDT)		
C15	Pump fail to start alarm contact (DPDT)		
C16	Control voltage healthy alarm contact (DPDT)		
C17	Flow meter valve loop open c/w visual indication and alarm contact (DPDT)		
C18	High water reservoir level c/w visual indication and alarm contact (DPDT)		

\*For fire pump controller section only.

Note: Options chosen from this page are not electrically represented on the wiring schematics in this submittal package.



D15	Tropicalization
D18	CE Mark with factory certificate
D26	Modbus with RTU frame format and RS485 connection
D27	Motor heater connection (external single phase power source and heater on/off contact)
D27A	Motor heater connection (internal single phase power source and heater on/off contact)
D28	Customized drawing set
D34A	Field programmable I/O board - 5 Input / 5 output
D43	Seismic Certification compliant to CBC 2019, IBC 2018 rigid base/wall mounted only
D44	Special Seismic Certification compliant to OSHPD rigid base/wall mounted only

L01	Other language and English (bilingual)
L02	French
L03	Spanish
L04	German
L05	Italian
L06	Polish
L07	Romanian
L08	Hungarian
L09	Slovak
L10	Croatian
L11	Czech
L12	Portuguese
L13	Dutch
L14	Russian
L15	Turkish
L16	Swedish
L17	Bulgarian
L18	Thai
L19	Indonesian
L20	Slovenian
L21	Danish
L22	Greek
L23	Arabic
L24	Hebrew
L25	Chinese

Additional Options:

---



---



---




---



---

Note: Options chosen from this page are not electrically represented on the wiring schematics in this submittal package.

**ViZiTouch V2 Operator Interface**

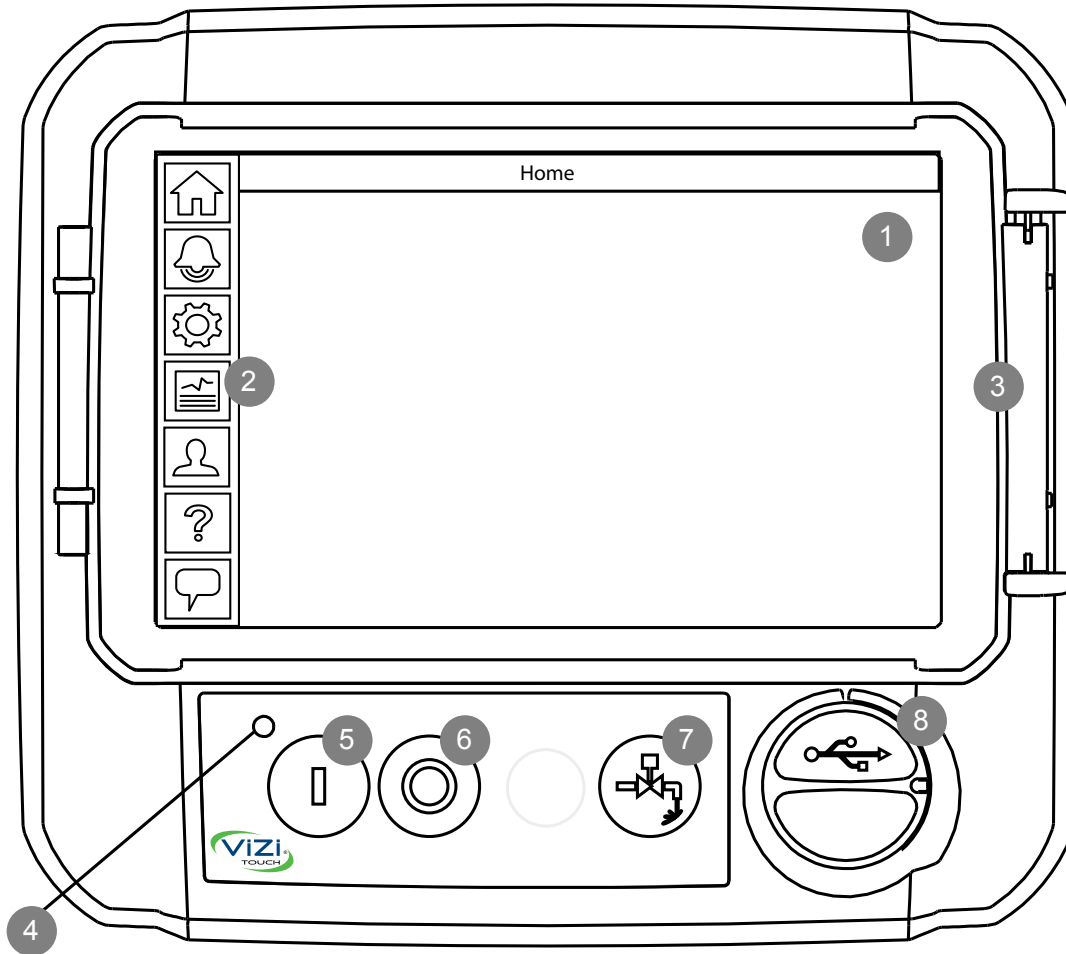




- |                        |                          |
|------------------------|--------------------------|
| 1 - Color touch screen | 3 - Screen protector     |
| 2 - Onscreen menu      | 4 - Power LED (3 colors) |
| • HOME page            | 5 - START button         |
| • ALARM page           | 6 - STOP button          |
| • CONFIGURATION page   | 7 - RUN TEST button      |
| • HISTORY page         | 8 - USB port             |
| • SERVICE page         |                          |
| • MANUAL page          |                          |
| • LANGUAGES page       |                          |

# Electric Fire Pump Controller

Model: GPA/GPP/GPY

## Dimensions

Built to the latest edition of the NFPA 20 standard

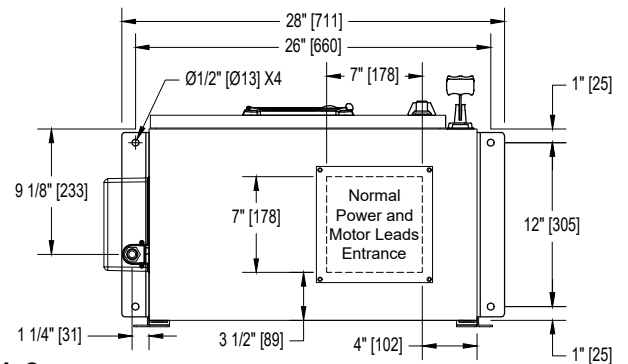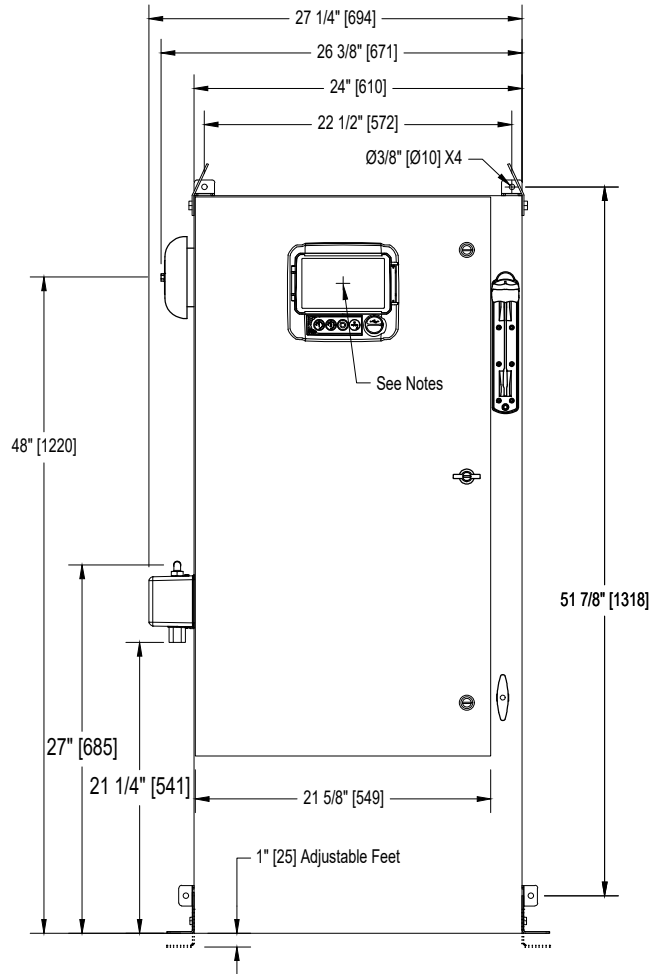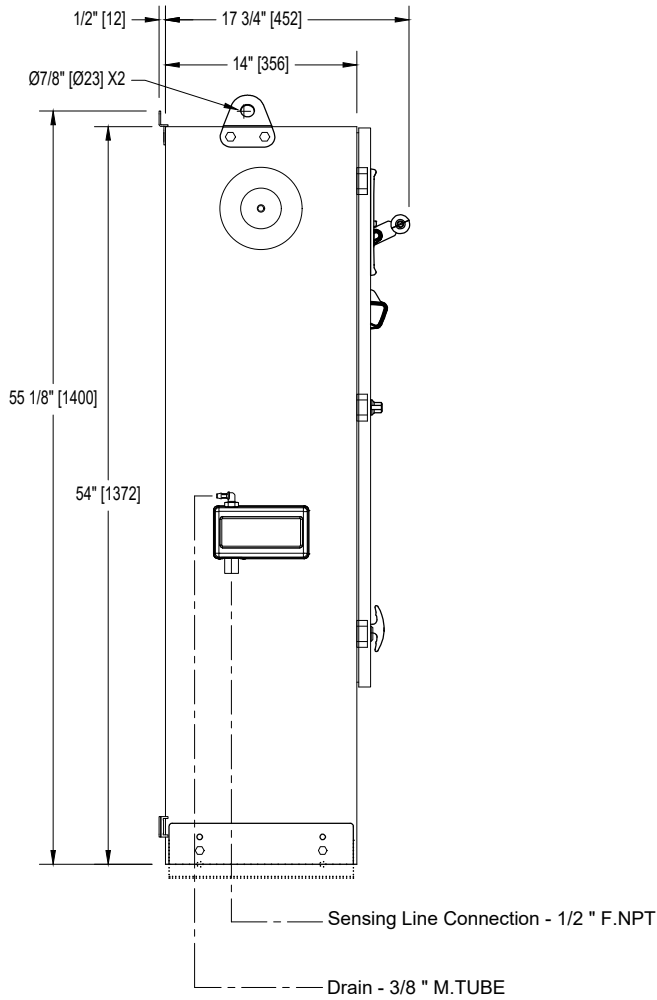


Voltage	Min HP	Max HP
208	40	60
220 - 240	40	75
380 - 400 - 415	75	125
440 - 480	75	150
600	100	200

### Notes:

- Standard NEMA: NEMA 2
- Standard paint : textured red RAL 3002.
- All dimensions are in inches [millimeters].
- Center of ViZiTouch screen: 47-5/8" [1208] from Bottom.
- Bottom conduit entrance through removable gland plate recommended.
- Use watertight conduit and connector only.
- Protect equipment against drilling chips.
- Door swing equal to door width.

Drawing for information only.  
 Manufacturer reserves the right to modify this drawing without notice.  
 Contact manufacturer for "As Built" drawing.




REV.	DESCRIPTION	DD/MM/YY	Drawing number
4.	Removed Seismic logo (optional)	18/05/22	GPX-DI261 /E
3.	HP Table Modified	22/12/20	
2.	New Logo	10/05/18	

# Electric Fire Pump Controller Reduced Voltage / Wye-Delta (Open Transition)

# Model: GPY

Wiring schematic

Built to the latest edition of the NFPA 20 standard

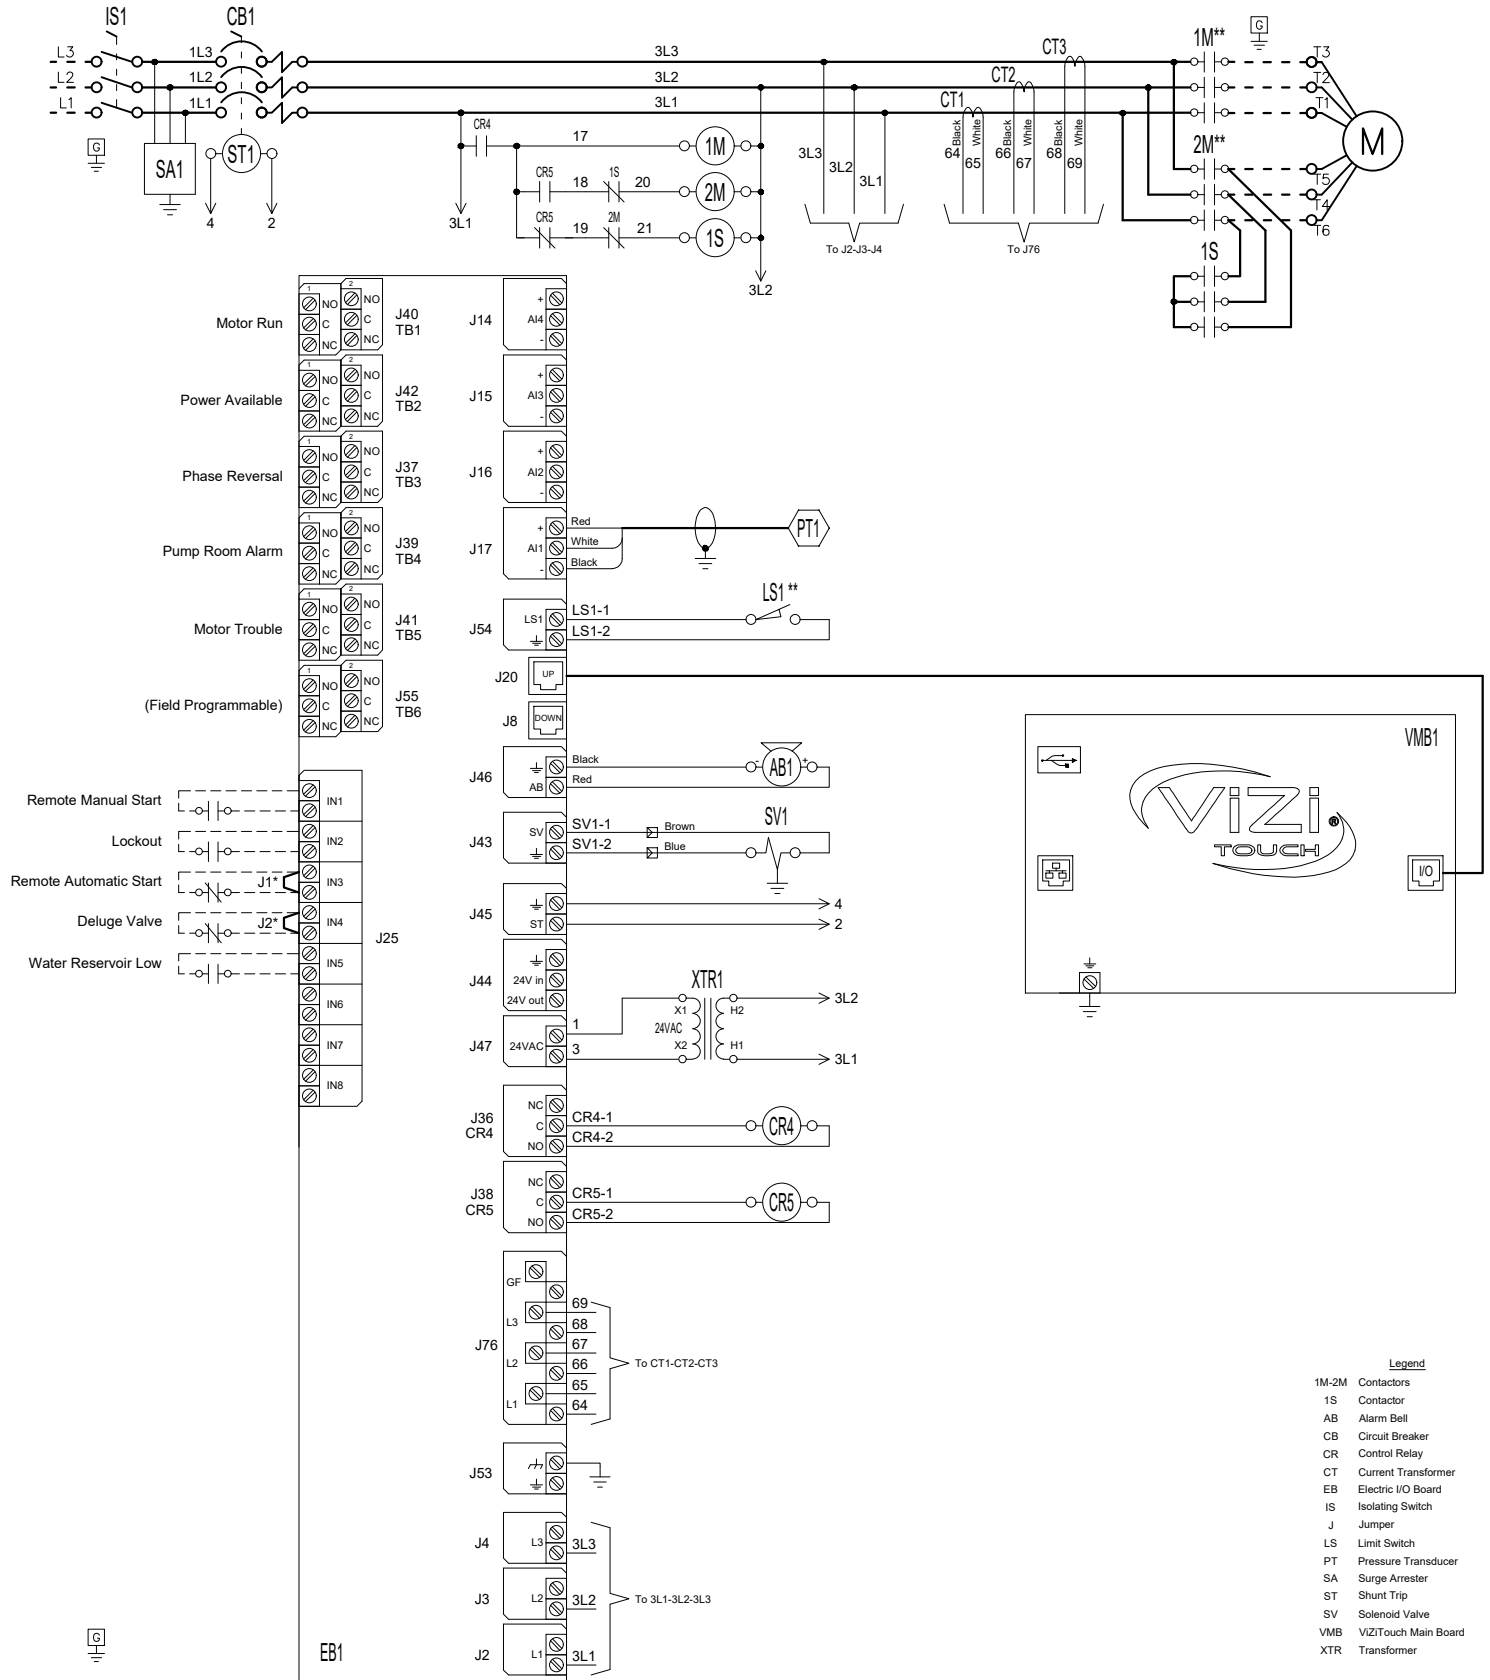

\* Remove jumper to use this feature  
\*\* Contact closes when emergency start is in "ON" position

Drawing for information only.  
Manufacturer reserves the right to modify this drawing without notice.  
Contact manufacturer for "As Built" drawing.



REV.	DESCRIPTION	DD/MM/YY	Drawing number
3	Removed Seismic logo (optional)	18/05/22	GPY-WS600 /E
2	Update Logo	23/04/18	
1	Removed (fail safe) text from Power Available relay	20/02/17	


# Electric Fire Pump Controller

# Model: GPX

Terminal Diagram and Sizing for Isolating Switch

Built to the latest edition of the NFPA 20 standard

## Power Terminals



### Notes:

- 1 - For proper wire sizing, refer to NFPA70 and NEC (USA) or CEC (Canada) or local code.
- 2 - Controller suitable for service entrance in USA.
- 3 - For more accurate motor connections refer to motor manufacturer or motor nameplate.
- 4 - Controller is phase sensitive. Incoming lines must be connected in ABC sequence.

### COPPER CONDUCTORS for Isolating Switch (IS1).

Field Wiring According to Bending Space (AWG or MCM). Terminals L1 - L2 - L3

Bending Space	5" (127 mm)							8" (203 mm)		
	HP	5	7.5	10	15	20	25	30	40	50
208	1x (10 to 1/0)	1x (8 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)	1x (2 to 1/0)	1x (1/0 to 3/0)	1x (3/0 to 250)	1x (4/0 to 250)
220 to 240	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)	1x (1 to 3/0)	1x (2/0 to 3/0)	1x (3/0 to 250)
380 to 416	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)	1x (3 to 1/0)
440 to 480	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)
600	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)

Bending Space	12" (305 mm)				16" (406 mm)							
	HP	75	100	125	150	200	250	300	350	400	450	500
208	2x (1/0 to 500)	2x (2/0 to 500)	2x (4/0 to 500)	2x (250 to 500)	3x (4/0 to 500)	-----	-----	-----	-----	-----	-----	-----
220 to 240	1x (250)	2x (2/0 to 500)	2x (3/0 to 500)	2x (4/0 to 500)	2x (350 to 500)	3x (250 to 500)	-----	-----	-----	-----	-----	-----
380 to 416	1x (1/0 to 3/0)	1x (3/0 to 250)	1x (250)	2x (1/0 to 500)	2x (3/0 to 500)	2x (4/0 to 500)	2x (300 to 500)	2x (400 to 500)	3x (250 to 500)	3x (300 to 500)	-----	-----
440 to 480	1x (1 to 3/0)	1x (2/0 to 3/0)	1x (3/0 to 250)	1x (4/0 to 250)	2x (1/0 to 500)	2x (3/0 to 500)	2x (4/0 to 500)	2x (300 to 500)	2x (350 to 500)	2x (400 to 500)	3x (250 to 500)	-----
600	1x (3 to 1/0)	1x (1 to 3/0)	1x (2/0 to 3/0)	1x (3/0 to 250)	1x (250)	2x (2/0 to 500)	2x (3/0 to 500)	2x (4/0 to 500)	2x (250 to 500)	2x (300 to 500)	2x (350 to 500)	2x (500)

### ALUMINUM CONDUCTORS for Isolating Switch (IS1).

Field Wiring According to Bending Space (AWG or MCM). Terminals L1 - L2 - L3

Bending Space	5" (127 mm)							8" (203 mm)		10" (254 mm)
	HP	5	7.5	10	15	20	25	30	40	50
208	1x (10 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)	1x (1 to 1/0)	1x (1/0)	1x (3/0)	1x (4/0 to 250)	1x (300)** or 1x (250) 90°C*
220 to 240	1x (10 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (3 to 1/0)	1x (2 to 1/0)	1x (1 to 1/0)	1x (2/0 to 3/0)	1x (3/0) 90°C*	1x (250)
380 to 416	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (4 to 1/0)	1x (2 to 1/0)	1x (1 to 1/0)	1x (1/0)
440 to 480	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (2 to 1/0)	1x (1 to 1/0)
600	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (10 to 1/0)	1x (8 to 1/0)	1x (6 to 1/0)	1x (6 to 1/0)	1x (4 to 1/0)	1x (4 to 1/0)	1x (2 to 1/0)

Bending Space	12" (305 mm)				16" (406 mm)							
	HP	75	100	125	150	200	250	300	350	400	450	500
208	2x (2/0 to 500)	2x (4/0 to 500)	2x (300 to 500)	2x (350 to 500)	3x (300 to 500)	-----	-----	-----	-----	-----	-----	-----
220 to 240	1x (350)** N/A	2x (3/0 to 500)	2x (250 to 500)	2x (300 to 500)	2x (500)	3x (400 to 500)	-----	-----	-----	-----	-----	-----
380 to 416	1x (3/0)	1x (250 to 350)	1x (350)** N/A	2x (3/0 to 500)	2x (4/0 to 500)	2x (300 to 500)	2x (500)	3x (300 to 500)** 2x (500) 90°C*	3x (350 to 500)	3x (400 to 500)	-----	-----
440 to 480	1x (1/0 to 3/0)	1x (3/0)	1x (250)	1x (300 to 350)** 1x (250) 90°C*	2x (3/0 to 500)	2x (250 to 500)	2x (300 to 500)	2x (400 to 500)	2x (500)	2x (500) 90°C*	3x (350 to 500)	-----
600	1x (1 to 1/0)	1x (2/0 to 3/0)	1x (3/0) 90°C*	1x (4/0 to 250)	1x (350 to 500)	2x (3/0 to 500)	2x (4/0 to 250)	2x (300 to 500)	2x (350 to 500)	2x (400 to 500)	2x (500)	-----

\*For standard enclosure, use 90°C aluminium wire. Consult Factory for Use of Conductors Rated Lower than 90°C.  
\*\* Consult Factory

Drawing for information only.  
Manufacturer reserves the right to modify this drawing without notice.  
Contact manufacturer for "As Built" drawing.



REV.	DESCRIPTION	DD/MM/YY	Drawing number
1	Removed Seismic logo (optional)	18/05/22	GPX-TD612 1/2 /E
0	First issue	22/12/20	


# Electric Fire Pump Controller

# Model: GPX


Terminal Diagram and Sizing For GPP, GPY & GPW

Built to the latest edition of the NFPA 20 standard

## Motor Terminals



Model : GPP



Models : GPW & GPY

### Notes:

- 1 - For proper wire sizing, refer to NFPA70 and NEC (USA) or CEC (Canada) or local code.
- 2 - Controller suitable for service entrance in USA.
- 3 - For more accurate motor connections refer to motor manufacturer or motor nameplate.
- 4 - Controller is phase sensitive. Incoming lines must be connected in ABC sequence.

### COPPER CONDUCTORS for Motor Connection (1M-2M).

Field Wiring According to Bending Space (AWG or MCM). Terminals T1-T2-T3-T4-T5-T6-T7-T8-T9

HP Voltage	5	7.5	10	15	20	25	30	40	50	60
208	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (8 to 4)	1x (8 to 4)	1x (6 to 4)	1x (6 to 4)	1x (4 to 2/0)	1x (2 to 2/0)	1x (1 to 2/0)
220 to 240	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (8 to 4)	1x (8 to 4)	1x (6 to 4)	1x (6 to 4)	1x (4)	1x (3 to 2/0)	1x (2 to 2/0)
380 to 416	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (8 to 4)	1x (8 to 4)	1x (6 to 4)	1x (4)
440 to 480	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (8 to 4)	1x (8 to 4)	1x (6 to 4)
600	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (10 to 4)	1x (8 to 4)	1x (8 to 4)

HP Voltage	75	100	125	150	200	250	300	350	400	450	500
208	1x (2/0 to 3/0)	1x (3/0 to 300)	1x (250 to 300)	2x (1/0 to 300)	2x (3/0 to 350)	-----	-----	-----	-----	-----	-----
220 to 240	1x (1/0 to 2/0)	1x (3/0)	1x (4/0 to 300)	1x (300)	2x (2/0 to 300)	2x (4/0 to 350)	-----	-----	-----	-----	-----
380 to 416	1x (4 to 2/0)	1x (2 to 2/0)	1x (1/0 to 2/0)	1x (2/0 to 3/0)	1x (4/0 to 300)	1x (300)	2x (2/0 to 300)	2x (3/0 to 300)	2x (4/0 to 350)	2x (4/0 to 350)	-----
440 to 480	1x (4 to 2/0)	1x (3 to 2/0)	1x (2 to 2/0)	1x (1/0 to 3/0)	1x (2/0 to 3/0)	1x (4/0 to 300)	1x (300)	2x (1/0 to 300)	2x (2/0 to 300)	2x (3/0 to 350)	2x (4/0 to 350)
600	1x (6 to 4)	1x (4)	1x (3 to 2/0)	1x (2 to 2/0)	1x (1/0 to 3/0)	1x (2/0 to 3/0)	1x (4/0 to 300)	1x (250 to 300)	1x (300)	2x (1/0 to 300)	2x (2/0 to 300)

### ALUMINUM CONDUCTORS for Contactor (1M-2M).

Field Wiring According to Bending Space (AWG or MCM). Terminals T1-T2-T3-T4-T5-T6-T7-T8-T9

HP Voltage	5	7.5	10	15	20	25	30	40	50	60
208	1x (12 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (8 to 2/0) **	1x (6 to 2/0) **	1x (4 to 2/0) **	1x (4 to 2/0) **	1x (2 to 2/0)	1x (1/0 to 2/0)	1x (2/0)
220 to 240	1x (12 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (8 to 2/0) **	1x (8 to 2/0) **	1x (6 to 2/0) **	1x (4 to 2/0) **	1x (2 to 2/0) **	1x (1 to 2/0)	1x (1/0 to 2/0)
380 to 416	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (8 to 2/0) **	1x (8 to 2/0) **	1x (6 to 2/0) **	1x (4 to 2/0) **	1x (3 to 2/0) **
440 to 480	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (8 to 2/0) **	1x (8 to 2/0) **	1x (6 to 2/0) **	1x (4 to 2/0) **
600	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (12 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (10 to 2/0) **	1x (8 to 2/0) **	1x (8 to 2/0) **	1x (6 to 2/0) **

HP Voltage	75	100	125	150	200	250	300	350	400	450	500
208	1x (3/0)	Consult Factory	1x (300) 90°C *	2x (3/0 to 300)	2x (250 to 350)	-----	-----	-----	-----	-----	-----
220 to 240	1x (2/0) 90°C *	Consult Factory	1x (300)	1x (300) 90°C *	2x (4/0 to 300)	2x (300 to 350)	-----	-----	-----	-----	-----
380 to 416	1x (2 to 2/0)	1x (1/0 to 2/0)	1x (1/0 to 2/0)	1x (3/0) 90°C *	1x (300)	1x (300) 90°C *	2x (4/0 to 300)	2x (250 to 300)	2x (300 to 350)	2x (300 to 350)	-----
440 to 480	1x (3 to 2/0) **	1x (2 to 2/0)	1x (2/0) 90°C *	1x (2/0 to 3/0)	1x (3/0) 90°C *	1x (300)	1x (300) 90°C *	2x (3/0 to 300)	2x (4/0 to 300)	2x (250 to 350)	2x (300 to 350)
600	1x (4 to 2/0) **	1x (3 to 2/0) **	1x (2 to 2/0)	1x (1/0 to 3/0)	1x (3/0)	1x (3/0) 90°C *	1x (300)	1x (300) 90°C *	Consult Factory	2x (3/0 to 300)	2x (4/0 to 300)

\*For standard enclosure, use 90°C aluminium wire. Consult Factory for Use of Conductors Rated Lower than 90°C.

\*\* Option V659 required.

Drawing for information only.  
Manufacturer reserves the right to modify this drawing without notice.  
Contact manufacturer for "As Built" drawing.



REV.	DESCRIPTION	DD/MM/YY	Drawing number
1	Removed Seismic logo (optional)	18/05/22	GPX-TD612 2/2 /E
0	First issue	22/12/20	

# Electric Fire Pump Controller

# Model: GPX

## Terminal Diagram and Sizing


Built to the latest edition of the NFPA 20 standard

### Control Terminals (EB1)

Terminals Wire Size:  
24 - 12 AWG  
0.5 Nm


### Remote Alarm Terminals (EB1)

Terminals Wire Size:  
24 - 12 AWG  
0.5 Nm

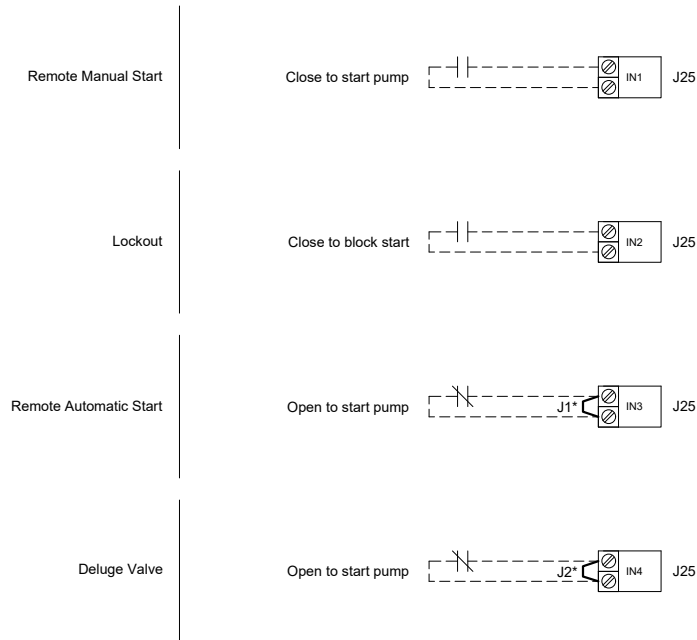



### Alarm Inputs (EB1)

Terminals Wire Size:  
24 - 12 AWG  
0.5 Nm

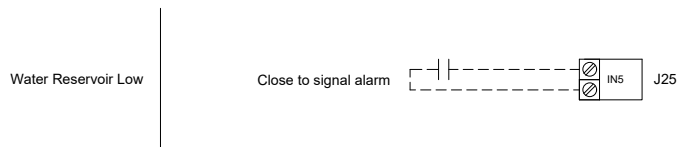


### Network Connection (VMB1)

Shielded Female Connector RJ45

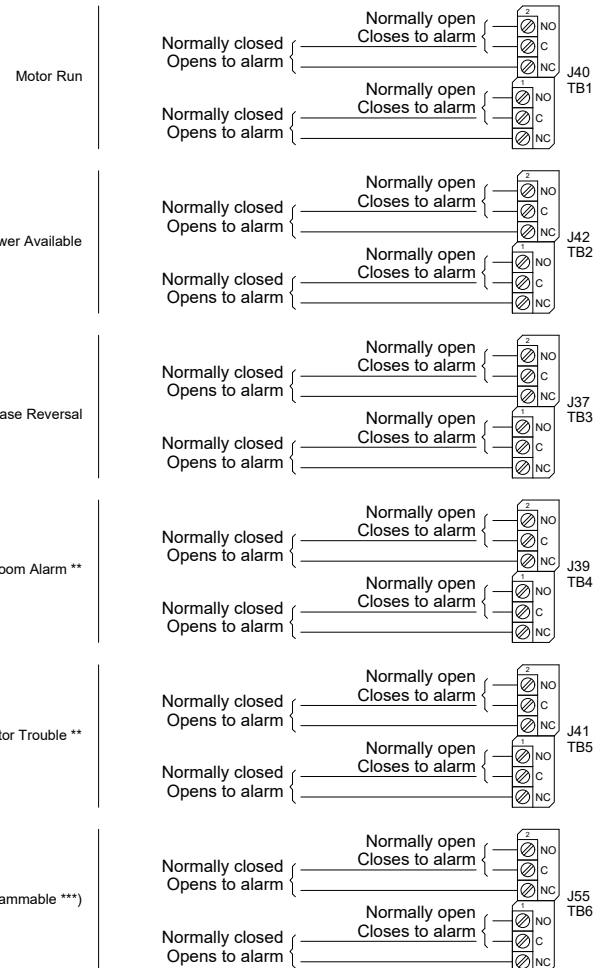


\* Remove jumper to use this feature  
\*\* Re-assignable  
\*\*\* Not available on GPS models

Drawing for information only.  
Manufacturer reserves the right to modify this drawing without notice.  
Contact manufacturer for "As Built" drawing.




REV.	DESCRIPTION	DD/MM/YY	Drawing number
3	Removed Seismic logo (optional)	18/05/22	GPX-TD603 / E
2	Revised logo	18/06/18	
1	General Revision (added AL coverage)	10/07/17	

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## JOCKEY PUMP

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# PACIFIC STAINLESS STEEL WATER PUMP

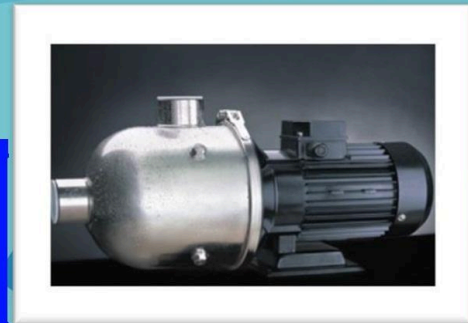

HIGH PERFORMANCE PUMPS FOR ALL WATER APPLICATIONS

## Product introduction

Performance range .....	2
Applications .....	3
Product range .....	4
Pump .....	5
Motor .....	5
Ambient temperature .....	5
Terminal box positions .....	5
Viscosity .....	5

## Construction

RV/RVA1,2,3,4,5 .....	6
RV/RVA10,15,20 .....	7
RV/RVA32,45,64,90 .....	8

## Instruction and codes

### Operating and inlet pressures

Max. operation pressure and liquid temperature...	10
Operation range of the shaft seal .....	10
Max. Inlet Pressure .....	11

### Selection and sizing

Selection of pumps .....	12~14
How to read the curve charts .....	14
Guidelines to performance curve.....	15


### Performance Curves and Technical Data

RVA1 .....	16~17
RV1 .....	18~19
RVA2 .....	20~21
RV2 .....	22~23
RVA3 .....	24~25
RV3 .....	26~27
RVA4 .....	28~29
RV4 .....	30~31

RVA5 .....	32~33
RV5 .....	34~35
RVA10 .....	36~37
RV10 .....	38~39
RVA15 .....	40~41
RV15 .....	42~43
RVA20 .....	44~45
RV20 .....	46~47
RVA32 .....	48~49
RV32 .....	50~51
RVA45 .....	52~53
RV45 .....	54~55
RVA64 .....	56~57
RV64 .....	58~59
RVA90 .....	60~61
RV90 .....	62~64
<b>Accessories</b> .....	65~69

# Product introduction

## Performance range

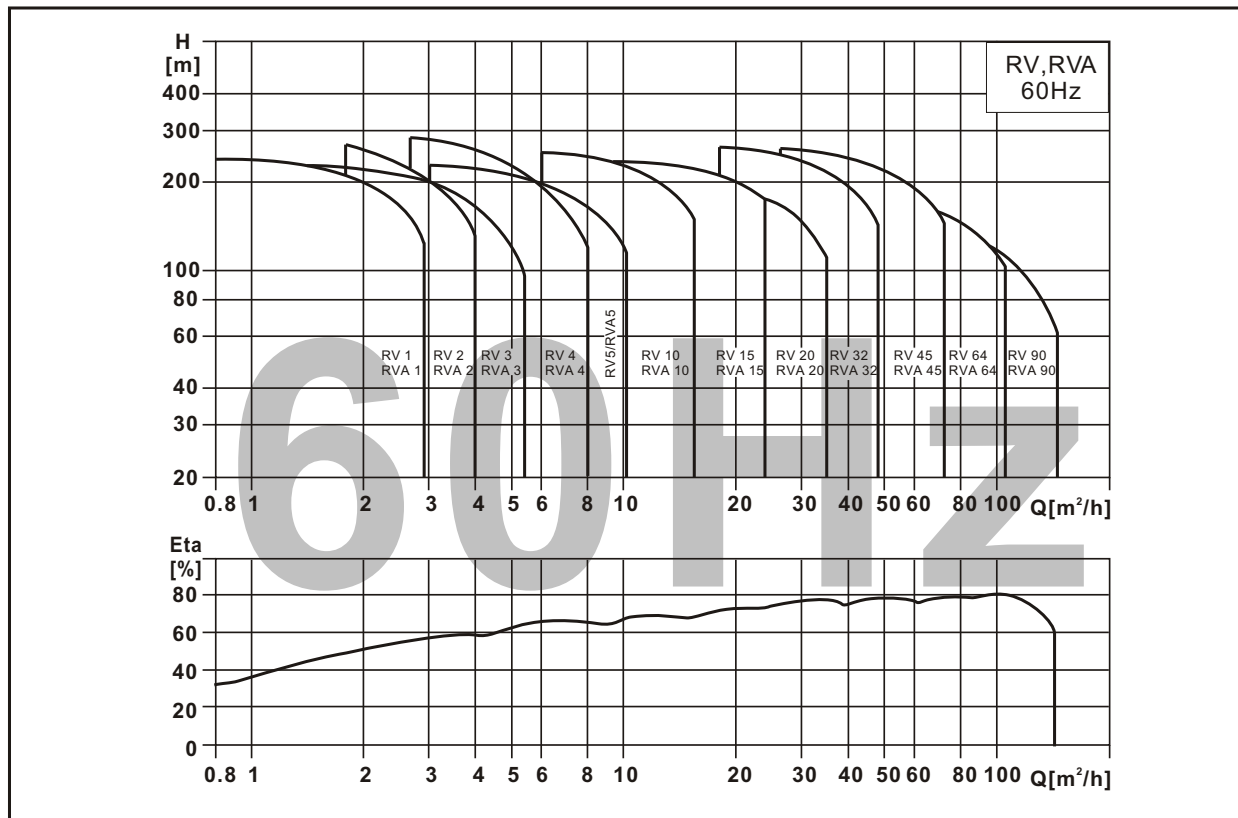

## Applications

Application	RVA	RV
<b>Water supply</b>		
Filtration and transfer at waterworks	●	●
Distribution from waterworks	●	●
Pressure boosting in mains	●	●
Pressure boosting in high-rise buildings, hotels, etc.	●	●
Pressure boosting for industrial water supply	●	●
<b>Industry</b>		
<b>Pressure boosting</b>		
Process water systems	●	●
Washing and cleaning systems	●	●
Vehicle washing tunnels	●	●
Fire fighting systems	●	●
<b>Liquid transfer</b>		
Cooling and air-conditioning systems (refrigerants)	●	●
Boiler feed and condensate systems	●	●
Machine tools (cooling lubricants)	●	●
Aquafarming	●	●
<b>Transfer</b>		
Oil and alcohol	●	●
Glycol and coolants	●	●
<b>Water treatment</b>		
Ultra-filtration systems	●	○
Reverse osmosis systems	●	○
Softening, ionising, demineralizing systems	●	○
Distillation systems	●	○
Separators	●	○
Swimming baths	●	●
<b>Irrigation</b>		
Field irrigation (flooding)	●	●
Sprinkler irrigation	●	●
Drip-feed irrigation	●	●

- Recommended pump model
- Option pump model

# Product introduction

Vertical Multistage Centrifugal Pump

## Product range


Range	RV1 RVA1	RV2 RVA2	RV3 RVA3	RV4 RVA4	RV5 RVA5	RV10 RVA10	RV15 RVA15	RV20 RVA20	RV32 RVA32	RV45 RVA45	RV64 RVA64	RV90 RVA90
Nominal rated [m <sup>3</sup> /h]	1	2	3	4	5	10	15	20	32	45	64	90
Temperature range [°C]	-20~+104											
Temperature on range [°C]	-40~+180								-40~+180			
Max Efficiency [%]	44	45	56	58	65	66	68	69	77	78	80	81
RVpump												
Flow range [m <sup>3</sup> /h]	0.7-2.4	1-3.2	1.2-4.5	2-4.8	2.5-8	5-13	9-24	10-29	14-40	20-56	30-85	40-120
Max Pressure [bar]	22	25	24	25	24	22	23	25	28	26	20	20
High Pressure on request [bar]	47	47	47	47	47	47	47	47	39	40	39	39
Motor power [kW]	0.37-2.2	0.37-3	0.37-3	0.37-4	0.37-5.5	0.37-7.5	1.1-15	1.1-18.5	1.5-30	3-45	4-45	5.5-45
Material type												
RV cast iron, S.S EN1.4301/AISI 304	●	●	●	●	●	●	●	●	●	●	●	●
RVA S.S EN1.4301/AISI 304	●	●	●	●	●	●	●	●	●	●	●	●
RVN S.S EN1.4401/AISI 316	●	●	●	●	●	●	●	●	●	●	●	●
RVpump pipe connection												
Flange	DN25 DN32	DN25 DN32	DN25 DN32	DN25 DN32	DN25 DN32	DN40	DN50	DN50	DN65	DN80	DN100	DN100
Flange on request	-	-	-	-	-	DN50	DN65	DN65	DN80	DN100	DN125	DN125
RVA/RV pump pipe connection												
column pipe thread★	G1 G1¼	G1 G1¼	G1 G1¼	G1 G1¼	G1 G1¼	G1½ G2	G2½	G2½	-	-	-	-
column pipe thread on request★	G1½	G1½	G1½	G1½	G1½	-	G2	G2	-	-	-	-
Flange	DN25 DN32	DN25 DN32	DN25 DN32	DN25 DN32	DN25 DN32	DN40	DN50	DN50	DN65	DN80	DN100	DN100
Flange on request	-	-	-	-	-	DN50	DN65	DN65	DN80	DN100	DN125	DN125
Cutting ferrule joint [PJE] ★	G1¼ DN32	G1¼ DN32	G1¼ DN32	G1¼ DN32	G1¼ DN32	G2 DN50	G2 DN50	G2 DN50	-	-	-	-

★NPT thread are on request

## Pump

RVA and RV are non-self priming vertical multistage centrifugal pump, the pumps are available with standard motor, the inlet and outlet are located at the pump bottom at the same plane (inline type). All pumps are equipped with a maintenance-free mechanical seal set of the cartridge type.

Fig.1 RVA

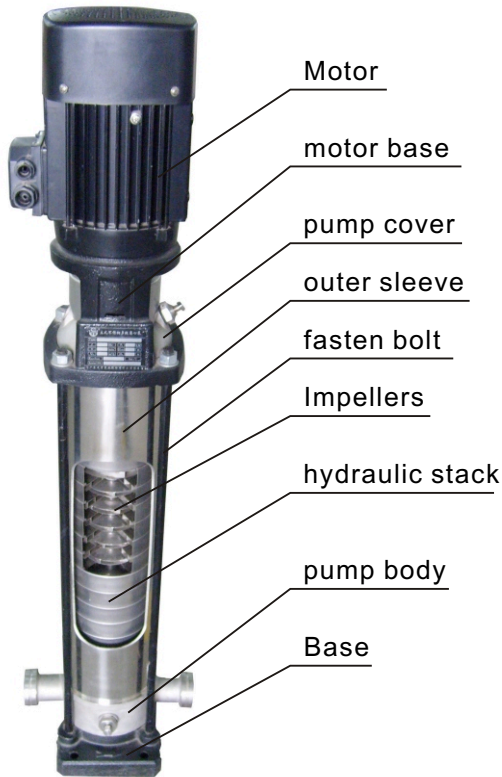

## Motor

RVA and RV are fitted with a totally enclosed, fan-cooled, 2-pole, three-phase standard motor. From 0.37kW to 2.2kW, are also available with single-phase motor. (1\*220-230V/240V).

## Motor Protection

Single-phase motor have a built-in thermal overload switch. Three-phase motors must be connected to a motor protective circuit breaker according to local regulations.

## Ambient temperature

Ambient temperature: maximum +40°C, if the ambient temperature exceeds +40°C, or the pump is installed at an altitude exceeding 1000 meters, the motor must not be fully loaded due to the risk of overheating. Overheating may result from excessive ambient temperatures or the low density and consequently low cooling effect of the air. In such cases, it may be necessary to use a motor with a higher rated output.

## Terminal box positions


As standard the terminal box is mounted on the suction side of the pump, meanwhile, 0°, 90°, 180°, 270° could be adjusted according to the following proceeding:

1. If necessary, disassembling the protective cover of the shaft connector, but did not disassembling the shaft connector.
2. Disassembling the motor fixation screws.
3. Turn the motor to the required direction.
4. Fasten the motor screws.
5. Install the shaft connector's protective cover.

The voltage and frequency are marked on the label, the correct power should be confirm with the label before usage.

To ensure the electric connection is conformity to the drawing marked on the label inside the terminal box.

Fig2. Terminal box positions

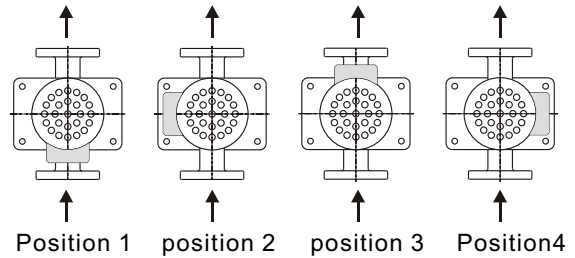


## Viscosity

The pumping of liquids with densities or kinematic viscosities higher than those of water will cause a considerable pressure drop, a drop in the hydraulic performance and a rise in the power consumption.

In such situations the pump should be fitted with a larger motor, if in doubt.

Fig.3 Relationship between motor output (P2) and temperature

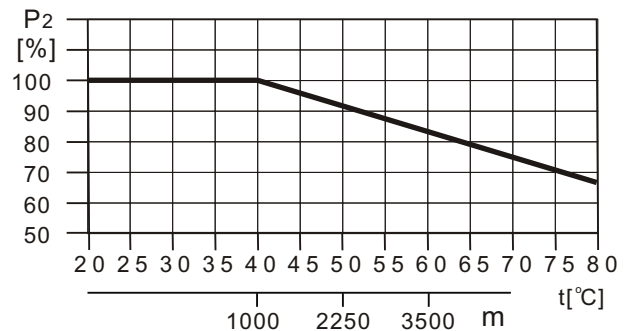


## Example:


From the Fig.3, the pump is installed at an altitude exceeding altitude 3500 meters, P2 will decrease to 88%, if the ambient temperature is up to 70°C, P2 will decrease to 78%.

# Construction

RV1,2,3,4,5  
Sectional drawing

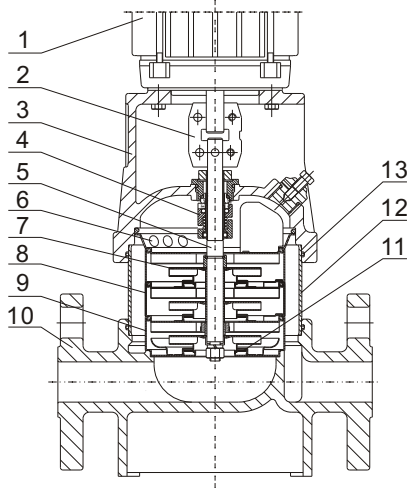

RVA1,2,3,4,5  
Sectional drawing

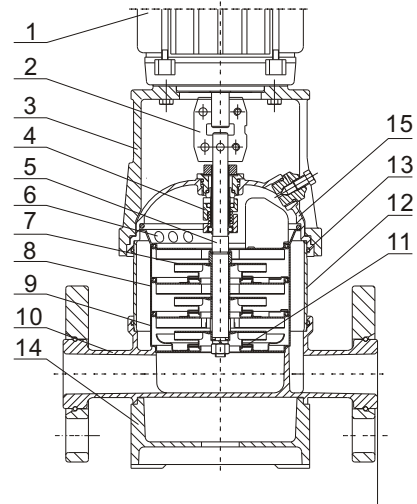

Material RV


No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Castiron	EN-JL1030	ASTM25B
4	Mechanical seal			
5	Shaft	S.S		AISI420
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Inlet	S.S	1.4301	AISI304
10	Pump body	Castiron	EN-JL1030	ASTM25B
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EPDM/FKM		

Material RVA


No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Castiron	EN-JL1030	ASTM25B
4	Mechanical seal			
5	Shaft	S.S	1.4057	AISI431
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Inlet	S.S	1.4301	AISI304
10	Pump body	S.S	1.4301	AISI304
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EDM/FKM		
14	Bottom base	Castiron	EN-JL1030	ASTM25B
15	Pump cover	S.S	1.4301	AISI304

# Construction

RV10,15,20  
Sectional drawing

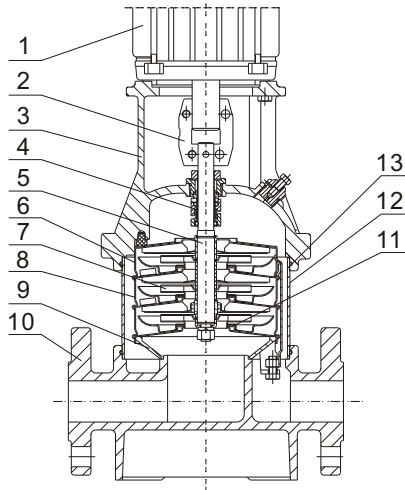

RVA10,15,20  
Sectional drawing

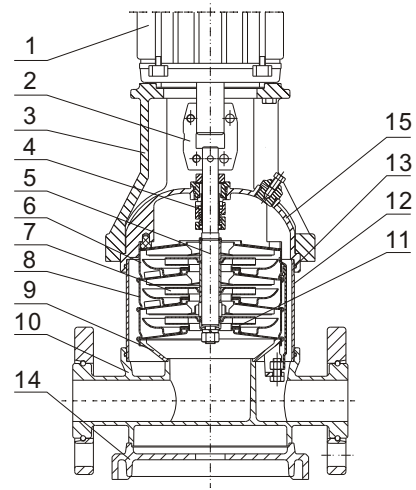

Material RV


No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Cast iron	EN-JL1030	ASTM25B
4	Mechanical seal			
5	Shaft	S.S		AISI420
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Settled cover	S.S	1.4301	AISI304
10	Pump body	Cast iron	EN-JL1030	ASTM25B
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EPDM/FKM		

Material RVA

No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Cast iron	EN-JL1030	ASTM25B
4	Mechanical seal			
5	Shaft	S.S	1.4057	AISI431
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Settled cover	S.S	1.4301	AISI304
10	Pump body	S.S	1.4301	AISI304
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EPDM/FKM		
14	Bottom base	Cast iron	EN-JL1030	ASTM25B
15	Pump cover	S.S	1.4301	AISI304


RV32,45,64,90

### Sectional drawing

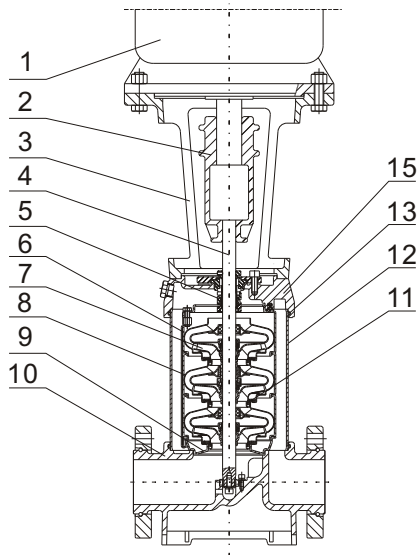

RVA32,45,64,90

### Sectional drawing

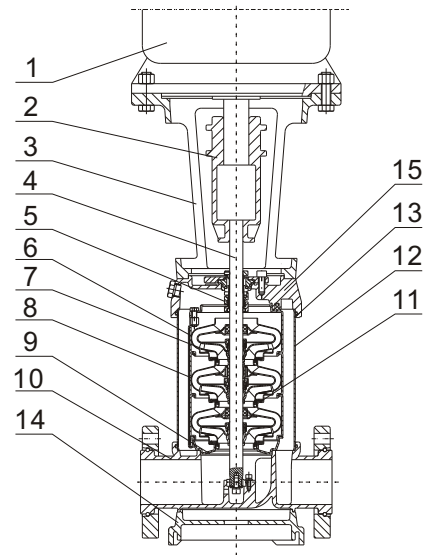

### Material RV


No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Cast iron	EN-JL1030	ASTM25B
4	Shaft	S.S		AISI420
5	Mechanical sea			
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Inlet	S.S	1.4301	AISI304
10	Pump body	Cast iron	EN-JL1030	ASTM25B
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EPDM/FKM		
14	Pump cover	Cast iron	EN-JL1030	ASTM25B

### Material RVA


No.	Description	Material	EN/DIN	AISI/ASTM
1	Motor			
2	Shaft connector			
3	Pump head	Cast iron	EN-JL1030	ASTM25B
4	Shaft	S.S	1.4057	AISI431
5	Mechanical seal			
6	Outlet	S.S	1.4301	AISI304
7	Impeller	S.S	1.4301	AISI304
8	Hydraulic stack	S.S	1.4301	AISI304
9	Inlet	S.S	1.4301	AISI304
10	Pump body	S.S	1.4301	AISI304
11	Neck ring	PTFE		
12	Outer sleeve	S.S	1.4301	AISI304
13	O-ring	EPDM/FKM		
14	Bottom base	Cast iron	EN-JL1030	ASTM25B
15	Pump cover	S.S	1.4301	AISI304

## Model instruction




RV/RVA1,2,3,4,5,10,15 and 20... ..

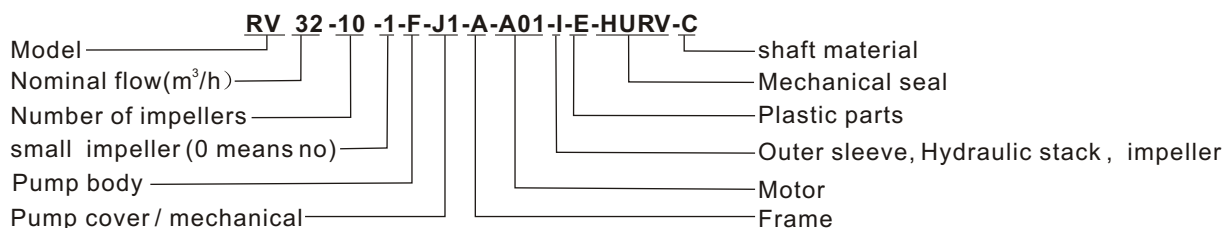

## Codes

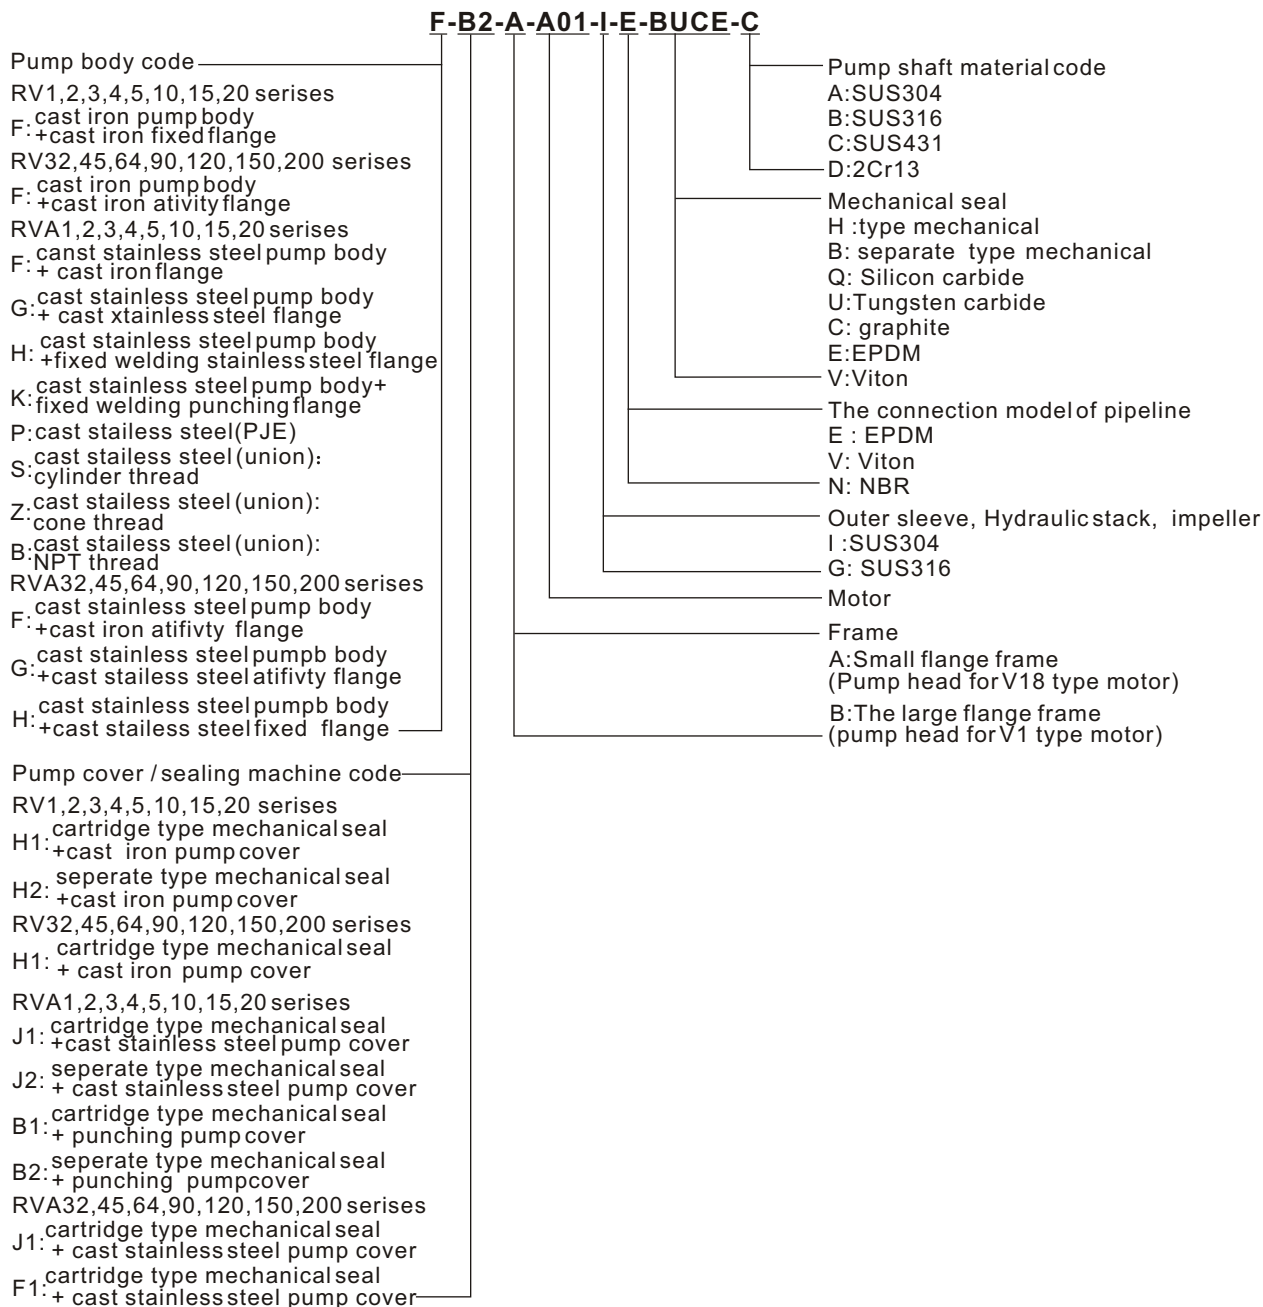


## Maximum operating pressure and temperature range

	DIN-FGJ	UNION	PJE
			
	Max. permissible operating pressure		Liquid temperature range
RV,RVA1	25bar		-20 °C to +104 °C
RV,RVA2	25bar		-20 °C to +104 °C
RV,RVA3	25bar		-20 °C to +104 °C
RV,RVA4	25bar		-20 °C to +104 °C
RV,RVA5	25bar		-20 °C to +104 °C
RV,RVA10-1→RV,RVA10-10	16bar		-20 °C to +104 °C
RV,RVA10-12→RV,RVA10-17	25bar		-20 °C to +104 °C
RV,RVA15-1→RV,RVA15-8	16bar		-20 °C to +104 °C
RV,RVA15-9→RV,RVA15-12	25bar		-20 °C to +104 °C
RV,RVA20-1→RV,RVA20-7	16bar		-20 °C to +104 °C
RV,RVA20-8 →RV,RVA20-10	25bar		-20 °C to +104 °C
RV,RVA32-1-1→RV,RVA32-5	16bar		-20 °C to +104 °C
RV,RVA32-6-2→RV,RVA32-8	25bar		-20 °C to +104 °C
RV,RVA32-9-2→RV,RVA32-10-2	30bar		-20 °C to +104 °C
RV,RVA45-1-1→RV,RVA45-4	16bar		-20 °C to +104 °C
RV,RVA45-5-2→RV,RVA45-6-1	25bar		-20 °C to +104 °C
RV,RVA45-6→RV,RVA45-7	30bar		-20 °C to +104 °C
RV,RVA64-1-1→RV,RVA64-3	16bar		-20 °C to +104 °C
RV,RVA64-4-2→RV,RVA64-5-2	25bar		-20 °C to +104 °C
RV,RVA90-1-1→RV,RVA90-3	16bar		-20 °C to +104 °C
RV,RVA90-4-2	25bar		-20 °C to +104 °C

### Operating range of the shaft seal

The operating range of the shaft seal depends on operating pressure, pump type, type of shaft seal and liquid temperature. The range shown in fig 4. Applies to cleanwater and water with glycol liquids.

Fig.4 Operating range of standard shaft seals

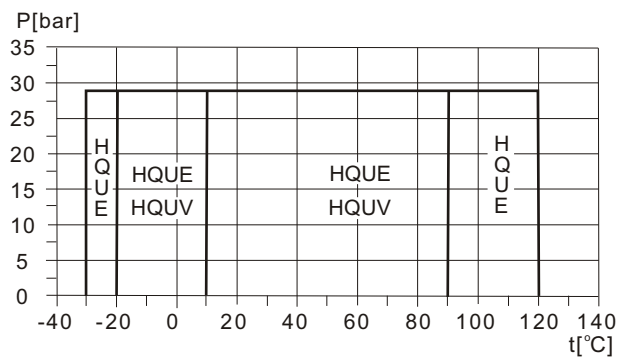

## maximum inlet pressure

The following table shows the maximum permissible inlet pressure. However, the actual inlet pressure the pressure against a closed valve must always be lower than the maximum permissible operating pressure. If the maximum permissible operating pressure is exceeded, the bearing in the motor may be damaged and the life of the shaft seal reduced.

<b>RV,RVA 1</b> RV,RVA1-2 → RV,RVA1-25 RV,RVA1-27	10bar 15bar
<b>RV,RVA 2</b> RV,RVA2-2 → RV,RVA2-26	10bar
<b>RV,RVA 3</b> RV,RVA3-2 → RV,RVA3-15 RV,RVA3-17 → RV,RVA3-25	10bar 15bar
<b>RV,RVA 4</b> RV,RVA4-2 → RV,RVA4-22	15bar
<b>RV,RVA 5</b> RV,RVA5-2 → RV,RVA5-9 RV,RVA5-10 → RV,RVA5-24	10bar 15bar
<b>RV,RVA 10</b> RV,RVA10-1 → RV,RVA10-5 RV,RVA10-6 → RV,RVA10-17	8bar 10bar
<b>RV,RVA 15</b> RV,RVA 15-1 → RV,RVA 15-2 RV,RVA 15-3 → RV,RVA 15-12	8bar 10bar
<b>RV,RVA20</b> RV,RVA20-1 RV,RVA20-2 → RV,RVA20-10	8bar 10bar
<b>RV,RVA 32</b> RV,RVA32-1-1 → RV,RVA32-2 RV,RVA32-3-2 → RV,RVA32-6 RV,RVA32-7-2 → RV,RVA32-10-2	4bar 10bar 15bar
<b>RV,RVA 45</b> RV,RVA45-1-1 → RV,RVA45-1 RV,RVA45-2-2 → RV,RVA45-3 RV,RVA45-4-2 → RV,RVA45-7	4bar 10bar 15bar
<b>RV,RVA 64</b> RV,RVA64-1-1 RV,RVA64-1 → RV,RVA64-2-1 RV,RVA64-2 → RV,RVA64-5-2	4bar 10bar 15bar
<b>RV,RVA 90</b> RV,RVA90-1-1 → RV,RVA90-2-2 RV,RVA90-2-1 → RV,RVA90-4-2	10bar 15bar

## Example of operating and inlet pressures :

The values for operating and inlet pressures shown in the table must not be considered individually but must always be compared, see the following examples.

### Example 1:

pump model:RVA-5-20-A-FGJ-E-HQUE

Max.operating pressure:25bar

Max.inlet pressure:15bar

discharge pressure against a closed valve:

13.7bar, see page 31.

the pump is not allowed to start at an inlet pressure of 15 bar, but at an inlet pressure of  $25 - 13.7 = 11.3$  bar.

### Example 2:

MODEL:RVA15-3-A-P-E-HQUE

Max.operating pressure:16bar

Max.inlet pressure:8bar

discharge pressure against a closed valve:

4.2bar, see page 39 curves chart.

This pump is allowed to start at an inlet pressure of 6bar, as the discharge pressure against a closed valve is only 4.2bar, which results in an operating pressure of  $6 + 4.2 = 10.2$  bar. On the contrary, the max. Operating pressure of this pump limited to 12.2bar, as a higher operating pressure bigger than 8bar will require on the Inlet.

## selection of pumps


selection of pumps should be based on:

- the duty point of the pump(see page12).
- dimensional data such as pressure loss as a
- result of height differences,friction loss in the pipework,pump efficiency etc.(see page12).
- pump materials(see page6,7,8)
- pump connections(see page13)
- shaft seal(see page13)

### 1. Duty point of the pump

From a duty point it is possible to select a pump on the basis of the curve charts shown in "performance curves/technical" data.

Fig.5 example of curve chart

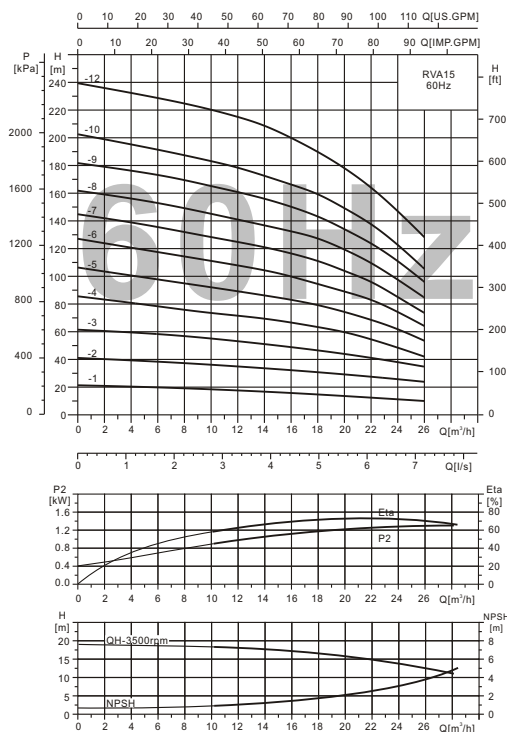

### 2. dimensional data


When sizing a pump the following must be taken into accounting:

- Required flow and pressure at the draw-off point.
- Pressure loss as a result of height differences( $H_{geo}$ ).
- Friction loss in the pipework( $H_f$ ) It may.
- Best efficiency at the estimated duty point.
- NPSH value.
- For calculation of the NPSH value, see corresponding curves chart.

### pump efficiency

Before determining the best efficiency point, the operation pattern of the pump needs to be identified. If the pump expected to operate as the same duty point, then select a RVA pump which is operating at a duty point corresponding with the best efficiency of the pump.

Fig.6 example of duty point

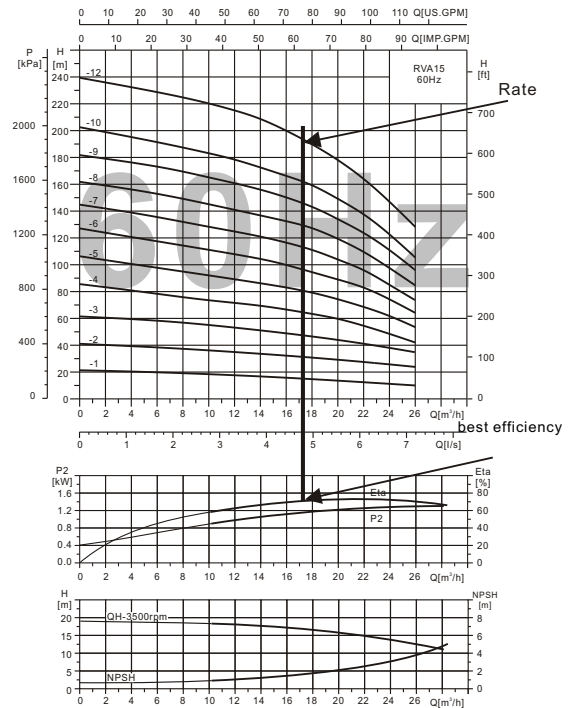

As the pump is sized on the basis of the highest possible flow, it is important always to have the duty point to the right on the efficiency curve (eta) in order to keep efficiency high when the flow drops.

Fig.7 best efficiency


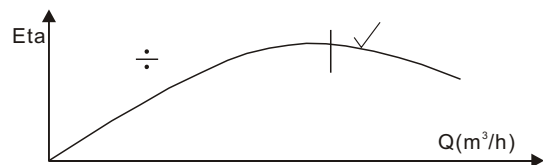


Fig.8 dimensional data



### 3. pump material

The material variant(RV,RVA)should be selected based of the liquid to be pump.  
 RVA wetted parts are made of AISI304.  
 RV pump body is made of cast-iron and .  
 Wetted parts are made of AISI304.

### 4. Pump connections

selection of pump connection depend on the rated pressure and pipework. To meet any requirement the RV, RVA pump offer a wide range of flexible connection such as:

- DIN frange.
- PJE coupling.
- union connection.
- Other connections on request.

### 5.shaft seal

As standard, the RV AND RVA range is fitted with a cartridge type suitable for themost common applications. The following key parameters must be taken into account ,when selecting the shaft seal:

- type of pumped liquid.
- liquid temperature and
- maximum pressure.

### Inlet pressure and operating pressure

The limit values stated on page 10 and page 11 must not be exceeded as regards

- maximum inlet pressure and
- maximum operating pressure.

Fig. 9 RV pump





Fig. 10 pump connections

DIN-FGJ



UNION



PJE




Fig.11 Shaft seal (cartridge type)





Fig.12 Inlet pressure and operating pressure

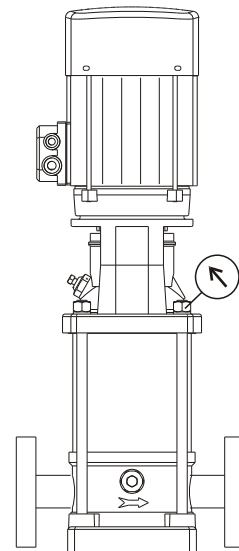

## Minimum inlet pressure-NPSH

Calculation of the inlet pressure "H" is recommended in these situations :

- the liquid temperature is high.
  - the flow is significantly higher than the rated flow.
  - water is drawn from depths.
  - water is drawn through long pipes.
- inlet conditions are poor. to avoid cavitation, make sure that there is a minimum pressure on the suction side of the pump.

The maximum suction lift "H" in metres head can be calculated as follows:

$$H = P_b * 10.2 - NPSH - H_f - H_v - H_s$$

---

$P_b$  = Barometric pressure in bar.  
(Barometric pressure can be set to 1 bar).  
in closed systems,  $P_b$  indicates the system pressure in bar.

---

NPSH = Net positive suction Head in metres head.  
(To be read from the NPSH curve at the highest flow the pump will be delivering).

---

$H_f$  = Friction loss in suction pipe (unit:m).  
(At the highest flow the pump will be delivering.)

---

$H_v$  = Vapour pressure (unit:m).  
(To be read from the vapour pressure scale).

---

$H_s$  = safety margin = minimum 0.5 metres head.

---

If the "H" calculated is positive, the pump can operate at a suction lift of maximum "H" metres head. If the "H" calculated is negative, an inlet pressure of minimum "H" metres head is required.

Example:

$P_b = 1 \text{ bar}$   
 pump model: RVA10,50Hz  
 flow:  $10 \text{ m}^3/\text{h}$   
 NPSH (P36 reference): 2.1 metres head.  
 liquid temperature:  $+50^\circ\text{C}$   
 $H_v$  (reference picture 4): 1.3 metres head.  
 $H = P_b * 10.2 - NPSH - H_f - H_v - H_s$   
 $H = 1 * 10.2 - 2.1 - 3.0 - 1.3 - 0.5 = 3.3 \text{ (metres)}$

It means the pump can operate at a suction lift of maximum 3.3 metres head.


exchanged meter head to bar:

$$1 \text{ metre head} = 1 * 0.0981 = 0.0981 \text{ bar}$$

exchanged metre head to kpa:


$$1 \text{ metre head} = 1 * 9.81 = 9.81 \text{ kpa.}$$

Fig.13 Minimum inlet pressure-NPSH

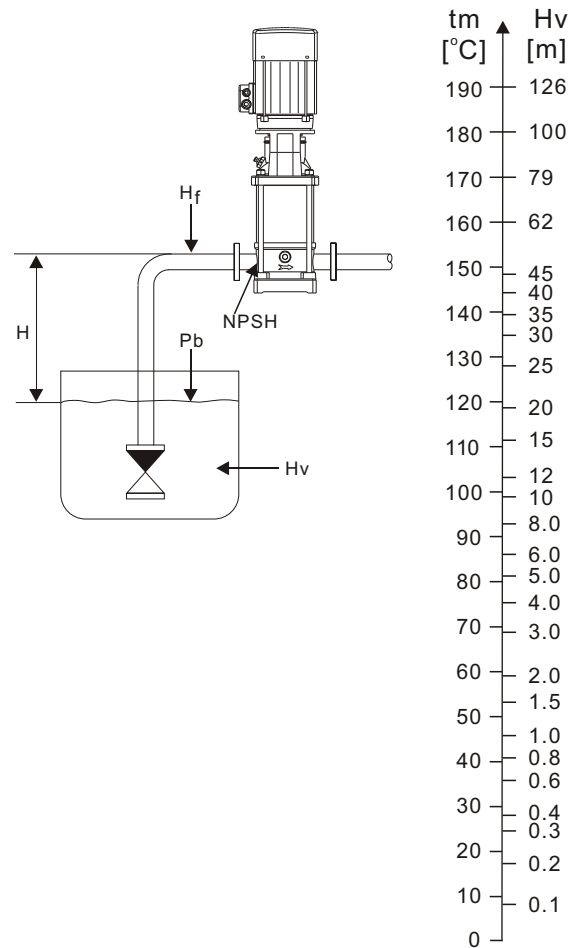

# Performance Curve


RV4-60Hz

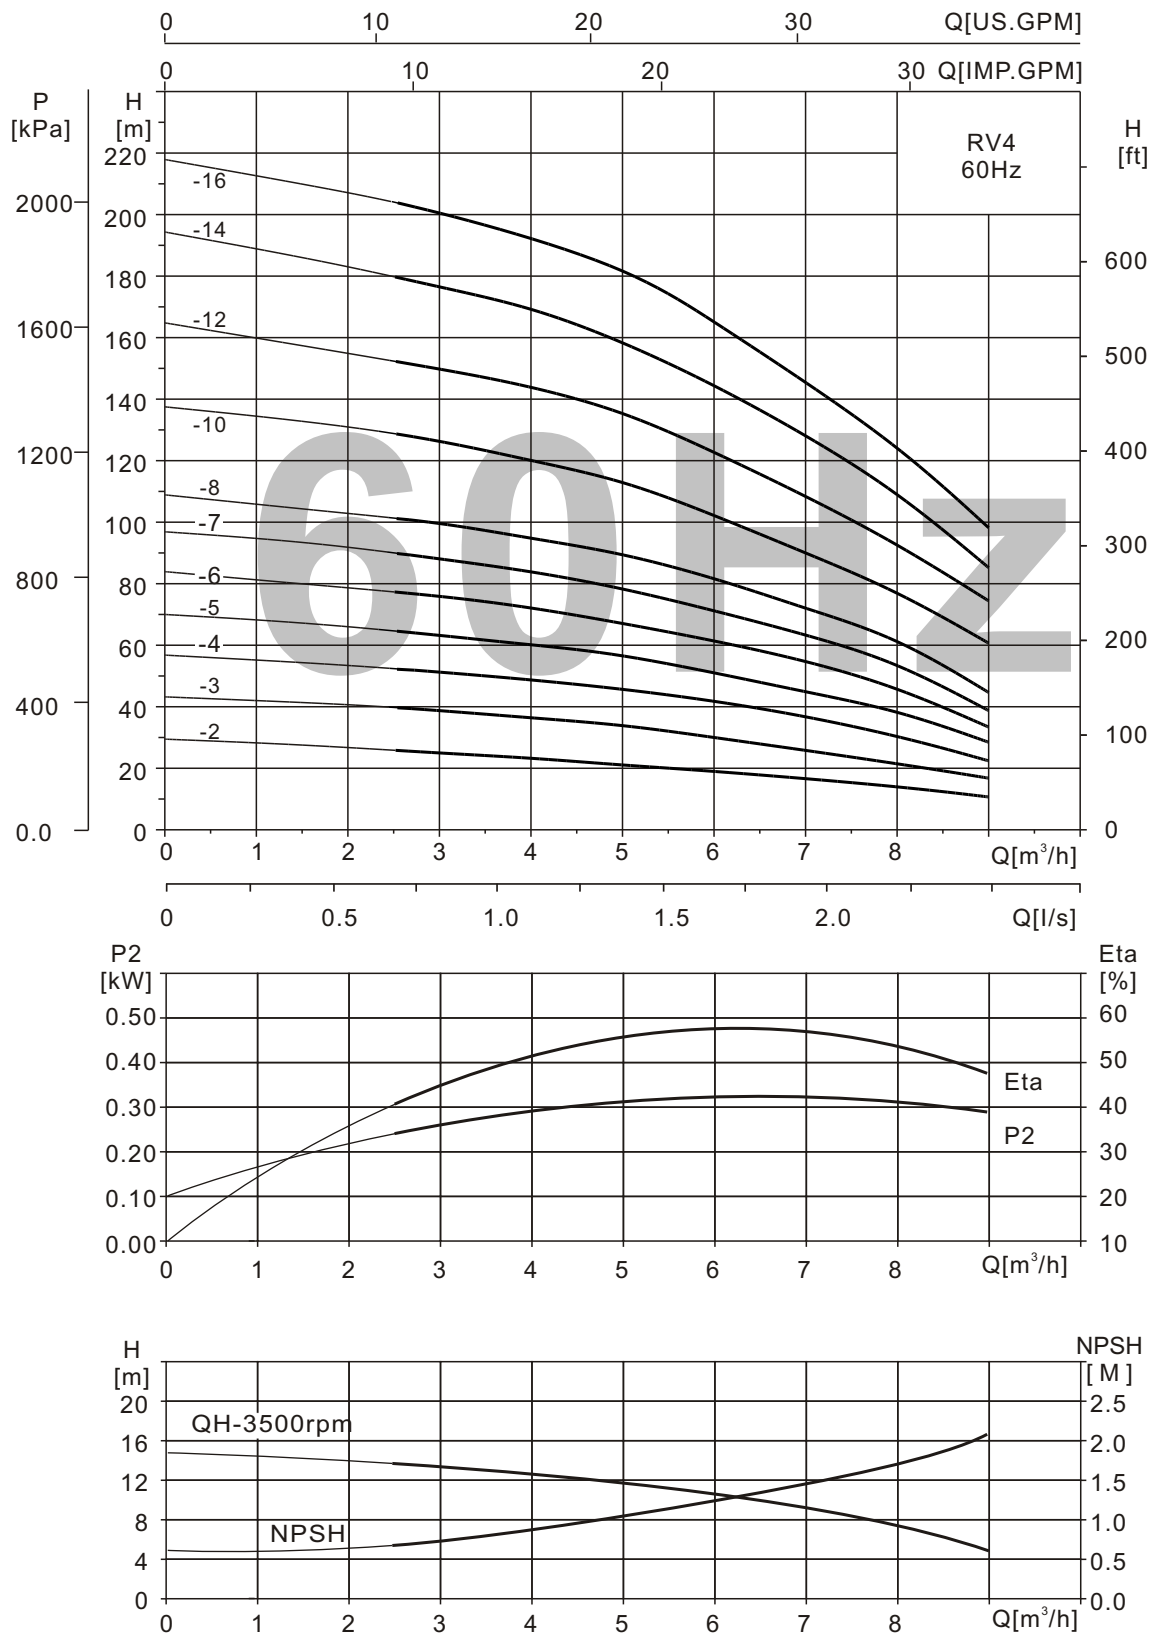

### Performance Table

Model	Power P <sub>2</sub> (kW)	Q (m <sup>3</sup> /h)	2.5	3.0	4.0	5.0	6.0	7.0	8.0	9.0
RV4-2	0.75	H (m)	26	25	23	21	19	16	14	11
RV4-3	1.1		39	38	36	32	28	24	21	18
RV4-4	1.5		52	50	48	44	38	35	31	22
RV4-5	2.2		65	62	60	55	49	44	39	27
RV4-6	2.2		78	75	72	67	59	54	47	33
RV4-7	3.0		92	88	84	78	69	62	55	38
RV4-8	3.0		104	100	95	90	79	72	63	44
RV4-10	4.0		130	125	120	113	102	90	80	61
RV4-12	4.0		156	150	145	136	122	109	96	74
RV4-14	5.5		182	176	170	159	145	129	112	86
RV4-16	5.5		207	201	196	183	165	146	128	98

### Installation sketches

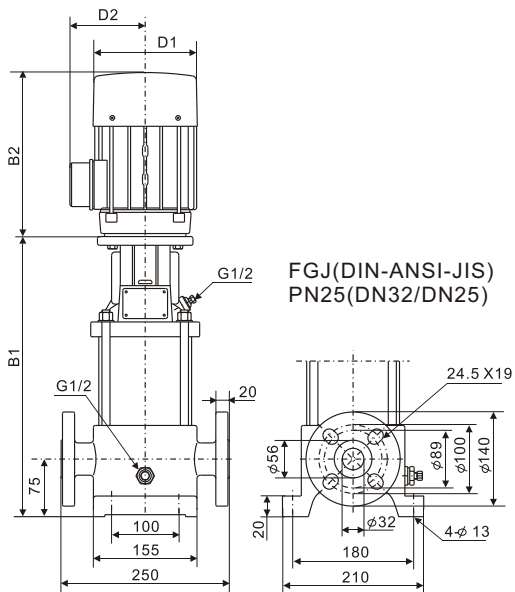

### Dimensions and weights

Model	Dimensions(mm)						Weight (kg)
	B1	B2	B1+B2	D	D1	D2	
RV4-2	262	205	467	-	133	102	25
RV4-3	286	241	527	-	154	111	28
RV4-4	304	241/293	545	-	151	111	30
RV4-5	330	275/293	605	-	177	116	38
RV4-6	348	275/293	623	-	177	116	39
RV4-7	366	293	641	-	177	116	43
RV4-8	384	293	659	-	177	116	44
RV4-10	440	305	745	-	197	148	45
RV4-12	476	305	781	-	197	148	46
RV4-14	517	390	907	300	275	210	74
RV4-16	553	390	943	300	275	210	75

# Technical Data

## Standard motor

Power $P_2$ (kW)	Voltage (V)	Current $I_N$ (A)	Power factor $\cos \varphi$	EFFiciency (%)	$I_{st}/I_N$
0.37	$\Delta$ 220/Y380	$\Delta$ 1.8/Y1.0	0.78	70.0	6.2
0.55	$\Delta$ 220/Y380	$\Delta$ 2.5/Y1.5	0.81	71.0	6.4
0.75	$\Delta$ 220/Y380	$\Delta$ 3.3/Y1.9	0.82	72.0	6.5
1.1	$\Delta$ 220/Y380	$\Delta$ 4.6/Y2.7	0.82	76.5	7.2
1.5	$\Delta$ 220/Y380	$\Delta$ 6.2/Y3.6	0.83	76.8	7.3
2.2	$\Delta$ 220/Y380	$\Delta$ 8.5/Y4.9	0.84	81.1	7.5
3.0	$\Delta$ 220/Y380	$\Delta$ 11.5/Y6.7	0.84	81.5	7.5
4.0	$\Delta$ 380/Y660	$\Delta$ 8.2/Y4.7	0.88	84.2	7.5
5.5	$\Delta$ 380/Y660	$\Delta$ 11.1/Y6.4	0.88	85.7	8.1
7.5	$\Delta$ 380/Y660	$\Delta$ 14.9/Y8.6	0.88	87.0	8.3
11	$\Delta$ 380/Y660	$\Delta$ 21.2/Y12.2	0.89	88.4	8.4
15	$\Delta$ 380/Y660	$\Delta$ 28.6/Y16.5	0.89	89.4	8.5
18.5	$\Delta$ 380/Y660	$\Delta$ 34.7/Y20.0	0.90	90.0	8.5
22	$\Delta$ 380/Y660	$\Delta$ 41.0/Y23.6	0.90	90.5	8.4
30	$\Delta$ 380/Y660	$\Delta$ 55.4/Y31.9	0.90	91.4	7.5
37	$\Delta$ 380/Y660	$\Delta$ 67.9/Y39.1	0.90	92.0	7.5
45	$\Delta$ 380/Y660	$\Delta$ 82.1/Y47.3	0.90	92.5	7.5

## High efficiency motor

Power $P_2$ (kW)	Voltage (V)	Current $I_N$ (A)	Power factor $\cos \varphi$	EFFiciency (%)	$I_{st}/I_N$
0.75	$\Delta$ 220/Y380	$\Delta$ 3.1/Y1.8	0.83	77.6	6.7
1.1	$\Delta$ 220/Y380	$\Delta$ 4.2/Y2.4	0.83	82.9	7.4
1.5	$\Delta$ 220/Y380	$\Delta$ 5.6/Y3.2	0.84	84.2	7.7
2.2	$\Delta$ 220/Y380	$\Delta$ 7.9/Y4.6	0.85	85.7	7.6
3.0	$\Delta$ 220/Y380	$\Delta$ 10.4/Y6.0	0.87	86.8	7.6
4.0	$\Delta$ 380/Y660	$\Delta$ 7.9/Y4.5	0.88	87.7	7.6
5.5	$\Delta$ 380/Y660	$\Delta$ 10.7/Y6.2	0.88	88.7	7.6
7.5	$\Delta$ 380/Y660	$\Delta$ 14.5/Y8.3	0.88	89.6	7.3
11	$\Delta$ 380/Y660	$\Delta$ 21.0/Y12.1	0.88	90.6	7.4
15	$\Delta$ 380/Y660	$\Delta$ 28.3/Y16.3	0.88	91.4	7.6
18.5	$\Delta$ 380/Y660	$\Delta$ 34.8/Y20.0	0.88	91.9	7.7
22	$\Delta$ 380/Y660	$\Delta$ 41.2/Y23.7	0.88	92.3	7.6
30	$\Delta$ 380/Y660	$\Delta$ 55.8/Y32.1	0.88	92.9	7.1
37	$\Delta$ 380/Y660	$\Delta$ 68.4/Y39.4	0.88	93.4	7.1
45	$\Delta$ 380/Y660	$\Delta$ 83.0/Y47.8	0.88	93.6	7.1

Remark: Special motor is available on request.

## Pipe connection

Various sets of counter flanges and couplings are available.

Counter flange for RV series



A set consists of one counter flange, one gasket, bolts and nuts.

(Remarks: The above accessories are not necessary for pumps, there will be extra charge for them if needed)

counter flange	pump type	description	rated pressure	pipe work Connection	product Number
	RV1 RV2 RV3 RV4 RV5	Threaded	16 bar, EN 1092-2	G1	
		For welding	25 bar, EN 1092-2	25mm, nominal	
		Threaded	16 bar, EN 1092-2	G1 <sup>1</sup> / <sub>4</sub>	
		For welding	25 bar, EN 1092-2	32mm, nominal	
		<hr/>			
	RV10	Threaded	16 bar, EN 1092-2	G1 <sup>1</sup> / <sub>2</sub>	
			16 bar, EN 1092-2	G2	
		For welding	25 bar, EN 1092-2	40mm, nominal	
		For welding	40bar, special flange	50mm, nominal	
		<hr/>			
	RV15 RV20	Threaded	16 bar, EN 1092-2	G2	
		Threaded	16bar, special flange	G2 <sup>1</sup> / <sub>2</sub>	
		Threaded	16bar, special flange	G2 <sup>1</sup> / <sub>2</sub>	
		For welding	25 bar, EN 1092-2	50mm, nominal	
		For welding	40bar, special flange	65mm, nominal	
<hr/>					
	RV32	Threaded	16 bar, EN 1092-2	G2 <sup>1</sup> / <sub>2</sub>	
		Threaded	16bar, special flange	G3	
		For welding	16 bar, EN 1092-2	65mm, nominal	
		For welding	40 bar, DIN 2635	65mm, nominal	
		For welding	16bar, special flange	80mm, nominal	

# Accessories

Vertical multistage centrifugal pumps

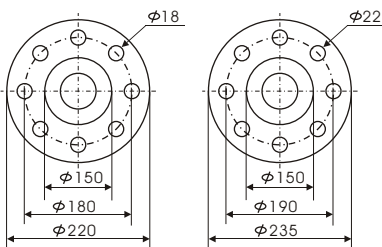counter flange	pump type	description	rated pressure	pipe work Connection	product Number
	RV45	Threaded	16 bar	G3	
		For welding	16 bar	80mm,nominal	
		For welding	40 bar	80mm,nominal	
	RV64 RV90	Threaded	16 bar	G4	
		For welding	16 bar	100mm,nominal	
		For welding	25 bar	100mm,nominal	





# Accessories

## Counter flange for RVA series

they are made of stainless steel EN1.4403(AISI304)



A set consists of one counter flange, one gasket, bolts and nuts.

(Remarks: The above accessories are not necessary for pumps, there will be extra charge for them if needed)

counter flange	pump type	description	rated pressure	pipe work Connection	product Number
		Threaded	16 bar, EN 1092-2	G1	
	RVA1 RVA2 RVA3 RVA4 RVA5	For welding	25 bar, EN 1092-2	25mm, nominal	
		Threaded	16 bar, EN 1092-2	G1 <sup>1</sup> / <sub>4</sub>	
		For welding	25 bar, EN 1092-2	32mm, nominal	
		Threaded	16 bar, EN 1092-2	G1 <sup>1</sup> / <sub>2</sub>	
		Threaded	16 bar, EN 1092-2	G2	
	RVA10	Threaded	16 bar, EN 1092-2	G2	
		For welding	25 bar, EN 1092-2	40mm, nominal	
		For welding	25 bar, special flange	50mm, nominal	
		Threaded	16 bar, special flange	G2 <sup>1</sup> / <sub>2</sub>	
		Threaded	16 bar, EN 1092-2	G2	
	RVA15 RVA20	Threaded	16 bar, special flange	G2 <sup>1</sup> / <sub>2</sub>	
		Threaded	16 bar, special flange	G2 <sup>1</sup> / <sub>2</sub>	
		For welding	25 bar, EN 1092-2	50mm, nominal	
		For welding	25 bar, special flange	65mm, nominal	
		Threaded	16 bar	G2 <sup>1</sup> / <sub>2</sub>	
	RVA32	Threaded	16 bar, special flange	G3	
		For welding	16 bar	65mm, nominal	
		For welding	40 bar	65mm, nominal	
		For welding	16 bar, special flange	80mm, nominal	
		For welding	25 bar, special flange	80mm, nominal	

# Accessories

Vertical multistage centrifugal pumps

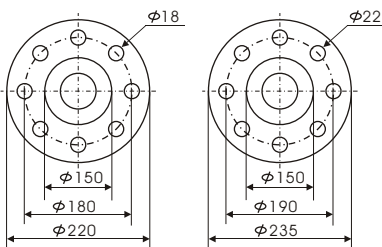
counter flange	pump type	description	rated pressure	pipe work Connection	product Number
	RVA45	Threaded	16 bar	G3	
		For welding	16 bar	80mm,nominal	
		For welding	40 bar	80mm,nominal	
	RVA64 RVA90	Threaded	16 bar	G4	
		For welding	16 bar	100mm,nominal	
		For welding	40 bar	100mm,nominal	

## PJE Couplings for RVA series

they are made of stainless steel EN1.4403(AISI304)


A set consists of one clamp, one gasket, bolts and nuts.

(Remarks: The above accessories are not necessary for pumps, there will be extra charge for them if needed)

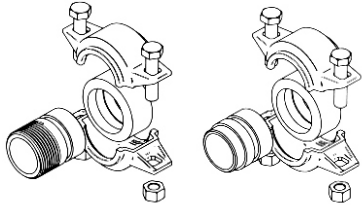counter flange	pump type	description	PN	pipe work Connection	rubber parts	Number of coupling sets needed
	RVA1 RVA2 RVA3 RVA4 RVA5	Threaded	80bar	G1 <sup>1</sup> / <sub>4</sub>	EPDM FKM	2 2
		For welding	80bar	DN32	EPDM FKM	2 2
	RVA10 RVA15 RVA20	Threaded	70bar	G2	EPDM FKM	2 2
		For welding	70bar	DN50	EPDM FKM	2 2

Edition:2013.08

The technical data are subject to amend without notice.

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## JOCKEY PUMP CONTROLLER

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



# TORNATECH

Project: \_\_\_\_\_

Customer: \_\_\_\_\_

Engineer: \_\_\_\_\_

Pump Manufacturer: \_\_\_\_\_

## Technical Data Submittal Document

### Model JP3

Across the Line Start  
Jockey Pump Controller



### Contents:

Data Sheets

Dimensional Data

Wiring Schematics

Field Connections


**Note:** The drawings included in this package are for controllers covered under our standard offering. Actual AS BUILT drawings may differ from what is shown in this package.



N.Y.C.  
APPROVED



March 2020

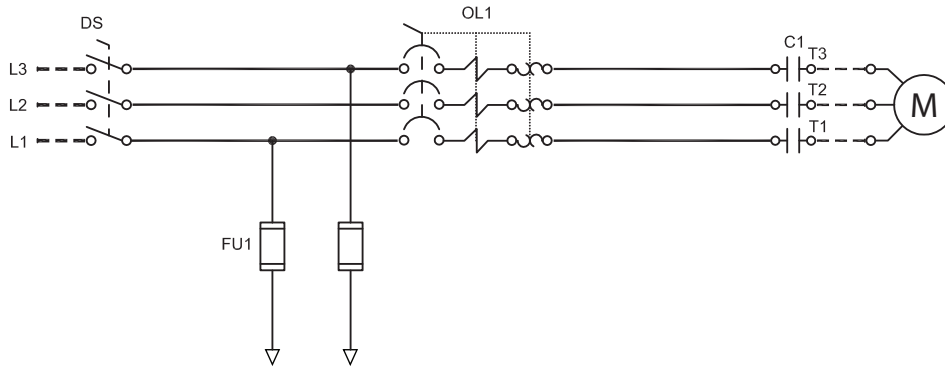

N.Y.C.  
APPROVED



OPTIONAL



<b>Listing</b>	Underwriters Laboratory (UL)	UL508A - Industrial Pump Controllers
	CSA	CSA C22.2 No. 14 Industrial Control Equipment
	New York City	Accepted for use in the City of New York by the Department of Buildings
	Seismic Certification	See page 4 for details
	<b>Optional</b>	
<input type="checkbox"/> CE Mark	Various EN, IEC & CEE directives and standards	
<b>Enclosure</b>	<b>Protection Rating</b>	
	<input type="checkbox"/> Standard: NEMA 2	
	<b>Optional</b>	
	<input type="checkbox"/> NEMA 12 <input type="checkbox"/> NEMA 3 <input type="checkbox"/> NEMA 3R <input type="checkbox"/> NEMA 4	<input type="checkbox"/> NEMA 4X-304 sst painted <input type="checkbox"/> NEMA 4X-304 sst brushed finish <input type="checkbox"/> NEMA 4X-316 sst painted <input type="checkbox"/> NEMA 4X-316 sst brushed finish
<b>Accessories</b>		<b>Paint Specifications</b>
• Wall mounting lugs ( x4)		• Red RAL3002 • Powder coating • Glossy textured finish




<b>Fuseless Motor Starter</b>	<ul style="list-style-type: none"> <li>• Main disconnect – padlockable – rotary type handle – door interlocked</li> <li>• Thermo-magnetic motor protector</li> <li>• Contactor</li> </ul>		
<b>Control Circuit</b>	<ul style="list-style-type: none"> <li>• 24V.AC</li> </ul>		
<b>iPD+ Operator Interface</b>	<ul style="list-style-type: none"> <li>• Solid state controls</li> <li>• All adjustments on door front</li> <li>• Navigation pushbuttons</li> </ul>		
<b>Pressure Sensing</b>	<ul style="list-style-type: none"> <li>• Pressure transducer for fresh water application 316 stainless steel construction</li> <li>• Rated for 0-600psi working pressure</li> <li>• Pressure sensing line connection 1/2" brass Male NPT</li> </ul>		
<b>Visual Indications</b>	<ul style="list-style-type: none"> <li>• Manual motor start/run LED</li> <li>• Automatic motor start/run LED</li> <li>• Motor overload</li> <li>• Pressure reading               <ul style="list-style-type: none"> <li>• Start pressure</li> <li>• Stop pressure</li> <li>• System pressure</li> </ul> </li> <li>• System pressure diagnostic LED's               <ul style="list-style-type: none"> <li>• Green: system pressure at or above stop pressure</li> <li>• Yellow: system pressure between start and stop pressure</li> <li>• Red: system pressure at or below start pressure</li> </ul> </li> <li>• AUTO mode</li> <li>• OFF mode</li> </ul>		
<b>Timers</b>	<ul style="list-style-type: none"> <li>• Minimum run timer (off delay)</li> <li>• Delay start timer (on delay)</li> <li>• Visual countdown</li> </ul>		
<b>Counters</b>	<ul style="list-style-type: none"> <li>• Pump start counter</li> <li>• Elapsed timer meter (hours / non-resettable)</li> </ul>		
<b>Operators</b>	<ul style="list-style-type: none"> <li>• OFF-AUTO pushbutton</li> <li>• Start and Stop pushbutton</li> </ul>		
<b>Operation</b>	Automatic Start	Start on pressure drop	
	Manual Start	Start pushbutton	
	Stopping	Stop pushbutton	
	Timers	Field adjustable & visual countdown	<ul style="list-style-type: none"> <li>• Minimum run timer (off delay)</li> <li>• Delay start timer (on delay)</li> </ul>



<b>Seismic Certification</b>	Seismic Certification Company	TRU Compliance, LLC A Tobalski Watkins Affiliate					TWEI Project No.: 15014				
	Mounting details	Rigid wall mounting									
	Seismic Information	Building Code	Test Criteria	Seismic Parameters	<b>S<sub>Ds</sub></b>	<b>z/h</b>	<b>I<sub>p</sub></b>	<b>A<sub>FLX-H</sub></b>	<b>A<sub>RIG-H</sub></b>	<b>A<sub>FLX-V</sub></b>	<b>A<sub>RIG-V</sub></b>
	IBC 2015, CBC 2016	ICC-ES AC156	ASCE 7-10 Chapter 13	2.0	1.0	1.5	3.20	2.40	1.33	0.53	
				3.2	0.0	1.5	3.20	1.28	2.13	0.85	

RRS for Nonstructural Components Testing

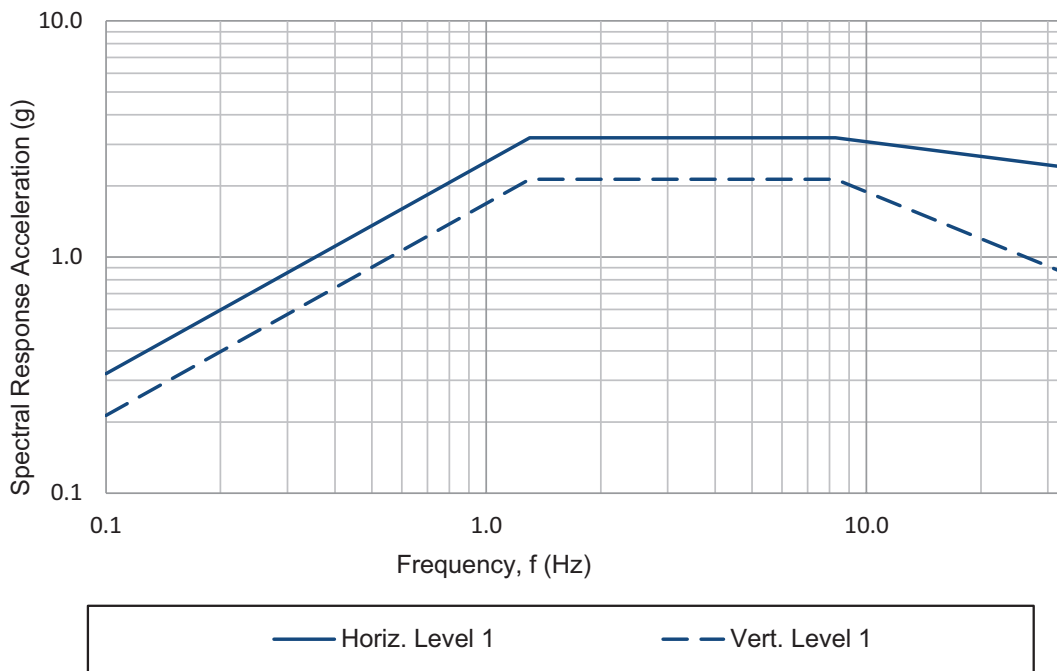

Notes:

- Components are tested in accordance with ICC-ES AC156, IBC 2015 & CBC 2016.
- OSHPD Special Seismic Certification Preapproval (OSP)




<input type="checkbox"/> A4	Elapsed time meter (time totalizer)
<input type="checkbox"/> A5	Motor run alarm contact
<input type="checkbox"/> A6	Loss of power alarm contact
<input type="checkbox"/> A7	Overload or short circuit alarm contact
<input type="checkbox"/> D11D	Pressure transducer 0-600psi with ½" MNPT 316 stainless steel bushing
<input type="checkbox"/> D14	Export packing for 1 controller
<input type="checkbox"/> D13A	Externally mounted wetted parts
<input type="checkbox"/> D14	Export packing for 1 controller
<input type="checkbox"/> D18	Audible alarm
<input type="checkbox"/> D19	Anti-condensation heater and thermostat
<input type="checkbox"/> D20	Anti-condensation heater and humidistat
<input type="checkbox"/> D21	Tropicalization
<input type="checkbox"/> D22	Phase reversal / failure pilot light and alarm contact
<input type="checkbox"/> D23	Controller power healthy pilot light and alarm contact
<input type="checkbox"/> D24	Pump failure via current sensing relay with pilot light and dry alarm contact
<input type="checkbox"/> D25	Low zone pump control function
<input type="checkbox"/> D26	Mid zone pump control function
<input type="checkbox"/> D27	High zone pump control function
<input type="checkbox"/> D28	Selector switch in auto alarm contacts
<input type="checkbox"/> D29	Selector switch in off alarm contacts
<input type="checkbox"/> D30	Motor heater circuit
<input type="checkbox"/> D32	Service entrance rated - 100kA short circuit withstand rating: • 120V/1ph (0.5hp max.) • 240V/1ph (1hp max.) • 200V-208V - 60hz (2hp max.) • 220V-240V - 60hz (3hp max.) • 380V-416V - 50hz - 60hz (5hp max.) • 440V-480V - 60hz (5hp max.)
<input type="checkbox"/> D33	Service entrance rated - 65kA short circuit withstand rating: • 120V/1ph (0.5hp max.) • 240V/1ph (1hp max.) • 200V-208V - 60hz (3hp-15hp max.) • 220V-240V - 60hz (515hp max.) • 380V-416V - 50hz - 60hz (7.5hp - 40hp max.) • 440V-480V - 60hz (7.5hp-40hp max.)
<input type="checkbox"/> D34	Service entrance rated - 42kA short circuit withstand rating: • 600V - 60hz (7.5hp max.)

<input type="checkbox"/> L01	Other language and English (bilingual)
<input type="checkbox"/> L02	French
<input type="checkbox"/> L03	Spanish
<input type="checkbox"/> L04	German
<input type="checkbox"/> L05	Italian
<input type="checkbox"/> L06	Polish
<input type="checkbox"/> L07	Romanian
<input type="checkbox"/> L08	Hungarian
<input type="checkbox"/> L09	Slovak
<input type="checkbox"/> L10	Croatian
<input type="checkbox"/> L11	Czech
<input type="checkbox"/> L12	Portuguese
<input type="checkbox"/> L13	Dutch
<input type="checkbox"/> L14	Russian
<input type="checkbox"/> L15	Turkish
<input type="checkbox"/> L16	Swedish
<input type="checkbox"/> L17	Bulgarian
<input type="checkbox"/> L18	Thai
<input type="checkbox"/> L19	Indonesian
<input type="checkbox"/> L20	Slovenian
<input type="checkbox"/> L21	Danish
<input type="checkbox"/> L22	Greek
<input type="checkbox"/> L23	Arabic
<input type="checkbox"/> L24	Hebrew
<input type="checkbox"/> L25	Chinese

Note: Options chosen from this page are not electrically represented on the wiring schematics in this submittal package.

**iPD+ Operator Interface**

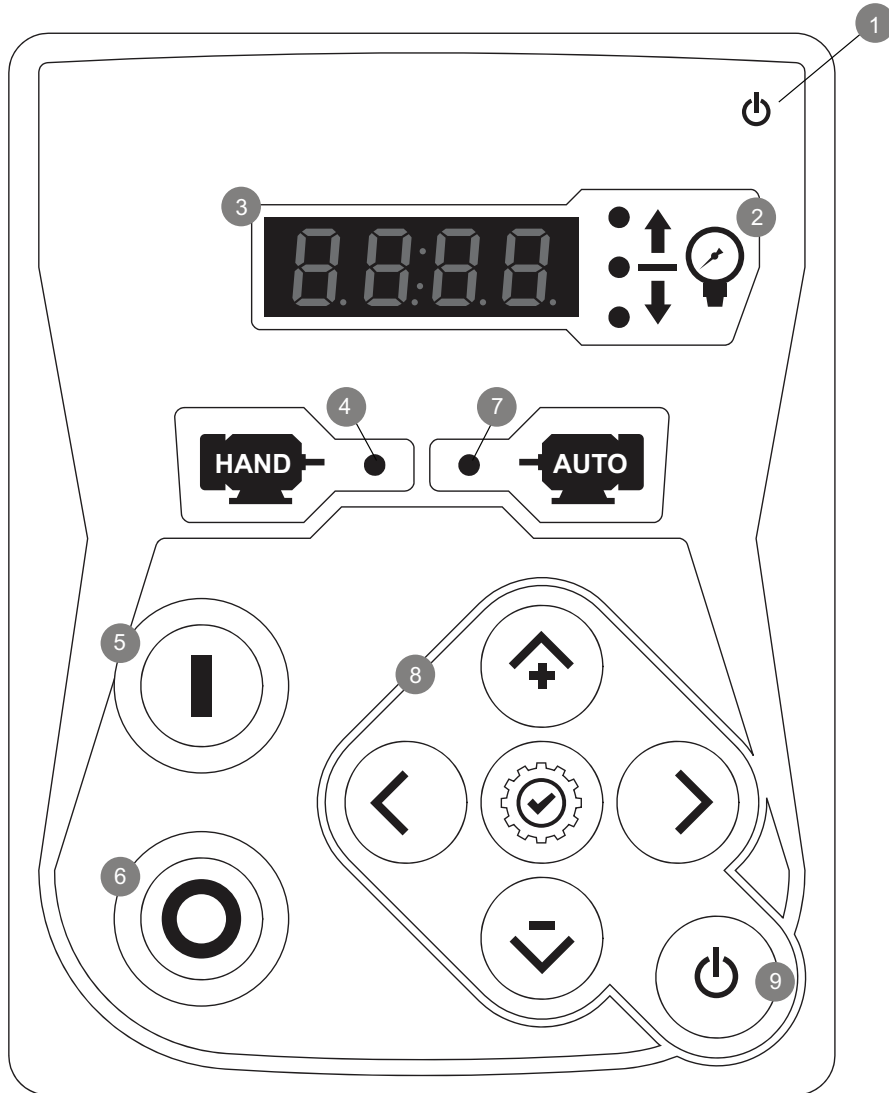

- |                       |                         |
|-----------------------|-------------------------|
| 1 - Power on LED      | 6 - STOP pushbutton     |
| 2 - System status LED | 7 - Auto start LED      |
| 3 - Digital display   | 8 - Navigation keypad   |
| 4 - Hand start LED    | 9 - ON - OFF pushbutton |
| 5 - START pushbutton  |                         |

# Jockey Pump Controller

Across the Line / 3 Phase

## Model:JP3

### Dimensions

Built to the latest edition of the UL 508A & CSA C22.2 No.14 standard

PER QUOTE DRAWING No.






NYC  
Dept of Building  
Approved



REV.	DESCRIPTION	DD/MM/YY
6	Modified J19 Outputs ID	10/06/16
7	Revised logo	18/06/18
8	Sensing line connection changed	25/03/25

Drawing No:  
**JP3-DI500/E**

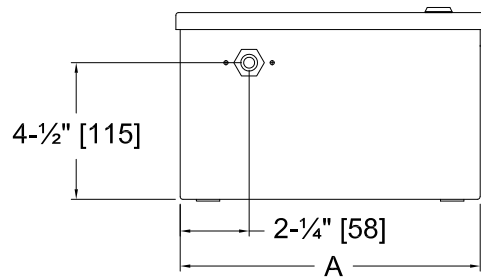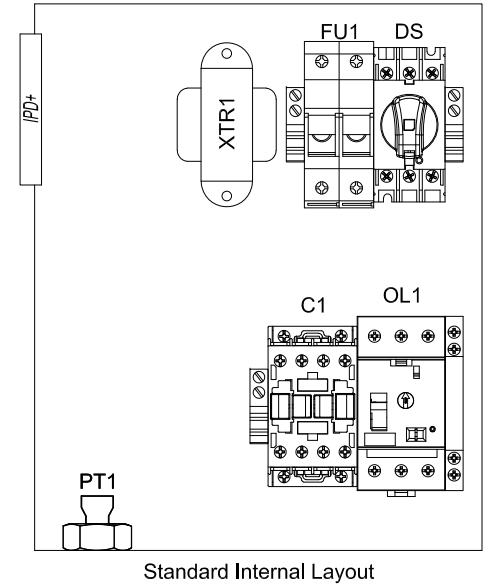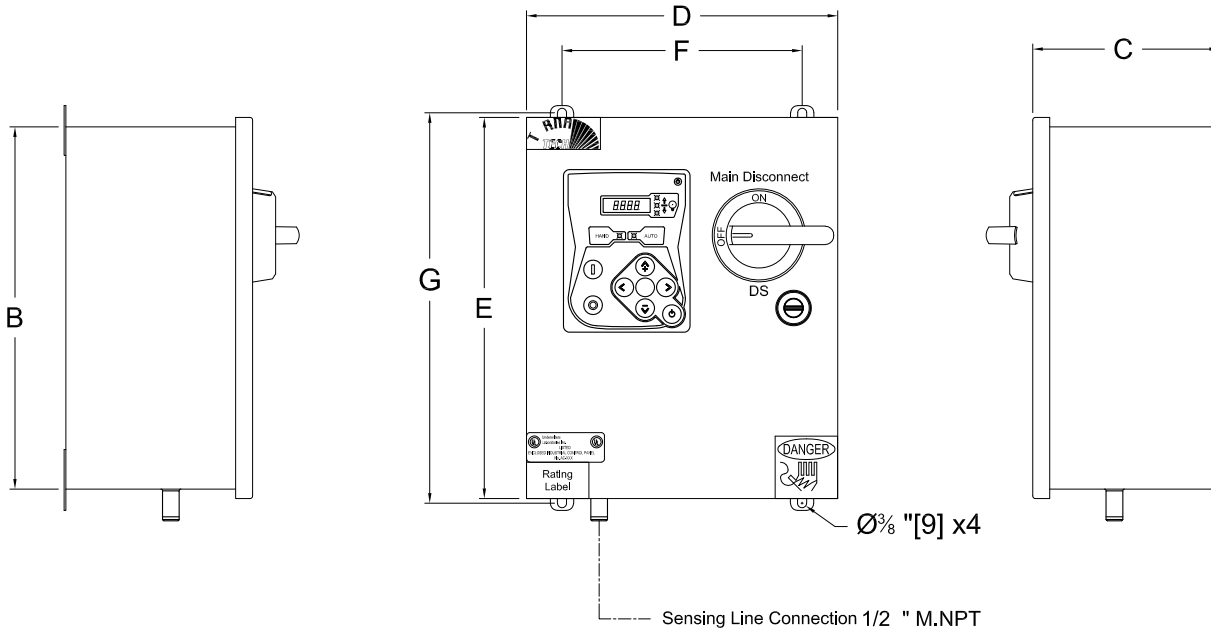

Dimensions*					Enclosure Dimensions A X B X C	Door Dimensions D X E	Anchor Dimensions F X G
Maximum Motor Horsepower							
200-208V	220-240V	380-416V	440-480V	575-600V	10"X12"X6-1/2"	10-3/4"X12-3/4"	8"X12-3/4"
10HP	10HP	15HP	20HP	25HP	16"X16"X7-1/2"	16-1/2"X16-1/2"	14"X16-3/4"
20HP	30HP	40HP	60HP	60HP			

#### Notes:


- Standard NEMA: NEMA 2
- Standard Paint: Textured Red RAL 3002.
- All Dimensions are in Inches [Millimeters]
- Use Watertight Conduit and Connector Only.
- Protect Equipment Against Drilling Chips.
- Door Swing Equal to Door Width

Drawing for information only.

Manufacturer reserves the right to modify this drawing without notice.

Contact manufacturer for "As Built" drawing.

\*Dimensions may change depending on option required. Consult Factory for exact dimensions.




# Jockey Pump Controller


Across the Line / 3 Phase

## Model:JP3

### Wiring schematic

Built to the latest edition of the UL 508A & CSA C22.2 No.14 standard

PER QUOTE DRAWING No.		SEISMIC COMPLIANT	UL	SF	NYC Dept of Building Approved	
REV.	DESCRIPTION	DD/MM/YY				
5	Modified Tormatech & Seismic Logo	14/04/16				
6	Modified J19 Outputs ID	10/06/16				
7	Revised logo	18/06/18				Drawing No. JP3-WS500/E

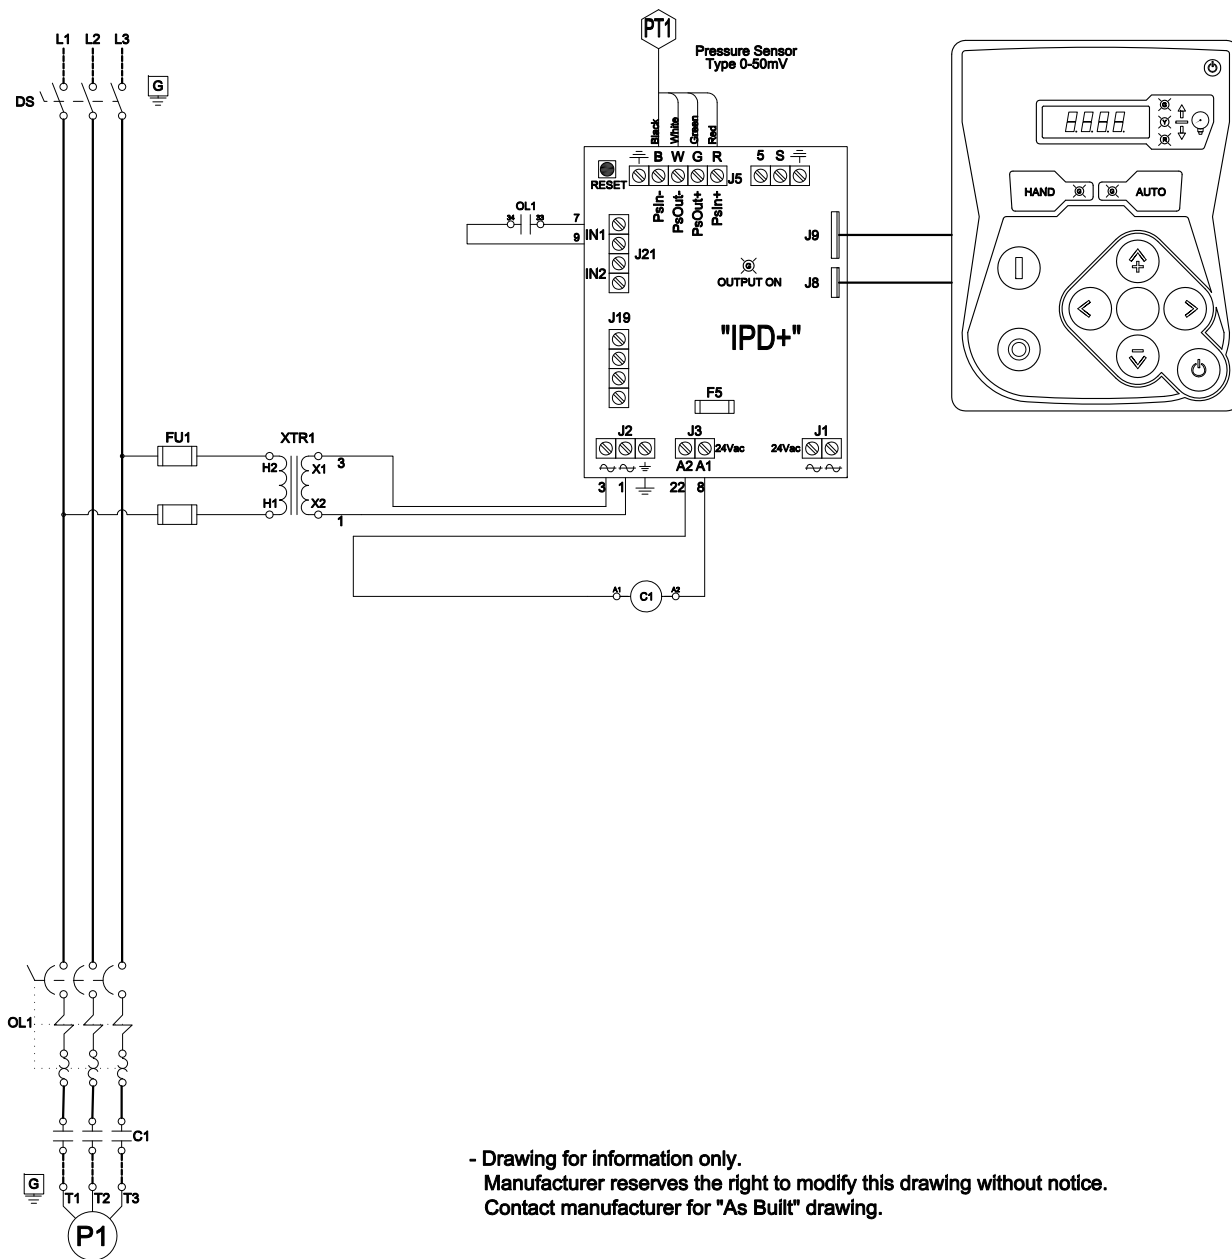

- Drawing for information only.  
 Manufacturer reserves the right to modify this drawing without notice.  
 Contact manufacturer for "As Built" drawing.


# Jockey Pump Controller

Across the Line / 3 Phase


## Model:JP3

### Line and Motor Terminal Size

Built to the latest edition of the UL 508A & CSA C22.2 No.14 standard

PER QUOTE DRAWING No.		SEISMIC COMPLIANT	UL	SP	NYC Dept of Building Approved	 <b>TOMATECH</b>
REV.	DESCRIPTION	DD/MM/YY				
5	Modified Tomatech & Seismic Logo	14/04/16				
6	Modified J19 Outputs ID	10/06/16				
7	Revised logo	18/06/18				Drawing No. <b>JP3-TD500/E</b>

### Power Connections and Motor Connections

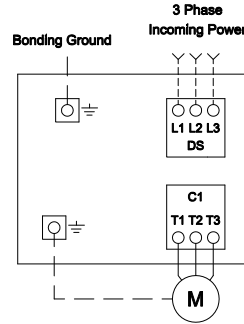


#### Line Terminals (L1,L2,L3,GND)

Maximum Motor Horsepower					Wire Size Copper Only	Torque	Wire Size Ground Copper Only
200-208V	220-240V	380-416V	440-480V	575-600V			
10HP	10HP	20HP	20HP	25HP	#14 AWG - #6 AWG	2 Nm	#14 AWG - #2 AWG
20HP	30HP	40HP	60HP	60HP	#12 AWG - #1 AWG	6 Nm	#6 AWG - #2 AWG


#### Motor Terminals (T1,T2,T3,GND)

Maximum Motor Horsepower					Wire Size Copper Only	Torque	Wire Size Ground Copper Only
200-208V	220-240V	380-416V	440-480V	575-600V			
5HP	7.5HP	10HP	15HP	20HP	#14 AWG - #10 AWG	1.8 Nm	#14 AWG - #2 AWG
10HP	10HP	15HP	20HP	25HP	#14 AWG - #6 AWG	2.5 Nm	#12 AWG - #2 AWG
15HP	20HP	30HP	50HP	50HP	#10 AWG - #3 AWG	5 Nm	#12 AWG - #2 AWG
20HP	30HP	40HP	60HP	60HP	#10 AWG - #2 AWG	11.3 Nm	#12 AWG - #2 AWG

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## ACCESSORIES

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

	Vendor Ref. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## Flow Meter

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



# GERAND ENGINEERING

## “MODEL G” FIRE PUMP TEST METERS

Accurate Pump Performance and Quality Service for 50 Years



**BEST VALUE  
IN THE  
INDUSTRY**

**5 YEAR  
WARRANTY**

**MANUFACTURED  
IN THE USA**

**HIGH GRADE  
MATERIALS:**

*CARBON STEEL,  
STAINLESS STEEL,  
EPOXY AND  
MONEL*



### MODEL-G METERS

-- RATING 500 PSI --  
(Buttweld, Grooved,  
300# Flanged)

-- RATING 275 PSI --  
(150# Flanged)

CALIBRATED VENTURI &  
ATTACHED GPM METER

4½” DIAL METER  
MOUNTS ON  
VENTURI BRACKET



**ADDITIONAL SIZES LISTED  
AT [WWW.GERAND.COM](http://WWW.GERAND.COM)**

PUMP GPM	PIPE SIZE	VENTURI STYLE	METER RANGE (GPM)	VENTURI LENGTH (BUTTWELD OR GROOVED)	VENTURI LENGTH (150# FLANGED)	VENTURI LENGTH (300# FLANGED)
50	2"	685	25-100	4½" THREADED	-	-
100	2 1/2"	746	50-200	3" BUTTWELD 4" GROOVED	9½"	10"
250	4"	744	125-500	3½" BUTTWELD 3¾" GROOVED	9½"	10¾"
300	4"	744	150-600			
450	4"	744	225-900			
500	5"	715	250-1000	5"	12"	13¾"
500	6"	743	250-1000	6"	13"	14¾"
750	6"	743	375-1500			
1000	6"	743	500-2000			
1250	6"	743	625-2500	7"	15'	16¾"
1500	8"	750	750-3000			
2000	8"	750	1000-4000			
2500	8"	750	1250-5000			




[WWW.GERAND.COM](http://WWW.GERAND.COM) FOR MORE INFORMATION

\*Venturi available in Raised or Flat Face; Steel, Stainless Steel or Monel


\*\*Dual LPM/GPM Scales Available

# VENTURI STYLES


**BUTTWELD**

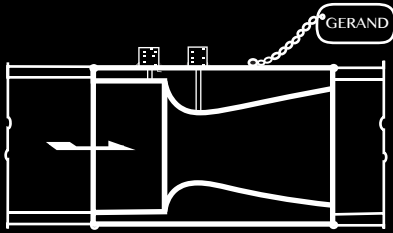


**GROOVED**

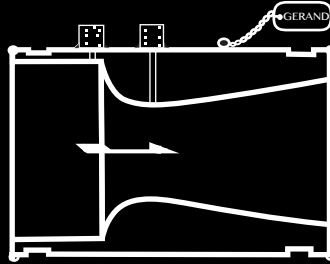

**FLANGED**

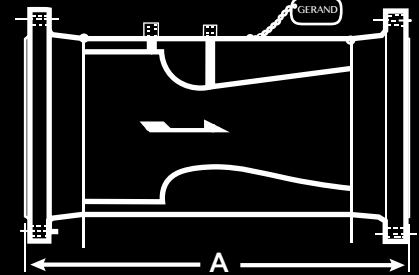


## OPERATING INSTRUCTIONS

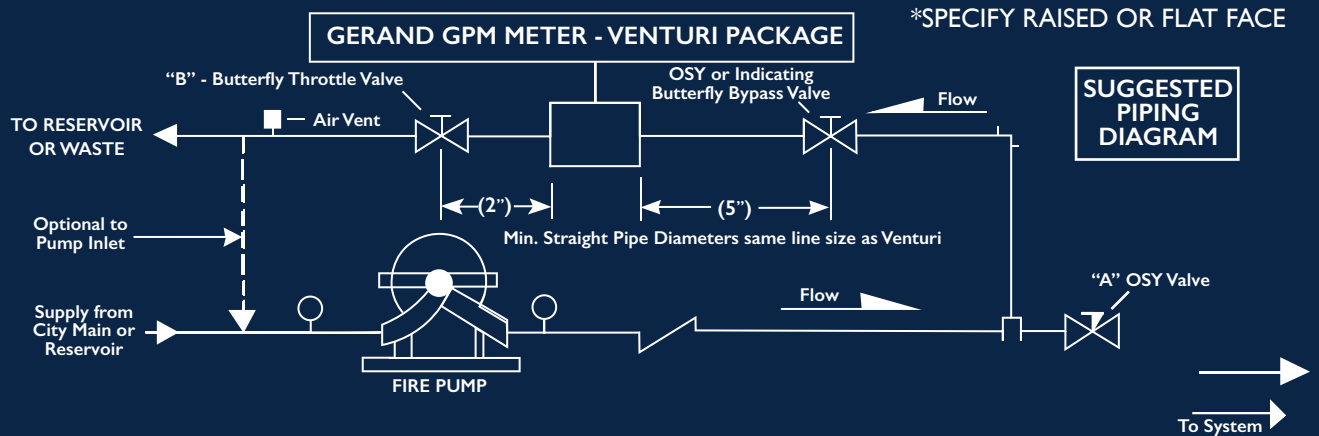

1. Close system OSY valve "A"
2. Open by-pass valve and "B" butterfly throttle valve
3. Purge meter, located on venturi, as follows:
  - a) Open station shut-off valves on venturi & vent valves attached to meter. When a steady stream of water passes through hose, meter is purged of air.
  - b) Close the vent valves after purging.

4. Start the fire pump, and read meter in GPM.
5. Refer to pump GPM requirement and adjust throttle valve to meet the requirement.
6. After the test, open valve "A" and close the by-pass and "B" valves.



	Vendor Ref. No.	
	Vendor Doc. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## Pressure Gauge

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

# Bourdon Tube Pressure Gauges Standard Series Type 111.10SP

WIKA Datasheet 111.10SP

## Applications

- Fire sprinkler systems
- Suitable for all media that will not obstruct the pressure system or attack copper alloy parts

## Product Features

- UL-listed (UL-393), United States and Canada
- Factory Mutual (FM) approved
- Reliable and economical

## Specifications

### Design

EN 837-1 & ASME B40.100

### Sizes

4" (100 mm)

### Accuracy class

± 3/2/3% of span (ASME B40.100 Grade B)

### Ranges

0/80 psi (5,5 bar), retard to 250 psi (17 bar), air

0/300 psi (20 bar), water

0/400 psi (28 bar), water

0/600 psi (40 bar), water

### Working pressure

Steady: 3/4 of full scale value

Fluctuating: 2/3 of full scale value

Short time: full scale value

### Operating temperature

Ambient: -40°F to 140°F (-40°C to 60°C)

Media: 140°F (+60°C) maximum

### Temperature error

Additional error when temperature changes from reference temperature of 68°F (20°C) ±0.4% of span for every 18°F (10°K) rising or falling.



Bourdon Tube Pressure Gauge Type 111.10SP

### Bourdon tube

Material: copper alloy  
C-shape

### Pressure connection

Material: copper alloy  
1/4" NPT lower mount (LM)

### Movement

Copper alloy

### Dial

White aluminum with stop pin; black and red lettering

### Pointer

Black aluminum

### Case

Black polycarbonate

### Window

Snap-in clear polycarbonate

### Approvals

UL listed (UL-393)


Factory Mutual

## Optional Extras

(not all options are UL or FM approved)

- Brass restrictor
- Black-painted steel case
- Custom dial layout
- Other dual scales in combination with psi are available:  
bar, kPa, MPa, kg/cm<sup>2</sup>

## Dimensions

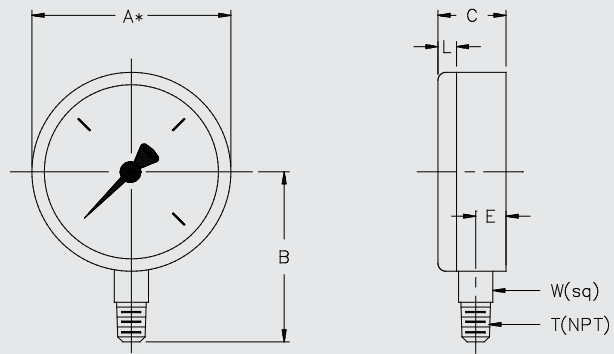

Size		A	B	C	E	L	T	W	Weight
4"	mm	100	71	30	11.5	3.75		14	
	in	4.0	2.79	1.18	0.45	0.15	1/4"	0.55	0.35 lb.

### Ordering information

Pressure gauge model / Nominal size / Scale range / Size of connection / Optional extras required  
 Specifications and dimensions given in this leaflet represent the state of engineering at the time of printing.  
 Modifications may take place and materials specified may be replaced by others without prior notice.



**WIKAI Instrument Corporation**  
 1000 Wiegand Boulevard  
 Lawrenceville, GA 30043-5868  
 Tel: 888-WIKA-USA • 770-513-8200  
 Fax: 770-338-5118  
 E-Mail: info@wika.com  
 www.wika.com

# Bourdon tube pressure gauge Model 111.11, welding gauge to ISO 5171

WIKA data sheet PM 01.03



for further approvals  
see page 2

## Applications

- For equipment and plants for welding, cutting and allied processes

## Special features

- Design per ISO 5171
- Pressure relief in case back
- Reliable and cost-effective



Bourdon tube pressure gauge model 111.11

## Description

### Design

ISO 5171

### Nominal size in mm

40, 50, 63

### Accuracy class

2.5

### Scale ranges

Welding engineering standard ranges for oxygen and acetylene to ISO 5171, as well as 0 ... 1 to 0 ... 400 bar to EN 837-1

### Pressure limitation

Steady: 3/4 x full scale value

Fluctuating: 2/3 x full scale value

Short time: Full scale value

### Permissible temperature

Ambient: -20 ... +60 °C

Medium: +60 °C maximum

### Temperature effect

When the temperature of the measuring system deviates from the reference temperature (+20 °C): max.  $\pm 0.4\%$ /10 K of the span

## Standard version

### Process connection

Copper alloy, lower mount (LM), with restrictor  
 NS 40: G 1/8 B (male), 14 mm flats  
 NS 50,63: G 1/4 B (male), 14 mm flats

### Pressure element

Copper alloy (with acetylene, max. 70 % copper content),  
 C-type or helical type

### Movement

Copper alloy

### Dial


Plastic, white, with pointer stop pin  
 Black lettering

### Pointer

Plastic, black

## Dimensions in mm

### Standard version

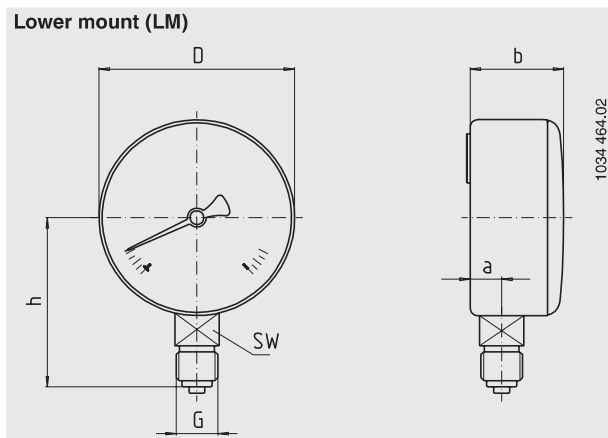

NS	Dimensions in mm						Weight in kg
	a	b	D	G	h ±1	SW	
40	9.5	26	39	G 1/8 B	36	14	0.09
50	9.5	28	49	G 1/4 B	45	14	0.11
63	9.5	28	62	G 1/4 B	53.5	14	0.15

Process connection per EN 837-1 / 7.3

## Ordering information

Model / Nominal size / Scale range / Connection size / Options

© 2010 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.  
 The specifications given in this document represent the state of engineering at the time of publishing.  
 We reserve the right to make modifications to the specifications and materials.

### Case

Steel, brass-coloured,  
 with pressure relief in case back

### Window

Polycarbonate, snap-fitted in case

## Options

- Other process connection
- Sealings (model 910.17, see data sheet AC 09.08)
- Case brass or stainless steel
- Slip-on bezel
- Back mount (BM)
- Acetylene pressure gauge for pressure regulators for manifold systems per ISO 7291 (BAM tested)

## CE conformity

### Pressure equipment directive

97/23/EC, PS > 200 bar, module A, pressure accessory

## Approvals

- GOST, metrology/measurement technology, Russia
- GOST-R, import certificate, Russia
- CRN, safety (e.g. electr. safety, overpressure, ...), Canada

## Certificates <sup>1)</sup>


- 2.2 test report per EN 10204 (e.g. state-of-the-art manufacturing, material proof, indication accuracy)
- 3.1 inspection certificate per EN 10204 (e.g. indication accuracy)

1) Option

Approvals and certificates, see website



**WIKAL Alexander Wiegand SE & Co. KG**  
 Alexander-Wiegand-Straße 30  
 63911 Klingenberg/Germany  
 Tel. +49 9372 132-0  
 Fax +49 9372 132-406  
 info@wika.de  
 www.wika.de

	Vendor Ref. No.	
	Vendor Doc. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

**CRV**


<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>



## Model 513 & 513A


### Pressure Relief Control Valve

- FLUID® Model 513 Pressure Relief Control Valve is a direct-acting, spring loaded, diaphragm type relief valve.
- Model 513 is available with Brass construction as standard & model 513A is available with stainless steel construction.
- The PRV is intended to use in fire systems where maintaining pressure limit is critical for smooth operation to open & shut within close differential pressure limits.
- Available in Globe & Angle type configuration and suitable for vertical & horizontal installation.
- PRV set pressure is field adjustable with a range from 20 psi to 150 psi for LP model & 150 psi to 300 psi for HP model.
- Pressure gauge port (1/4") is provided for accurate pressure setting.

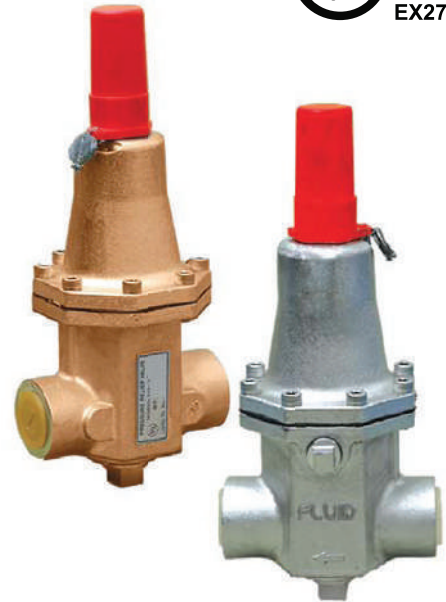


#### Material Specification

Sr. No.	Items	Model 513	Model 513A
1	Body & Cover	Brass	Stainless Steel (CF-8M)
2	Diaphragm	EPDM/NBR	EPDM/NBR
3	Spring Guide	Stainless Steel (SS316)	Stainless Steel (SS316)
4	Adjustment Screw	Brass	Stainless Steel (SS316)
5	Plug	Brass	Stainless Steel (SS316)
6	Tamper Proof Cap	ABS Plastic	ABS Plastic

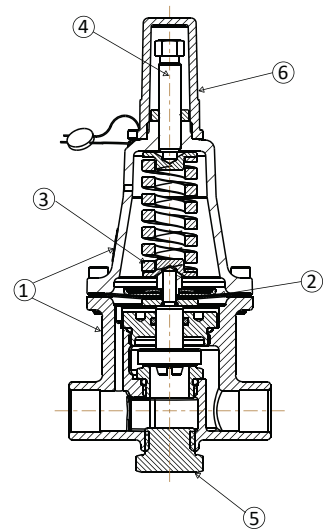

#### Dimensions

Nominal Size mm / in	A	B	C	D
15	90	82.5	205	1/2" NPT
1/2	3.54	3.25	8.07	1/2" NPT
20	90	82.5	210	3/4" NPT
3/4	3.54	3.25	8.27	3/4" NPT

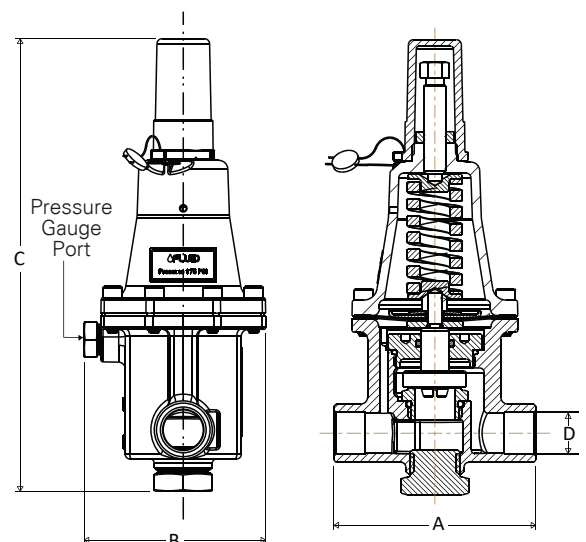

## Operation


Typically used in Fire Protection, FLUID® Pressure Relief Valve prevents excess pressure built up in a system. At a point when pressure exceeds the set limit, the valve opens, releasing excess pressure to the atmosphere & when pressure falls below the set point, the valve closes drip tight to its normally closed position.

The single port is closed by the force of the adjustable spring located above the pressure sensing diaphragm. When the force exceeds the force of the spring the valve will open to relieve the pressure and will close tight when pressure falls below the preset value.

Pressure adjustment can be done at field by turning the adjusting screw to vary the spring load within the adjustable range. The adjustment cap is wire sealed to prevent unauthorized tampering of set point.

## Configuration

Model 513 & 513A PRV is a versatile design which can be installed either in globe or angle pattern configuration for ease of installation.

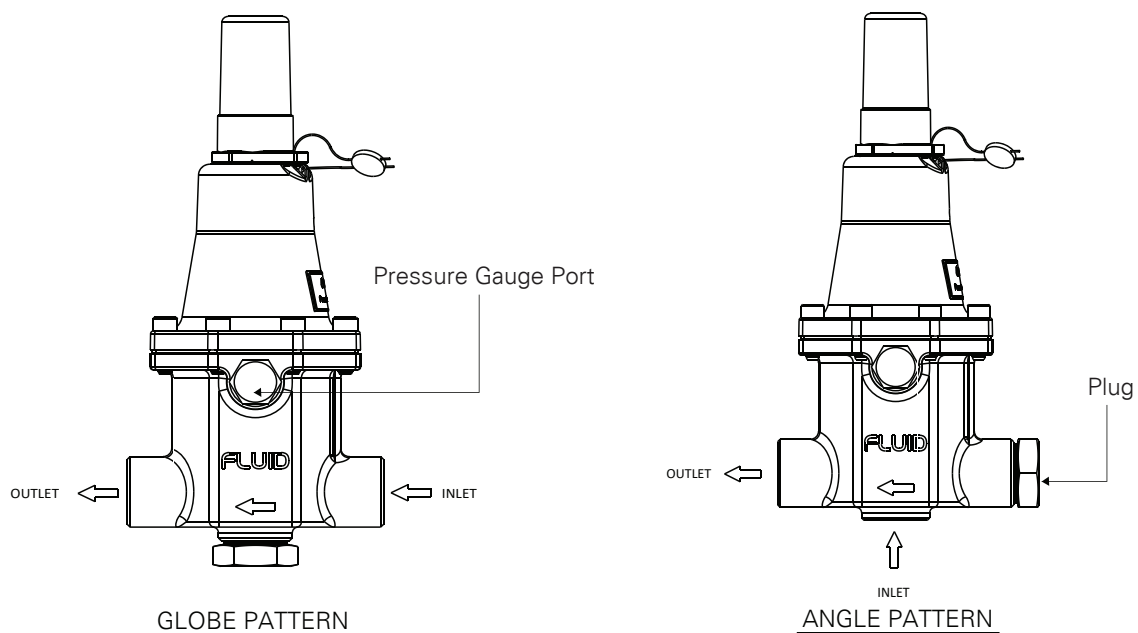

## Adjustable Range & Set Point

Model	Size	Adjustable Range		Factory Set Point *		Maximum Pressure Rating		Installation	Approval
		psi	bar	psi	bar	psi	bar		
513-LP	½", ¾"	20 - 150	1.37 - 10.34	100	6.9	300	20.68	H / V	UL
513-HP	½", ¾"	150 - 300	10.34 - 20.68	175	12.06	300	20.68	H / V	UL
513A-LP	½", ¾"	20 - 150	1.37 - 10.34	100	6.9	300	20.68	H / V	UL
513A-HP	¾"	150 - 300	10.34 - 20.68	175	12.06	300	20.68	H / V	UL

\* Custom set points are available up on request within these parameters.

H: Horizontal Installation, V: Vertical Installation

### Note:


The information contained in this document is subject to change without notice due to continuous improvement process. FLUID shall not be liable for any errors contained herein.



**Fluid Pumps & Equipment India Pvt. LTD**  
7/222, Nagamanaickenpalayam,  
Pattanam Road, Coimbatore,  
Tamil Nadu, India.

**Fluid Equipment International Limited**  
4 The Break,  
Colla Road, Schull,  
CO. Cork P81 E657, Ireland.


**Fluid Fire Equipment Manufacturing LLC**  
Plot No. 599-2285,  
Jebel Ali Industrial Area-1,  
Dubai, UAE.

	Vendor Ref. No.	
	Vendor Doc. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	


## DIESEL TANK DRAWING

<b>0</b>	<b>SUBMITTED FOR APPROVAL</b>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>


Shell Size :- 1315 x 2623 mm  
 End Plate size :- Ø 832mm

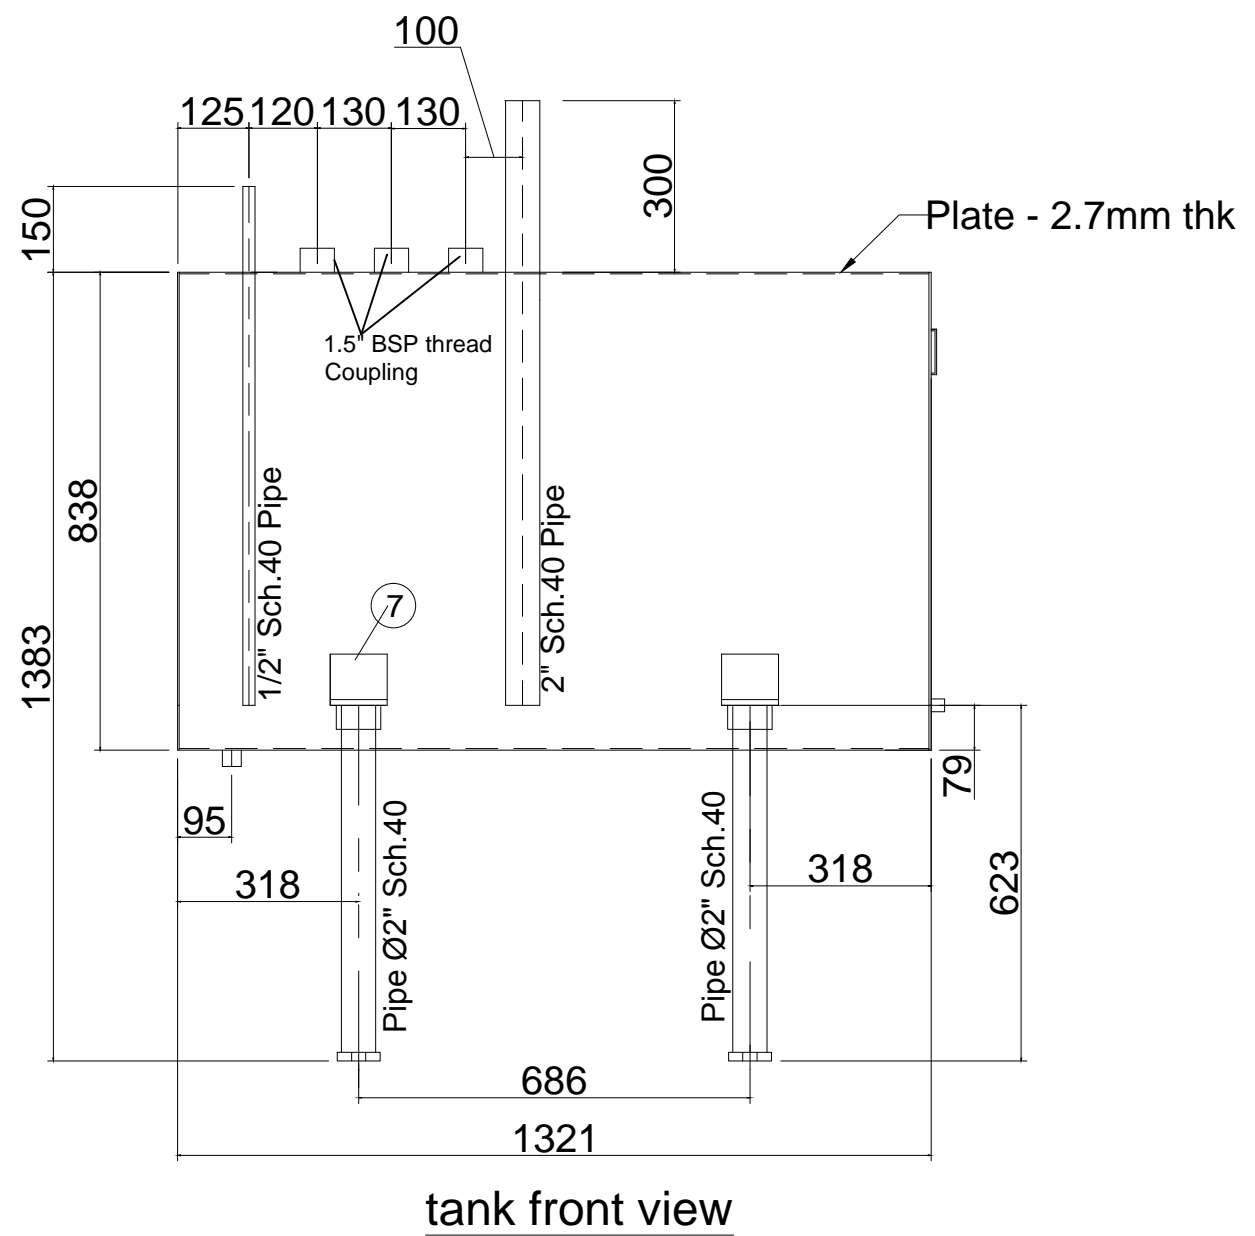

tank front view

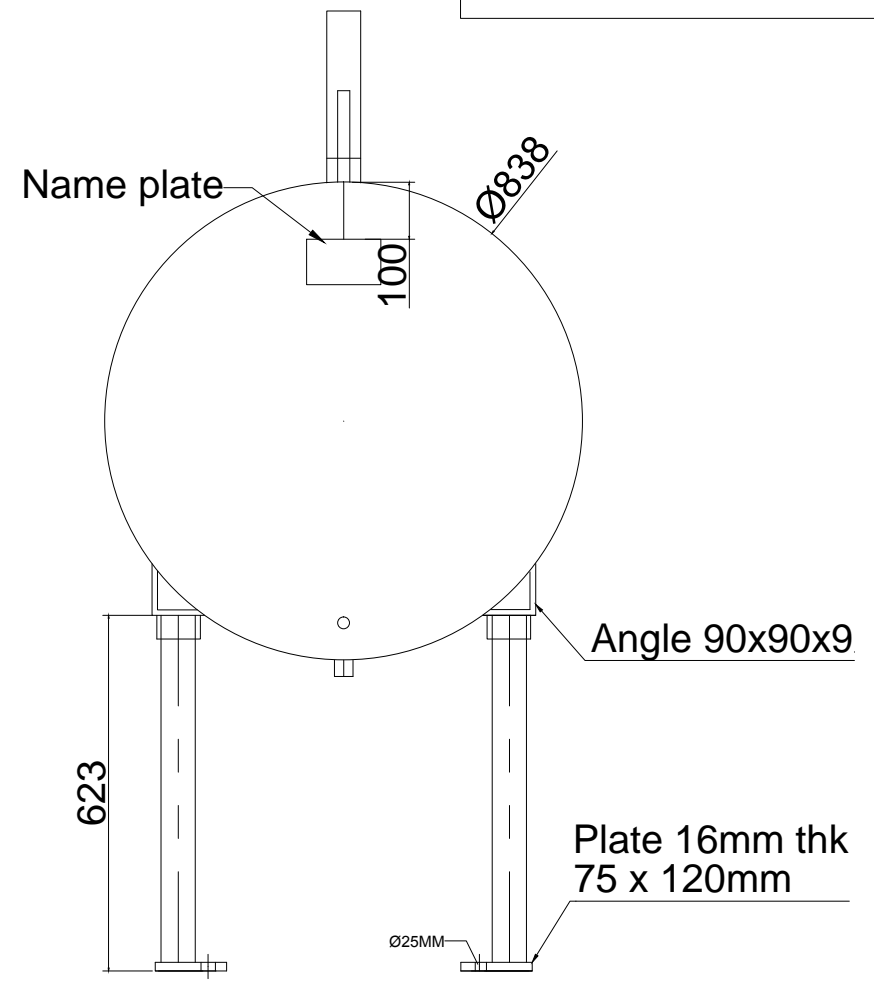


tank side view

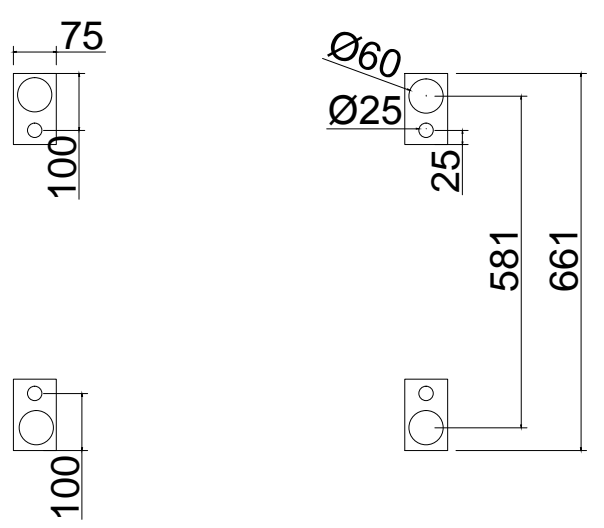

180 US GLN Tank

1. ALL DIMENSION ARE IN MILLIMETERS AND ALL LEVELS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
2. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELATED DRAWINGS.
3. ANY DISCREPANCY IN THE DRAWING SHALL BE BRING INTO NOTICE OF THE ENGINEER PRIOR TO THE EXECUTION OF WORK.
4. DO NOT COMMENCE THE WORK UNLESS THE DRAWING IS ISSUED FOR CONSTRUCTION.
5. PROJECT ENGINEERS SHALL CHECK ALL DIMENSIONS, SIZE ETC. BEFORE COMMENCING ANY WORK AT SITE.

NO.	DATE	DESCRIPTION	
00	03-07-2021	ISSUED FOR FABRICATION	
REVISIONS			
DO NOT SCALE DRAWINGS. FOLLOW WRITTEN DIMENSIONS			
PROJECT :-			
CLIENT:-			
BURIEN FIRE FIGHTING SYSTEMS CO.LLC			
CONSULTANT:-			
CONTRACTOR:-			
DRAWING TITLE			
180 US GLN TANK			
SUB CONTRACTOR:-			
DRAWN	SPS	DATE	03-Jul-2021
CHECKED	BSM	PROJECT NO.	
DESIGNED		SCALE	1:1
APPROVED		REVISION	00
DWG.NO.	MSF-BURIEN-180-001		

	Vendor Ref. No.	
	Vendor Doc. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

**PRV**

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

## Angle Fire Pump Relief Valve FL x FL Ends

FIG. F1329

### Specifications




- Flanged to EN 1092-2 PN16, ANSI Class125/150/250. (Other available on request)
- Opens quickly; maintains pressure within close limits.
- Wide range adjustable: 65psi - 300psi (4.5 bar - 21 bar).
- Pilot operated main valve.
- Reduced cavitation design.
- Simple field adjustable pressure setting, requiring no special tools or system down time.
- Closes gradually for surge-free operation.
- UL 1478 Listed and FM 1361 Approved.
- Limits maximum pump discharge pressure.
- Factory tested & preset to requirements.
- Applicable for water, foam.
- 300psi (21bar) high Working Pressure  
600psi (42bar) Hydrostatic Test
- Fusion Bonded Epoxy Coated Interior and Exterior to AWWA C550 Standard.

### Material Specifications

Main Valve Parts	Material	ASTM Specification
Body	Ductile Iron	A536 Grade 65-45-12
Seat	Stainless Steel	A351 Grade CF8
Seal Disc	Rubber	D2000 EPDM
Diaphragm	Nylon Reinforced Natural Rubber	
Diaphragm Disc	Ductile Iron	A536 Grade 65-45-12
Diaphragm Adapter	Ductile Iron	A536 Grade 65-45-12
Spring	Stainless Steel	A276 Type 304
Bonnet	Ductile Iron	A536 Grade 65-45-12
Bonnet Bolts	Carbon Steel	A307 Grade B
Stem	Stainless Steel	A276 Type 304
O-Ring	Rubber	D2000 NBR

No.	Trim Components	Material
1	Basic Control Valve Assembly	Assembly
2	Pressure Relief Pilot Assembly	Assembly
3	Ejector	Stainless Steel 304
4	Y-strainer	Stainless Steel 304
5	Tubing/Fittings	Stainless Steel 304
6	Check Valve	Stainless Steel 304
7	Stabilizer	Stainless Steel 304


### Main Dimensions (mm /inch)

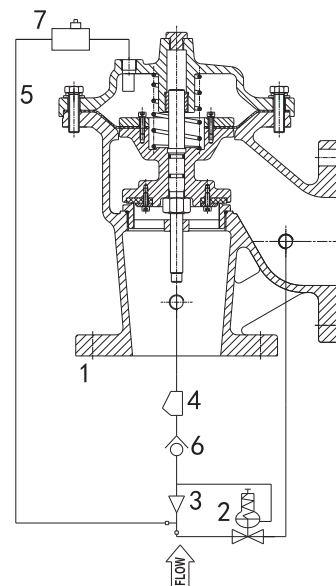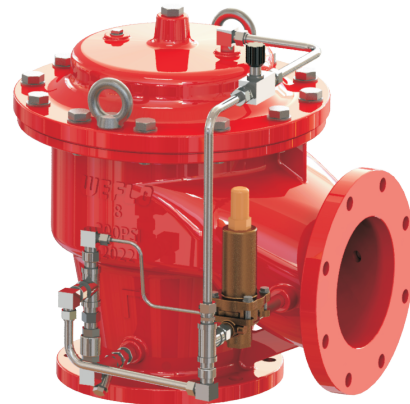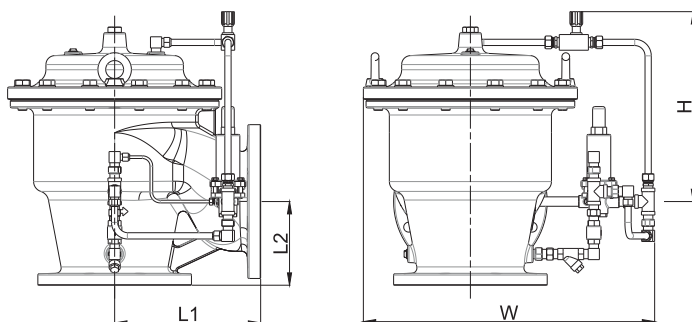

Size	L1	L2	H	W
3"	149/5.9	110/4.3	265/10.5	455/18.0
4"	185/7.3	130/5.1	310/12.2	470/18.5
5"	218/8.6	140/5.5	360/14.2	490/19.3
6"	265/10.4	155/6.1	380/15.0	540/21.3
8"	326/12.8	190/7.5	450/17.8	590/23.2

#### Notes

• Designs, materials and specifications shown are subject to change without notice due to the continuous development of our products.

	Vendor Ref. No.	
	Vendor Doc. No.	
	Contractor Ref. No.	
Project Name:	Contractor Job No.	

## DRAFT WARRANTY

<i>0</i>	<i>SUBMITTED FOR APPROVAL</i>				
<b>Rev</b>	<b>Description</b>	<b>Prepared</b>	<b>Checked</b>	<b>Approved</b>	<b>Date</b>

Date :  
Ref. : WC/ME/2025/K25XXX

## Warranty Certificate

<b>Project</b>	
<b>Plot</b>	
<b>Location</b>	
<b>Main Contractor</b>	
<b>Consultant</b>	

**Subject : WARRANTY CERTIFICATE – FIRE PUMP SET**

Dear Sir,

We hereby inform that material supplied by us for the above-mentioned project details as per the following:

**1- FIRE FIGHTING PUMP SET WITH CAPACITY ( GPM @ BAR) – Brand MENA**

Is under WARRANTY for (12) months from delivery/invoice date against Manufacture or Malfunction Defect and it is Limited only for Supplying or Repairing Free of Charge defective parts of material supplied by us.

The warranty shall not apply in the following situations:

- Defect arises from any modification undertaken by the customer/client or a third party without consent of our team
- Normal wear and tear
- Failure to observe the operating instructions
- Over-loading
- Mishandling the equipment or improper use.

Thanks & Best Regards,

**For Mena Mech. Ind. Co.**